

WESTERN COMMERCIAL GUIDE





**The SIMPLE FRAMING SYSTEM®
Makes Designing Homes Easier**

**Architects, engineers and designers trust
Boise Cascade’s engineered wood products
to provide a better system for
framing floors, roofs and walls.**

Boise Cascade Engineered Wood Products for Light Commercial Applications

Boise Cascade Engineered Wood Products are readily available through experienced distributors and retailers who provide valuable assistance in selecting and specifying the most economical joist and beam system. By specifying the products shown in the guide, time delays associated with so-called custom products from other manufacturers are minimized. While those products may be structurally adequate, they are only available on a “build to order” basis. That means your clients have automatically just added a minimum of 2-3 weeks to their production cycle: an eternity in today’s tight construction schedules. Add that same amount of time for a single mis-cut joist and you can certainly see how quickly a well-intended specification can turn into a logistical nightmare.

This design guide is intended to provide information for the preliminary sizing of Boise Cascade Engineered Wood Products. While the products and applications shown in this guide are similar to our residential applications guide, the building code provisions and design requirements of the light commercial projects are significantly different. Concentrated floor load provisions, partition loads, wind and seismic provisions, and fire protection systems are all examples of these differences. This guide helps identify these issues and provides corresponding product application details. Professional guidelines in most areas require the project’s design professional of record to be responsible for the overall design

of light commercial structures. This guide is intended to assist the design professional in specifying engineered wood products in dry-use condition of such structures.


BCI® Joists and Versa-Lam® LVL beams are manufactured per corresponding International Code Council building code evaluation reports. Testing and quality control is certified by an independent inspection agency. Boise Cascade Engineered Wood Products are warranted for the life of the structure (see back cover of this guide). For the location of the nearest Boise Cascade representative or supplier of Boise Cascade Engineered Wood Products, please call 800-232-0788.

For complete information on fire resistance detailing and design with the entire Boise Cascade EWP product line, please refer to the US Fire Design & Installation Guide, located at www.bc.com/ewp.

Table of Contents

Product Profiles, BCI® Specifications	3	Versa-Lam® LVL Non-Snow Roof Load Tables (125% Load Duration)	42
40 PSF - 100 PSF Live/Concentrated Load Span Tables	4 - 13	Versa-Lam® LVL Closest Allowable Nail Spacing	43
BCI® Floor Framing Details	14 - 17	Versa-Lam® LVL Design Values	43
BCI® Joist Hole Location and Sizing	18	Versa-Lam® LVL Columns, Versa-Stud®	44
BCI® Cantilever Details, Web Stiffener Requirements	19	BOISE GLULAM® Beams	45
BCI® Floor Load Tables	20 - 22	BOISE GLULAM® Information	46
BCI® Roof Framing Details	23 - 24	BOISE GLULAM® Custom Products	47
BCI® Roof Span Tables	25 - 29	BOISE GLULAM® Design Values - 24F-V4, 26F-V1	48 - 50
BCI® Roof Load Tables	30 - 34	BOISE GLULAM® IJC Design Values - 24F-V4, 26F-V1	51
BCI® Design Properties, BCI® Allowable Nail Spacing	35	KING BEAM™ 3000 Design Values	52
Boise Cascade Rimboard Products	36	BOISE CEDAR GLULAM™ Design Values	53
Versa-Lam® LVL Products, Specifications, Allowable Holes	37	BOISE GLULAM® Column Table & Allowable Stresses	54
Versa-Lam® LVL Details, Multiple Member Connectors	38	BOISE GLULAM® Beams Hanger Tables	55 - 56
Versa-Lam® LVL Allowable Floor Joist Spans	39	Computer Software	57
Versa-Lam® LVL Floor Load Tables (100% Load Duration)	40	Framing Connectors	58 - 59
Versa-Lam® LVL Snow Roof Load Tables (115% Load Duration)	41	Lifetime Guarantee	Back Cover

BCI® Joists

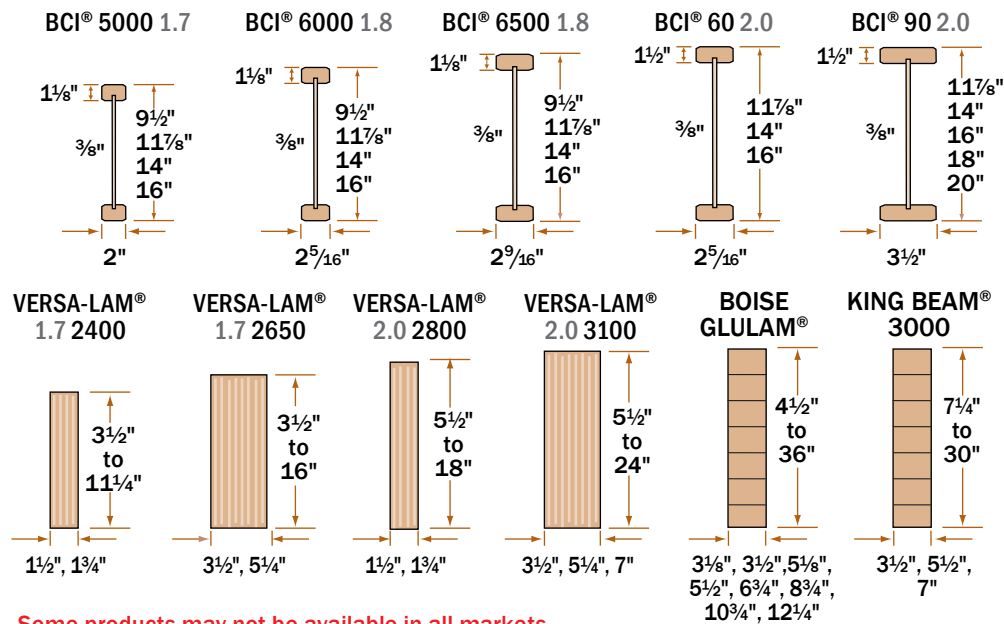

BCI® Joist Architectural Specifications

Scope: This work includes the complete furnishing and installation of all BCI® Joists as shown on the drawings, herein specified and necessary to complete the work.

Materials: BCI® Joists shall be manufactured by Boise Cascade Engineered Wood Products with oriented strand board webs, Versa-Lam® laminated veneer lumber flanges and waterproof, structural adhesives.

Joist webs shall be graded Structural I Exposure 1 by an agency listed by a model code evaluation service. Strands on the face layers of the web panels shall be oriented vertically in the joist. The web panels shall be glued together to form a continuous web member. The web panels shall be machined to fit into a groove in the center of the wide face of the flange members so as to form a pressed glue joint at that junction.

Design: The BCI® Joists shall be sized and detailed to fit the dimensions and loads indicated on the plans. All designs shall be in accordance with allowable values and section properties developed in accordance with ASTM D5055 and listed in the governing code evaluation service's report.

Drawing: Additional drawings showing layout and detail necessary for determining fit and placement in the building are (are not) to be provided by the supplier.

Fabrication: The BCI® Joists and section properties shall be manufactured in a plant evaluated for fabrication by the governing code evaluation service and under the supervision of a third-party inspection agency listed by the corresponding evaluation service.

Storage and Installation: The BCI® Joists, if stored prior to erection, shall be stored in a vertical and level position and protected from the weather. They shall be handled with care so they are not damaged.

The BCI® Joists are to be installed in accordance with the plans and the Boise Cascade Engineered Wood Products Installation Guide. Temporary construction loads which cause stresses beyond design limits are not permitted. Erection bracing shall be provided to keep the BCI® Joists straight and plumb as required and to assure adequate lateral support for the individual BCI® Joists and the entire system until the sheathing material has been applied.

Codes: The BCI® Joists shall be evaluated by a model code evaluation service.

BCI® Joists in Commercial Projects: All commercial projects utilizing BCI® joists shall have an engineer or architect of record.

40 PSF Live Load Span Tables

Multi-Family Dwellings and Hotels: Private Rooms

No Web Stiffeners Required Except for 18" & 20" BCI® 90 Joists

40 PSF Live Load + 25 PSF Dead Load

Joist Depth	Joist Series	3½" Interior Bearing				5¼" Interior Bearing			
		12" o.c.	16" o.c.	19.2" o.c.	24" o.c.	12" o.c.	16" o.c.	19.2" o.c.	24" o.c.
9½"	BCI® 5000 1.7	17'-1"	14'-11"	13'-8"	12'-2"	17'-1"	14'-11"	13'-8"	12'-2"
	BCI® 6000 1.8	17'-11"	16'-5"	15'-6"	13'-10"	17'-11"	16'-5"	15'-6"	13'-10"
	BCI® 6500 1.8	18'-6"	16'-11"	15'-11"	14'-7"	18'-6"	16'-11"	15'-11"	14'-7"
11⅞"	BCI® 5000 1.7	19'-7"	16'-11"	15'-5"	13'-9"	19'-7"	16'-11"	15'-5"	13'-10"
	BCI® 6000 1.8	21'-3"	19'-3"	17'-7"	15'-3"	21'-3"	19'-3"	17'-7"	15'-8"
	BCI® 6500 1.8	21'-11"	20'-0"	18'-6"	15'-3"	21'-11"	20'-0"	18'-6"	16'-6"
	BCI® 60 2.0	23'-3"	21'-3"	20'-1"	16'-10"	23'-3"	21'-3"	20'-1"	18'-8"
	BCI® 90 2.0	26'-3"	23'-11"	22'-7"	20'-8"	26'-3"	23'-11"	22'-7"	21'-0"
14"	BCI® 5000 1.7	21'-4"	18'-5"	16'-10"	14'-4"	21'-4"	18'-5"	16'-10"	15'-0"
	BCI® 6000 1.8	24'-3"	20'-11"	19'-1"	15'-11"	24'-3"	20'-11"	19'-1"	17'-1"
	BCI® 6500 1.8	24'-11"	22'-1"	19'-11"	15'-11"	24'-11"	22'-1"	20'-1"	17'-11"
	BCI® 60 2.0	26'-6"	24'-2"	21'-0"	16'-10"	26'-6"	24'-2"	22'-10"	19'-7"
	BCI® 90 2.0	29'-9"	27'-1"	25'-6"	20'-10"	29'-9"	27'-1"	25'-6"	23'-9"
16"	BCI® 5000 1.7	22'-9"	19'-8"	18'-0"	14'-8"	22'-9"	19'-8"	18'-0"	15'-5"
	BCI® 6000 1.8	25'-11"	22'-5"	20'-3"	16'-2"	25'-11"	22'-5"	20'-5"	18'-0"
	BCI® 6500 1.8	27'-3"	23'-7"	20'-3"	16'-2"	27'-3"	23'-7"	21'-6"	18'-0"
	BCI® 60 2.0	29'-3"	25'-3"	21'-0"	16'-10"	29'-3"	26'-8"	24'-6"	19'-7"
	BCI® 90 2.0	32'-11"	29'-11"	26'-3"	20'-11"	32'-11"	29'-11"	28'-3"	25'-0"
18"	BCI® 90 2.0	35'-11"	32'-8"	30'-10"	25'-5"	35'-11"	32'-8"	30'-10"	28'-8"
20"	BCI® 90 2.0	38'-10"	35'-4"	32'-11"	26'-4"	38'-10"	35'-4"	33'-4"	29'-9"

NOTES

- Loading based upon Table 1607.1 of 2009 International Building Code
- Spans limited by allowable moment and reaction values, total load deflection of L/240. Live load deflection limited to L/480.
- Table values assume that 23/32" min. plywood/OSB rated sheathing is glued and nailed to joists.
- Table values represent the most restrictive of simple or multiple span applications.
- Table values are the maximum allowable clear distance between supports.
- Table assumes minimum 2¼" end bearing. 18" & 20" BCI® 90 joists require web stiffeners at all bearing locations.
- This table was designed to apply to a broad range of applications. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc® sizing software.

Medical/Dental: Private Rooms

Web Stiffeners Required at All Bearing Locations for Table Below

Spans without web stiffeners and/or shorter bearings are possible, analyze such conditions with BC Calc® sizing software.

[Worst Case 40 PSF or 1000 LB Concentrated Live Load] + 25 PSF Dead Load					
Joist Depth	Joist Series	3½" Interior Bearing / 5¼" Interior Bearing			
		12" o.c.	16" o.c.	19.2" o.c.	24" o.c.
9½"	BCI® 5000 1.7	15'-10"	13'-6"	11'-10"	10'-0"
	BCI® 6000 1.8	16'-7"	15'-2"	14'-3"	12'-1"
	BCI® 6500 1.8	17'-1"	15'-7"	14'-8"	13'-0"
11⅞"	BCI® 5000 1.7	18'-8"	16'-2"	14'-2"	12'-0"
	BCI® 6000 1.8	19'-8"	18'-0"	16'-11"	14'-6"
	BCI® 6500 1.8	20'-3"	18'-6"	17'-6"	15'-7"
	BCI® 60 2.0	21'-6"	19'-8"	18'-6"	17'-3"
	BCI® 90 2.0	24'-3"	22'-1"	20'-10"	19'-4"
14"	BCI® 5000 1.7	21'-3"	18'-3"	16'-1"	13'-8"
	BCI® 6000 1.8	22'-5"	20'-6"	19'-1"	16'-5"
	BCI® 6500 1.8	23'-0"	21'-0"	19'-10"	17'-8"
	BCI® 60 2.0	24'-6"	22'-4"	21'-1"	19'-7"
	BCI® 90 2.0	27'-6"	25'-0"	23'-7"	21'-10"
16"	BCI® 5000 1.7	22'-9"	19'-8"	17'-8"	15'-0"
	BCI® 6000 1.8	24'-9"	22'-5"	20'-5"	18'-0"
	BCI® 6500 1.8	25'-5"	23'-2"	21'-6"	19'-3"
	BCI® 60 2.0	27'-1"	24'-8"	23'-3"	21'-8"
	BCI® 90 2.0	30'-5"	27'-8"	26'-1"	24'-2"
18"	BCI® 90 2.0	33'-3"	30'-2"	28'-5"	25'-5"
20"	BCI® 90 2.0	35'-11"	32'-8"	30'-9"	26'-4"

NOTES

- Loading based upon Table 1607.1 of 2009 International Building Code
- Spans limited by allowable moment and reaction values, total load deflection of L/240. Live load deflection limited to L/480 with 40 psf.
- Table values assume that 23/32" min. plywood/OSB rated sheathing is glued and nailed to joists.
- Table values represent the most restrictive of simple or multiple span applications.
- Table values are the maximum allowable clear distance between supports.
- Table values assume web stiffeners at each bearing location, minimum 2¼" end bearing.
- This table was designed to apply to a broad range of applications. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc® sizing software.
- School and essential service projects in California (DSA) require additional design provisions and thus the above span length limits may not apply. Contact Boise Cascade EWP Engineering for further information.

Concentrated Live Loads ("Safe" Loads)

The International Building Code requires certain types of commercial floors to be designed with a concentrated live load, in addition to the prescribed uniform loads. This concentrated live load is applied to the floor without the uniform live load but with all dead load, creating a separate live load analysis. The concentrated load is either 2000 lb or 1000 lb, depending upon the floor type, and is applied to a 2½ foot x 2½ foot square area. This 2½-foot square is applied on the floor such that would result in the highest shear and bending stress, and deflections. Since this load is intended to create maximum stress and deflection conditions, it is centered over a specific floor joist. Floor joists at 24" on-center will receive more load from the

concentrated live load than joists spaced at smaller increments. For example, a joist at 24" on-center will receive 2/2.5 or 80% of the concentrated load over a distance of 2'-6" along the joist length.

There have been some misconceptions in the design community on how the concentrated live load should be applied to floors. Boise Cascade EWP Engineering has consulted directly with ICC on this matter. The loads prescribed in section 1607.4 of the 2009 IBC have been properly considered in the development of the relative floor joist tables in this guide.

[Worst Case 50 PSF or 1000 LB Concentrated Live Load] +
15 PSF Partition Load + 25 PSF Dead Load
Office Buildings: Office Area

Web Stiffeners Required at All Bearing Locations for Table Below

Spans without web stiffeners and/or shorter bearings are possible, analyze such conditions with BC Calc® sizing software.

[Worst Case 50 PSF or 1000 LB Concentrated Live Load] + 15 PSF Partition Load + 25 PSF Dead Load									
Joist Depth	Joist Series	3½" Interior Bearing				5¼" Interior Bearing			
		12" o.c.	16" o.c.	19.2" o.c.	24" o.c.	12" o.c.	16" o.c.	19.2" o.c.	24" o.c.
9½"	BCI® 5000 1.7	11'-3"	8'-11"	6'-8"	3'-9"	11'-3"	8'-11"	6'-8"	3'-9"
	BCI® 6000 1.8	13'-9"	10'-11"	9'-5"	5'-7"	13'-9"	10'-11"	9'-5"	5'-7"
	BCI® 6500 1.8	14'-11"	11'-10"	10'-3"	5'-7"	14'-11"	11'-10"	10'-3"	5'-7"
11⅞"	BCI® 5000 1.7	13'-8"	10'-11"	9'-5"	6'-3"	13'-8"	10'-11"	9'-5"	6'-3"
	BCI® 6000 1.8	16'-9"	13'-4"	11'-6"	6'-3"	16'-9"	13'-4"	11'-6"	6'-3"
	BCI® 6500 1.8	18'-2"	14'-6"	12'-6"	6'-3"	18'-2"	14'-6"	12'-6"	6'-3"
	BCI® 60 2.0	19'-11"	18'-2"	13'-10"	6'-3"	19'-11"	18'-2"	13'-10"	6'-3"
	BCI® 90 2.0	22'-5"	20'-4"	19'-2"	16'-3"	22'-5"	20'-4"	19'-2"	16'-3"
14"	BCI® 5000 1.7	15'-8"	12'-6"	10'-9"	8'-10"	15'-8"	12'-6"	10'-9"	8'-10"
	BCI® 6000 1.8	19'-2"	15'-3"	13'-3"	8'-10"	19'-2"	15'-3"	13'-3"	8'-10"
	BCI® 6500 1.8	20'-9"	16'-7"	14'-4"	8'-10"	20'-9"	16'-7"	14'-4"	8'-10"
	BCI® 60 2.0	22'-7"	20'-7"	18'-8"	8'-10"	22'-7"	20'-7"	18'-8"	8'-10"
	BCI® 90 2.0	25'-5"	23'-1"	21'-3"	17'-0"	25'-5"	23'-1"	21'-8"	19'-8"
16"	BCI® 5000 1.7	17'-5"	13'-10"	12'-0"	10'-0"	17'-5"	13'-10"	12'-0"	10'-0"
	BCI® 6000 1.8	21'-3"	17'-0"	14'-8"	12'-3"	21'-3"	17'-0"	14'-8"	12'-3"
	BCI® 6500 1.8	23'-0"	18'-5"	15'-11"	12'-6"	23'-0"	18'-5"	15'-11"	12'-6"
	BCI® 60 2.0	25'-0"	22'-9"	20'-2"	12'-6"	25'-0"	22'-9"	20'-8"	12'-6"
	BCI® 90 2.0	28'-1"	25'-6"	22'-1"	17'-8"	28'-1"	25'-6"	24'-0"	20'-7"
18"	BCI® 90 2.0	30'-8"	27'-7"	22'-11"	18'-4"	30'-8"	27'-10"	26'-3"	21'-0"
20"	BCI® 90 2.0	33'-2"	28'-7"	23'-9"	19'-0"	33'-2"	30'-2"	26'-10"	21'-5"

NOTES

- Loading based upon Table 1607.1 of 2009 International Building Code
- Spans limited by allowable moment and reaction values, total load deflection of L/240. Live load deflection limited to L/600 with 50 psf, L/360 with 50 + 15 psf.
- Table values assume that 23/32" min. plywood/OSB rated sheathing is glued and nailed to joists.
- Table values represent the most restrictive of simple or multiple span applications.
- Table values are the maximum allowable clear distance between supports.
- Table values assume web stiffeners at each bearing location, minimum 2¼" end bearing.
- This table was designed to apply to a broad range of applications. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc® sizing software.
- School and essential service projects in California (DSA) require additional design provisions and thus the above span length limits may not apply. Contact Boise Cascade EWP Engineering for further information.

Deflection Criteria for Commercial Floors

The minimum deflection criterion for commercial floors is the same as for residential floors, L/360 for live load deflection and L/240 for total load deflection. Since deflection controls a significant amount of I-joist designs, an additional deflection limit has been considered in the development of the BCI® joist span tables shown in this guide. In addition to the minimum limits at full uniform and concentrated ("safe") live loads, deflection is limited to L/600 with a uniform live load of 50 psf in those tables where the code specified uniform live load is 50 psf or greater. As is the case with all joist designs, floor performance should always be considered by the design professional of record in each specific condition.

Medical/Dental: Operating Rooms & Laboratory
Library: Reading Rooms

[Worst Case 60 PSF or 1000 LB Concentrated Live Load] + 25 PSF Dead Load									
Joist Depth	Joist Series	3½" Interior Bearing				5¼" Interior Bearing			
		12" o.c.	16" o.c.	19.2" o.c.	24" o.c.	12" o.c.	16" o.c.	19.2" o.c.	24" o.c.
9½"	BCI® 5000 1.7	14'-7"	13'-1"	11'-10"	10'-0"	14'-7"	13'-1"	11'-10"	10'-0"
	BCI® 6000 1.8	15'-4"	14'-0"	13'-2"	12'-1"	15'-4"	14'-0"	13'-2"	12'-1"
	BCI® 6500 1.8	15'-9"	14'-4"	13'-7"	12'-4"	15'-9"	14'-4"	13'-7"	12'-7"
11⅞"	BCI® 5000 1.7	17'-1"	14'-9"	13'-6"	12'-0"	17'-1"	14'-9"	13'-6"	12'-0"
	BCI® 6000 1.8	18'-2"	16'-7"	15'-4"	13'-3"	18'-2"	16'-7"	15'-4"	13'-8"
	BCI® 6500 1.8	18'-9"	17'-1"	16'-2"	13'-3"	18'-9"	17'-1"	16'-2"	14'-0"
	BCI® 60 2.0	19'-11"	18'-2"	16'-8"	13'-3"	19'-11"	18'-2"	17'-1"	15'-2"
14"	BCI® 90 2.0	22'-5"	20'-4"	19'-2"	17'-3"	22'-5"	20'-4"	19'-2"	17'-9"
	BCI® 5000 1.7	18'-7"	16'-1"	14'-8"	13'-2"	18'-7"	16'-1"	14'-8"	13'-2"
	BCI® 6000 1.8	20'-9"	18'-4"	16'-8"	14'-8"	20'-9"	18'-4"	16'-8"	14'-11"
	BCI® 6500 1.8	21'-3"	19'-3"	17'-7"	14'-8"	21'-3"	19'-3"	17'-7"	14'-11"
	BCI® 60 2.0	22'-7"	20'-7"	19'-5"	16'-1"	22'-7"	20'-7"	19'-5"	17'-1"
16"	BCI® 90 2.0	25'-5"	23'-1"	21'-8"	18'-0"	25'-5"	23'-1"	21'-8"	20'-2"
	BCI® 5000 1.7	19'-11"	17'-3"	15'-8"	14'-0"	19'-11"	17'-3"	15'-8"	14'-0"
	BCI® 6000 1.8	22'-7"	19'-7"	17'-10"	15'-8"	22'-7"	19'-7"	17'-10"	15'-8"
	BCI® 6500 1.8	23'-6"	20'-7"	18'-10"	15'-8"	23'-6"	20'-7"	18'-10"	15'-8"
	BCI® 60 2.0	25'-0"	22'-9"	21'-4"	17'-1"	25'-0"	22'-9"	21'-6"	17'-6"
18"	BCI® 90 2.0	28'-1"	25'-6"	23'-5"	18'-8"	28'-1"	25'-6"	24'-0"	21'-9"
	BCI® 90 2.0	30'-8"	27'-10"	24'-3"	19'-5"	30'-8"	27'-10"	26'-3"	22'-3"
20"	BCI® 90 2.0	33'-2"	30'-2"	25'-2"	20'-1"	33'-2"	30'-2"	28'-4"	22'-8"

Web Stiffeners Required at All Bearing Locations for Table Below

Spans without web stiffeners and/or shorter bearings are possible, analyze such conditions with BC Calc® sizing software.

NOTES FOR BOTH TABLES

- Loading based upon Table 1607.1 of 2009 International Building Code.
- Spans limited by allowable moment and reaction values, total load deflection of L/240. Live load deflection limited to L/600 with 50 psf and L/360 with listed uniform live load.
- Table values assume that ²³/₃₂" min. plywood/OSB rated sheathing is glued and nailed to joists.
- Table values represent the most restrictive of simple or multiple span applications.
- Table values are the maximum allowable clear distance between supports.
- Table values assume web stiffeners at each bearing location, minimum 2¼" end bearing.
- This table was designed to apply to a broad range of applications. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc® sizing software.
- School and essential service projects in California (DSA) require additional design provisions and thus the above span length limits may not apply. Contact Boise Cascade EWP Engineering for further information.

Retail: Upper Floors

[Worst Case 75 PSF or 1000 LB Concentrated Live Load] + 25 PSF Dead Load									
Joist Depth	Joist Series	3½" Interior Bearing				5¼" Interior Bearing			
		12" o.c.	16" o.c.	19.2" o.c.	24" o.c.	12" o.c.	16" o.c.	19.2" o.c.	24" o.c.
9½"	BCI® 5000 1.7	13'-11"	12'-0"	11'-0"	9'-3"	13'-11"	12'-0"	11'-0"	9'-10"
	BCI® 6000 1.8	15'-4"	13'-8"	12'-5"	10'-6"	15'-4"	13'-8"	12'-5"	10'-11"
	BCI® 6500 1.8	15'-9"	14'-4"	13'-1"	10'-6"	15'-9"	14'-4"	13'-1"	10'-11"
11⅞"	BCI® 5000 1.7	15'-9"	13'-7"	12'-5"	11'-1"	15'-9"	13'-7"	12'-5"	11'-1"
	BCI® 6000 1.8	17'-11"	15'-6"	14'-1"	11'-3"	17'-11"	15'-6"	14'-1"	11'-11"
	BCI® 6500 1.8	18'-9"	16'-4"	14'-2"	11'-3"	18'-9"	16'-4"	14'-10"	11'-11"
	BCI® 60 2.0	19'-11"	17'-0"	14'-2"	11'-3"	19'-11"	18'-2"	16'-2"	12'-11"
	BCI® 90 2.0	22'-5"	20'-4"	18'-5"	14'-8"	22'-5"	20'-4"	19'-2"	17'-1"
14"	BCI® 5000 1.7	17'-2"	14'-10"	13'-6"	12'-1"	17'-2"	14'-10"	13'-6"	12'-1"
	BCI® 6000 1.8	19'-6"	16'-10"	15'-5"	12'-6"	19'-6"	16'-10"	15'-5"	12'-8"
	BCI® 6500 1.8	20'-6"	17'-9"	15'-8"	12'-6"	20'-6"	17'-9"	15'-11"	12'-8"
	BCI® 60 2.0	22'-7"	20'-7"	17'-2"	13'-8"	22'-7"	20'-7"	18'-2"	14'-6"
	BCI® 90 2.0	25'-5"	23'-0"	19'-2"	15'-3"	25'-5"	23'-1"	21'-8"	17'-8"
16"	BCI® 5000 1.7	18'-4"	15'-10"	14'-6"	12'-8"	18'-4"	15'-10"	14'-6"	12'-11"
	BCI® 6000 1.8	20'-10"	18'-0"	16'-5"	13'-3"	20'-10"	18'-0"	16'-5"	13'-3"
	BCI® 6500 1.8	21'-11"	19'-0"	16'-8"	13'-3"	21'-11"	19'-0"	16'-8"	13'-3"
	BCI® 60 2.0	25'-0"	21'-9"	18'-2"	14'-6"	25'-0"	22'-5"	18'-8"	14'-11"
	BCI® 90 2.0	28'-1"	23'-11"	19'-11"	15'-11"	28'-1"	25'-6"	23'-2"	18'-6"
18"	BCI® 90 2.0	30'-8"	24'-9"	20'-8"	16'-6"	30'-8"	27'-10"	23'-8"	18'-11"
20"	BCI® 90 2.0	33'-2"	25'-8"	21'-5"	17'-1"	33'-2"	29'-0"	24'-2"	19'-3"

Medical, Schools, Libraries: Upper Floor Corridors

[Worst Case 80 PSF or 1000 LB Concentrated Live Load] + 25 PSF Dead Load

Joist Depth	Joist Series	3½" Interior Bearing				5¼" Interior Bearing			
		12" o.c.	16" o.c.	19.2" o.c.	24" o.c.	12" o.c.	16" o.c.	19.2" o.c.	24" o.c.
9½"	BCI® 5000 1.7	13'-7"	11'-9"	10'-8"	8'-10"	13'-7"	11'-9"	10'-8"	9'-7"
	BCI® 6000 1.8	15'-4"	13'-4"	12'-2"	10'-0"	15'-4"	13'-4"	12'-2"	10'-4"
	BCI® 6500 1.8	15'-9"	14'-0"	12'-6"	10'-0"	15'-9"	14'-0"	12'-10"	10'-4"
11⅞"	BCI® 5000 1.7	15'-4"	13'-3"	12'-1"	10'-9"	15'-4"	13'-3"	12'-1"	10'-10"
	BCI® 6000 1.8	17'-6"	15'-1"	13'-5"	10'-9"	17'-6"	15'-1"	13'-9"	11'-4"
	BCI® 6500 1.8	18'-5"	15'-11"	13'-5"	10'-9"	18'-5"	15'-11"	14'-2"	11'-4"
	BCI® 60 2.0	19'-11"	16'-2"	13'-5"	10'-9"	19'-11"	18'-2"	15'-4"	12'-3"
	BCI® 90 2.0	22'-5"	20'-4"	17'-6"	14'-0"	22'-5"	20'-4"	19'-2"	16'-3"
14"	BCI® 5000 1.7	16'-9"	14'-6"	13'-3"	11'-6"	16'-9"	14'-6"	13'-3"	11'-10"
	BCI® 6000 1.8	19'-0"	16'-6"	14'-11"	11'-11"	19'-0"	16'-6"	15'-0"	12'-1"
	BCI® 6500 1.8	20'-0"	17'-4"	14'-11"	11'-11"	20'-0"	17'-4"	15'-1"	12'-1"
	BCI® 60 2.0	22'-7"	19'-7"	16'-4"	13'-0"	22'-7"	20'-6"	17'-3"	13'-9"
	BCI® 90 2.0	25'-5"	21'-11"	18'-2"	14'-6"	25'-5"	23'-1"	21'-1"	16'-10"
16"	BCI® 5000 1.7	17'-11"	15'-6"	14'-1"	12'-1"	17'-11"	15'-6"	14'-1"	12'-7"
	BCI® 6000 1.8	20'-4"	17'-7"	15'-10"	12'-8"	20'-4"	17'-7"	15'-10"	12'-8"
	BCI® 6500 1.8	21'-5"	18'-6"	15'-10"	12'-8"	21'-5"	18'-6"	15'-10"	12'-8"
	BCI® 60 2.0	25'-0"	20'-9"	17'-3"	13'-9"	25'-0"	21'-4"	17'-9"	14'-2"
	BCI® 90 2.0	28'-1"	22'-9"	18'-11"	15'-1"	28'-1"	25'-6"	22'-0"	17'-7"
18"	BCI® 90 2.0	30'-8"	23'-7"	19'-8"	15'-8"	30'-8"	27'-0"	22'-6"	18'-0"
20"	BCI® 90 2.0	32'-8"	24'-5"	20'-4"	16'-3"	33'-2"	27'-7"	23'-0"	18'-4"

Retail - 1st Floor / Schools - 1st Floor Corridors

[Worst Case 100 PSF or 1000 LB Concentrated Live Load] + 25 PSF Dead Load

Joist Depth	Joist Series	3½" Interior Bearing				5¼" Interior Bearing			
		12" o.c.	16" o.c.	19.2" o.c.	24" o.c.	12" o.c.	16" o.c.	19.2" o.c.	24" o.c.
9½"	BCI® 5000 1.7	12'-5"	10'-9"	9'-3"	7'-5"	12'-5"	10'-9"	9'-10"	8'-8"
	BCI® 6000 1.8	14'-1"	12'-2"	10'-6"	8'-4"	14'-1"	12'-2"	10'-11"	8'-8"
	BCI® 6500 1.8	14'-9"	12'-7"	10'-6"	8'-4"	14'-9"	12'-10"	10'-11"	8'-8"
11⅞"	BCI® 5000 1.7	14'-1"	12'-2"	11'-1"	9'-0"	14'-1"	12'-2"	11'-1"	9'-6"
	BCI® 6000 1.8	16'-0"	13'-7"	11'-3"	9'-0"	16'-0"	13'-10"	11'-11"	9'-6"
	BCI® 6500 1.8	16'-10"	13'-7"	11'-3"	9'-0"	16'-10"	14'-3"	11'-11"	9'-6"
	BCI® 60 2.0	18'-1"	13'-7"	11'-3"	9'-0"	18'-8"	15'-6"	12'-11"	10'-3"
	BCI® 90 2.0	21'-0"	17'-8"	14'-8"	11'-9"	21'-0"	19'-1"	17'-1"	13'-8"
14"	BCI® 5000 1.7	15'-4"	13'-3"	12'-1"	9'-8"	15'-4"	13'-3"	12'-1"	10'-1"
	BCI® 6000 1.8	17'-5"	15'-0"	12'-6"	9'-11"	17'-5"	15'-1"	12'-8"	10'-1"
	BCI® 6500 1.8	18'-4"	15'-0"	12'-6"	9'-11"	18'-4"	15'-3"	12'-8"	10'-1"
	BCI® 60 2.0	21'-2"	16'-5"	13'-8"	10'-11"	21'-2"	17'-5"	14'-6"	11'-7"
	BCI® 90 2.0	23'-9"	18'-4"	15'-3"	12'-2"	23'-9"	21'-3"	17'-8"	14'-1"
16"	BCI® 5000 1.7	16'-5"	14'-2"	12'-8"	10'-1"	16'-5"	14'-2"	12'-11"	10'-7"
	BCI® 6000 1.8	18'-8"	15'-11"	13'-3"	10'-7"	18'-8"	15'-11"	13'-3"	10'-7"
	BCI® 6500 1.8	19'-7"	15'-11"	13'-3"	10'-7"	19'-7"	15'-11"	13'-3"	10'-7"
	BCI® 60 2.0	23'-3"	17'-5"	14'-6"	11'-7"	23'-3"	17'-11"	14'-11"	11'-11"
	BCI® 90 2.0	25'-6"	19'-1"	15'-11"	12'-8"	26'-4"	22'-2"	18'-6"	14'-9"
18"	BCI® 90 2.0	26'-5"	19'-10"	16'-6"	13'-2"	28'-9"	22'-8"	18'-11"	15'-1"
20"	BCI® 90 2.0	27'-5"	20'-6"	17'-1"	13'-8"	30'-11"	23'-2"	19'-3"	15'-5"

**Web Stiffeners
Required at All
Bearing Locations for
Table Below**

Spans without web stiffeners and/or shorter bearings are possible, analyze such conditions with BC Calc® sizing software.

NOTES FOR BOTH TABLES

- Loading based upon Table 1607.1 of 2009 International Building Code
- Spans limited by allowable moment and reaction values, total load deflection of L/240. Live load deflection limited to L/600 with 50 psf and L/360 with listed uniform live load.
- Table values assume that 23/32" min. plywood/OSB rated sheathing is glued and nailed to joists.
- Table values represent the most restrictive of simple or multiple span applications.
- Table values are the maximum allowable clear distance between supports.
- Table values assume web stiffeners at each bearing location, minimum 2¼" end bearing.
- This table was designed to apply to a broad range of applications. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc® sizing software.
- School and essential service projects in California (DSA) require additional design provisions and thus the above span length limits may not apply. Contact Boise Cascade EWP Engineering for further information.

Office: Upper Floor Corridors

Web Stiffeners Required at All Bearing Locations for Table Below

Spans without web stiffeners and/or shorter bearings are possible, analyze such conditions with BC Calc® sizing software.

[Worst Case 80 PSF or 2000 LB Concentrated Live Load] + 25 PSF Dead Load

Joist Depth	Joist Series	3½" Interior Bearing				5¼" Interior Bearing			
		12" o.c.	16" o.c.	19.2" o.c.	24" o.c.	12" o.c.	16" o.c.	19.2" o.c.	24" o.c.
9½"	BCI® 5000 1.7	11'-3"	8'-11"	6'-8"	3'-9"	11'-3"	8'-11"	6'-8"	3'-9"
	BCI® 6000 1.8	13'-9"	10'-11"	9'-5"	5'-7"	13'-9"	10'-11"	9'-5"	5'-7"
	BCI® 6500 1.8	14'-11"	11'-10"	10'-3"	5'-7"	14'-11"	11'-10"	10'-3"	5'-7"
11⅞"	BCI® 5000 1.7	13'-8"	10'-11"	9'-5"	6'-3"	13'-8"	10'-11"	9'-5"	6'-3"
	BCI® 6000 1.8	16'-9"	13'-4"	11'-6"	6'-3"	16'-9"	13'-4"	11'-6"	6'-3"
	BCI® 6500 1.8	18'-2"	14'-6"	12'-6"	6'-3"	18'-2"	14'-6"	12'-6"	6'-3"
	BCI® 60 2.0	19'-11"	16'-2"	13'-5"	6'-3"	19'-11"	18'-2"	13'-10"	6'-3"
	BCI® 90 2.0	22'-5"	20'-4"	17'-6"	14'-0"	22'-5"	20'-4"	19'-2"	16'-3"
14"	BCI® 5000 1.7	15'-8"	12'-6"	10'-9"	8'-10"	15'-8"	12'-6"	10'-9"	8'-10"
	BCI® 6000 1.8	19'-0"	15'-3"	13'-3"	8'-10"	19'-0"	15'-3"	13'-3"	8'-10"
	BCI® 6500 1.8	20'-0"	16'-7"	14'-4"	8'-10"	20'-0"	16'-7"	14'-4"	8'-10"
	BCI® 60 2.0	22'-7"	19'-7"	16'-4"	8'-10"	22'-7"	20'-6"	17'-3"	8'-10"
	BCI® 90 2.0	25'-5"	21'-11"	18'-2"	14'-6"	25'-5"	23'-1"	21'-1"	16'-10"
16"	BCI® 5000 1.7	17'-5"	13'-10"	12'-0"	10'-0"	17'-5"	13'-10"	12'-0"	10'-0"
	BCI® 6000 1.8	20'-4"	17'-0"	14'-8"	12'-3"	20'-4"	17'-0"	14'-8"	12'-3"
	BCI® 6500 1.8	21'-5"	18'-5"	15'-10"	12'-6"	21'-5"	18'-5"	15'-10"	12'-6"
	BCI® 60 2.0	25'-0"	20'-9"	17'-3"	12'-6"	25'-0"	21'-4"	17'-9"	12'-6"
	BCI® 90 2.0	28'-1"	22'-9"	18'-11"	15'-1"	28'-1"	25'-6"	22'-0"	17'-7"
18"	BCI® 90 2.0	30'-8"	23'-7"	19'-8"	15'-8"	30'-8"	27'-0"	22'-6"	18'-0"
20"	BCI® 90 2.0	32'-8"	24'-5"	20'-4"	16'-3"	33'-2"	27'-7"	23'-0"	18'-4"

NOTES

- Loading based upon Table 1607.1 of 2009 International Building Code.
- Spans limited by allowable moment and reaction values, total load deflection of L/240. Live load deflection limited to L/600 with 50 psf and L/360 with 80 psf.
- Table values assume that ²³/₃₂" min. plywood/OSB rated sheathing is glued and nailed to joists.
- Table values represent the most restrictive of simple or multiple span applications.
- Table values are the maximum allowable clear distance between supports.
- Table values assume web stiffeners at each bearing location, minimum 2¼" end bearing.
- This table was designed to apply to a broad range of applications. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc® sizing software.
- School and essential service projects in California (DSA) require additional design provisions and thus the above span length limits may not apply. Contact Boise Cascade EWP Engineering for further information.

100 PSF Live Load Span Tables

Hotels: Public Rooms & Corridors
Retail - All Corridors; Medical - 1st Floor Corridors
Restaurants & Dining Rooms

Assembly Areas & Theatres: Lobbies, Movable Seat Areas

Web Stiffeners Required at All Bearing Locations for Table Below

Spans without web stiffeners and/or shorter bearings are possible, analyze such conditions with BC Calc[®] sizing software.

100 PSF Live Load + 25 PSF Dead Load

Joist Depth	Joist Series	3½" Interior Bearing				5¼" Interior Bearing			
		12" o.c.	16" o.c.	19.2" o.c.	24" o.c.	12" o.c.	16" o.c.	19.2" o.c.	24" o.c.
9½"	BCI [®] 5000 1.7	12'-5"	10'-9"	9'-3"	7'-5"	12'-5"	10'-9"	9'-10"	8'-8"
	BCI [®] 6000 1.8	14'-1"	12'-2"	10'-6"	8'-4"	14'-1"	12'-2"	10'-11"	8'-8"
	BCI [®] 6500 1.8	14'-9"	12'-7"	10'-6"	8'-4"	14'-9"	12'-10"	10'-11"	8'-8"
11⅞"	BCI [®] 5000 1.7	14'-1"	12'-2"	11'-1"	9'-0"	14'-1"	12'-2"	11'-1"	9'-6"
	BCI [®] 6000 1.8	16'-0"	13'-7"	11'-3"	9'-0"	16'-0"	13'-10"	11'-11"	9'-6"
	BCI [®] 6500 1.8	16'-10"	13'-7"	11'-3"	9'-0"	16'-10"	14'-3"	11'-11"	9'-6"
	BCI [®] 60 2.0	18'-1"	13'-7"	11'-3"	9'-0"	18'-8"	15'-6"	12'-11"	10'-3"
	BCI [®] 90 2.0	21'-0"	17'-8"	14'-8"	11'-9"	21'-0"	19'-1"	17'-1"	13'-8"
14"	BCI [®] 5000 1.7	15'-4"	13'-3"	12'-1"	9'-8"	15'-4"	13'-3"	12'-1"	10'-1"
	BCI [®] 6000 1.8	17'-5"	15'-0"	12'-6"	9'-11"	17'-5"	15'-1"	12'-8"	10'-1"
	BCI [®] 6500 1.8	18'-4"	15'-0"	12'-6"	9'-11"	18'-4"	15'-3"	12'-8"	10'-1"
	BCI [®] 60 2.0	21'-2"	16'-5"	13'-8"	10'-11"	21'-2"	17'-5"	14'-6"	11'-7"
	BCI [®] 90 2.0	23'-9"	18'-4"	15'-3"	12'-2"	23'-9"	21'-3"	17'-8"	14'-1"
16"	BCI [®] 6000 1.8	16'-5"	14'-2"	12'-8"	10'-1"	16'-5"	14'-2"	12'-11"	10'-7"
	BCI [®] 6000 1.8	18'-8"	15'-11"	13'-3"	10'-7"	18'-8"	15'-11"	13'-3"	10'-7"
	BCI [®] 6500 1.8	19'-7"	15'-11"	13'-3"	10'-7"	19'-7"	15'-11"	13'-3"	10'-7"
	BCI [®] 60 2.0	23'-3"	17'-5"	14'-6"	11'-7"	23'-3"	17'-11"	14'-11"	11'-11"
	BCI [®] 90 2.0	25'-6"	19'-1"	15'-11"	12'-8"	26'-4"	22'-2"	18'-6"	14'-9"
18"	BCI [®] 90 2.0	26'-5"	19'-10"	16'-6"	13'-2"	28'-9"	22'-8"	18'-11"	15'-1"
20"	BCI [®] 90 2.0	27'-5"	20'-6"	17'-1"	13'-8"	30'-11"	23'-2"	19'-3"	15'-5"

NOTES

- Loading based upon Table 1607.1 of 2009 International Building Code.
- Spans limited by allowable moment and reaction values, total load deflection of L/240. Live load deflection limited to L/600 with 50 psf and L/360 with 100 psf.
- Table values assume that 23/32" min. plywood/OSB rated sheathing is glued and nailed to joists.
- Table values represent the most restrictive of simple or multiple span applications.
- Table values are the maximum allowable clear distance between supports.
- Table values assume web stiffeners at each bearing location, minimum 2¼" end bearing.
- This table was designed to apply to a broad range of applications. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc[®] sizing software.
- School and essential service projects in California (DSA) require additional design provisions and thus the above span length limits may not apply. Contact Boise Cascade EWP Engineering for further information.

Office: Lobbies & 1st Floor Corridors

Web Stiffeners Required at All Bearing Locations for Table Below

Spans without web stiffeners and/or shorter bearings are possible, analyze such conditions with BC Calc® sizing software.

[Worst Case 100 PSF or 2000 LB Concentrated Live Load] + 25 PSF Dead Load									
Joist Depth	Joist Series	3½" Interior Bearing				5¼" Interior Bearing			
		12" o.c.	16" o.c.	19.2" o.c.	24" o.c.	12" o.c.	16" o.c.	19.2" o.c.	24" o.c.
9½"	BCI® 5000 1.7	11'-3"	8'-11"	6'-8"	3'-9"	11'-3"	8'-11"	6'-8"	3'-9"
	BCI® 6000 1.8	13'-9"	10'-11"	9'-5"	5'-7"	13'-9"	10'-11"	9'-5"	5'-7"
	BCI® 6500 1.8	14'-9"	11'-10"	10'-3"	5'-7"	14'-9"	11'-10"	10'-3"	5'-7"
11⅞"	BCI® 5000 1.7	13'-8"	10'-11"	9'-5"	6'-3"	13'-8"	10'-11"	9'-5"	6'-3"
	BCI® 6000 1.8	16'-0"	13'-4"	11'-3"	6'-3"	16'-0"	13'-4"	11'-6"	6'-3"
	BCI® 6500 1.8	16'-10"	13'-7"	11'-3"	6'-3"	16'-10"	14'-3"	11'-11"	6'-3"
	BCI® 60 2.0	18'-1"	13'-7"	11'-3"	6'-3"	18'-8"	15'-6"	12'-11"	6'-3"
	BCI® 90 2.0	21'-0"	17'-8"	14'-8"	11'-9"	21'-0"	19'-1"	17'-1"	13'-8"
14"	BCI® 5000 1.7	15'-4"	12'-6"	10'-9"	8'-10"	15'-4"	12'-6"	10'-9"	8'-10"
	BCI® 6000 1.8	17'-5"	15'-0"	12'-6"	8'-10"	17'-5"	15'-1"	12'-8"	8'-10"
	BCI® 6500 1.8	18'-4"	15'-0"	12'-6"	8'-10"	18'-4"	15'-3"	12'-8"	8'-10"
	BCI® 60 2.0	21'-2"	16'-5"	13'-8"	8'-10"	21'-2"	17'-5"	14'-6"	8'-10"
	BCI® 90 2.0	23'-9"	18'-4"	15'-3"	12'-2"	23'-9"	21'-3"	17'-8"	14'-1"
16"	BCI® 5000 1.7	16'-5"	13'-10"	12'-0"	10'-0"	16'-5"	13'-10"	12'-0"	10'-0"
	BCI® 6000 1.8	18'-8"	15'-11"	13'-3"	10'-7"	18'-8"	15'-11"	13'-3"	10'-7"
	BCI® 6500 1.8	19'-7"	15'-11"	13'-3"	10'-7"	19'-7"	15'-11"	13'-3"	10'-7"
	BCI® 60 2.0	23'-3"	17'-5"	14'-6"	11'-7"	23'-3"	17'-11"	14'-11"	11'-11"
	BCI® 90 2.0	25'-6"	19'-1"	15'-11"	12'-8"	26'-4"	22'-2"	18'-6"	14'-9"
18"	BCI® 90 2.0	26'-5"	19'-10"	16'-6"	13'-2"	28'-9"	22'-8"	18'-11"	15'-1"
20"	BCI® 90 2.0	27'-5"	20'-6"	17'-1"	13'-8"	30'-11"	23'-2"	19'-3"	15'-5"

NOTES

- Loading based upon Table 1607.1 of 2009 International Building Code.
- Spans limited by allowable moment and reaction values, total load deflection of L/240. Live load deflection limited to L/600 with 50 psf and L/360 with 100 psf.
- Table values assume that 23/32" min. plywood/OSB rated sheathing is glued and nailed to joists.
- Table values represent the most restrictive of simple or multiple span applications.
- Table values are the maximum allowable clear distance between supports.
- Table values assume web stiffeners at each bearing location, minimum 2¼" end bearing.
- This table was designed to apply to a broad range of applications. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc® sizing software.
- School and essential service projects in California (DSA) require additional design provisions and thus the above span length limits may not apply. Contact Boise Cascade EWP Engineering for further information.

125 PSF Live Load (Light Storage) Span Tables

Web Stiffeners Required at All Bearing Locations for Table Below

Spans without web stiffeners and/or shorter bearings are possible, analyze such conditions with BC Calc® sizing software.

125 PSF Live Load + 25 PSF Dead Load

Joist Depth	Joist Series	3½" Interior Bearing				5¼" Interior Bearing			
		12" o.c.	16" o.c.	19.2" o.c.	24" o.c.	12" o.c.	16" o.c.	19.2" o.c.	24" o.c.
9½"	BCI® 5000 1.7	11'-4"	9'-3"	7'-9"	6'-2"	11'-4"	9'-10"	8'-11"	7'-3"
	BCI® 6000 1.8	12'-10"	10'-6"	8'-9"	6'-11"	12'-10"	10'-11"	9'-0"	7'-3"
	BCI® 6500 1.8	13'-7"	10'-6"	8'-9"	6'-11"	13'-7"	10'-11"	9'-0"	7'-3"
11⅞"	BCI® 5000 1.7	12'-10"	11'-1"	9'-5"	7'-6"	12'-10"	11'-1"	9'-11"	7'-11"
	BCI® 6000 1.8	14'-7"	11'-3"	9'-5"	7'-6"	14'-7"	11'-11"	9'-11"	7'-11"
	BCI® 6500 1.8	15'-1"	11'-3"	9'-5"	7'-6"	15'-4"	11'-11"	9'-11"	7'-11"
	BCI® 60 2.0	15'-1"	11'-3"	9'-5"	7'-6"	17'-2"	12'-11"	10'-9"	8'-6"
	BCI® 90 2.0	19'-4"	14'-8"	12'-3"	9'-9"	19'-4"	17'-1"	14'-3"	11'-4"
14"	BCI® 5000 1.7	14'-0"	12'-1"	10'-0"	8'-0"	14'-0"	12'-1"	10'-6"	8'-5"
	BCI® 6000 1.8	15'-11"	12'-6"	10'-5"	8'-3"	15'-11"	12'-8"	10'-6"	8'-5"
	BCI® 6500 1.8	16'-8"	12'-6"	10'-5"	8'-3"	16'-9"	12'-8"	10'-6"	8'-5"
	BCI® 60 2.0	18'-3"	13'-8"	11'-5"	9'-1"	19'-4"	14'-6"	12'-0"	9'-7"
	BCI® 90 2.0	20'-5"	15'-3"	12'-9"	10'-2"	21'-11"	17'-8"	14'-9"	11'-9"
16"	BCI® 5000 1.7	14'-11"	12'-8"	10'-6"	8'-5"	14'-11"	12'-11"	11'-0"	8'-10"
	BCI® 6000 1.8	17'-0"	13'-3"	11'-0"	8'-10"	17'-0"	13'-3"	11'-0"	8'-10"
	BCI® 6500 1.8	17'-9"	13'-3"	11'-0"	8'-10"	17'-9"	13'-3"	11'-0"	8'-10"
	BCI® 60 2.0	19'-4"	14'-6"	12'-0"	9'-7"	19'-11"	14'-11"	12'-5"	9'-11"
	BCI® 90 2.0	21'-2"	15'-11"	13'-3"	10'-6"	24'-3"	18'-6"	15'-5"	12'-3"
18"	BCI® 90 2.0	22'-0"	16'-6"	13'-9"	10'-11"	25'-2"	18'-11"	15'-9"	12'-6"
20"	BCI® 90 2.0	22'-10"	17'-1"	14'-3"	11'-4"	25'-9"	19'-3"	16'-1"	12'-10"

NOTES

- Loading based upon Table 1607.1 of 2009 International Building Code.
- Spans limited by allowable moment and reaction values, total load deflection of L/240. Live load deflection limited to L/600 with 50 psf and L/360 with 125 psf.
- Table values assume that 23/32" min. plywood/OSB rated sheathing is glued and nailed to joists.
- Table values represent the most restrictive of simple or multiple span applications.
- Table values are the maximum allowable clear distance between supports.
- Table values assume web stiffeners at each bearing location, minimum 2¼" end bearing.
- This table was designed to apply to a broad range of applications. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc® sizing software.
- School and essential service projects in California (DSA) require additional design provisions and thus the above span length limits may not apply. Contact Boise Cascade EWP Engineering for further information.

Web Stiffeners Required at All Bearing Locations for Table Below

Spans without web stiffeners and/or shorter bearings are possible, analyze such conditions with BC Calc® sizing software.

250 PSF Live Load + 25 PSF Dead Load

Joist Depth	Joist Series	3½" Interior Bearing			5¼" Interior Bearing		
		12" o.c.	16" o.c.	19.2" o.c.	12" o.c.	16" o.c.	19.2" o.c.
9½"	BCI® 5000 1.7	6'-9"	5'-0"	4'-2"	7'-11"	5'-11"	4'-11"
	BCI® 6000 1.8	7'-7"	5'-8"	4'-8"	7'-11"	5'-11"	4'-11"
	BCI® 6500 1.8	7'-7"	5'-8"	4'-8"	7'-11"	5'-11"	4'-11"
11⅞"	BCI® 5000 1.7	8'-2"	6'-1"	5'-1"	8'-7"	6'-5"	5'-4"
	BCI® 6000 1.8	8'-2"	6'-1"	5'-1"	8'-7"	6'-5"	5'-4"
	BCI® 6500 1.8	8'-2"	6'-1"	5'-1"	8'-7"	6'-5"	5'-4"
	BCI® 60 2.0	8'-2"	6'-1"	5'-1"	9'-4"	7'-0"	5'-9"
	BCI® 90 2.0	10'-8"	7'-11"	6'-7"	12'-5"	9'-3"	7'-8"
14"	BCI® 5000 1.7	8'-9"	6'-6"	5'-5"	9'-2"	6'-10"	5'-8"
	BCI® 6000 1.8	9'-0"	6'-9"	5'-7"	9'-2"	6'-10"	5'-8"
	BCI® 6500 1.8	9'-0"	6'-9"	5'-7"	9'-2"	6'-10"	5'-8"
	BCI® 60 2.0	9'-11"	7'-5"	6'-2"	10'-6"	7'-10"	6'-6"
	BCI® 90 2.0	11'-1"	8'-3"	6'-11"	12'-10"	9'-7"	8'-0"
16"	BCI® 5000 1.7	9'-2"	6'-10"	5'-8"	9'-7"	7'-2"	6'-0"
	BCI® 6000 1.8	9'-7"	7'-2"	6'-0"	9'-7"	7'-2"	6'-0"
	BCI® 6500 1.8	9'-7"	7'-2"	6'-0"	9'-7"	7'-2"	6'-0"
	BCI® 60 2.0	10'-6"	7'-10"	6'-6"	10'-9"	8'-1"	6'-8"
	BCI® 90 2.0	11'-6"	8'-7"	7'-2"	13'-5"	10'-0"	8'-4"
18"	BCI® 90 2.0	11'-11"	8'-11"	7'-5"	13'-8"	10'-3"	8'-6"
20"	BCI® 90 2.0	12'-5"	9'-3"	7'-8"	14'-0"	10'-5"	8'-8"

NOTES

- Loading based upon Table 1607.1 of 2009 International Building Code.
- Spans limited by allowable moment and reaction values, total load deflection of L/240. Live load deflection limited to L/600 with 50 psf and L/360 with 250 psf.
- Table values assume that 23/32" min. plywood/OSB rated sheathing is glued and nailed to joists.
- Table values represent the most restrictive of simple or multiple span applications.
- Table values are the maximum allowable clear distance between supports.
- Table values assume web stiffeners at each bearing location, minimum 2¼" end bearing.
- This table was designed to apply to a broad range of applications. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc® sizing software.
- School and essential service projects in California (DSA) require additional design provisions and thus the above span length limits may not apply. Contact Boise Cascade EWP Engineering for further information.

BCI® Joists

NOTE

The illustration below is showing several suggested applications for the Boise Cascade EWP products. It is not intended to show an actual house under construction.

NO MIDSPAN BRIDGING IS REQUIRED FOR BCI® JOISTS

FOR INSTALLATION STABILITY,
Temporary strut lines (1x4 min.) 8' on center max.
Fasten at each joist with 2-8d nails minimum.

Dimension lumber is not suitable for use as a rim board in BCI® floor systems.

F01 F02
BCI® rim joist.
See page 15.

F07
BC Rimboard.
See pages 15 and 34.

F06 F09
See also Intermediate Bearing details,
page 15

When installing Boise Cascade EWP products with treated wood, use only connectors/fasteners that are approved for use with the corresponding wood treatment.

Versa-Lam® LVL header or an BCI® header.

1½" knockout holes at approximately 12" o.c. are pre-punched.

See page 17 for allowable hole sizes and location. **F27A**

Versa-Lam® LVL beam.

Endwall blocking as required per governing building code.

BCI® Blocking is required when joists are cantilevered.

For load bearing cantilever details, see page 19.

BCI® Joists, Versa-Lam® LVL, and ALLJOIST® must be stored, installed and used in accordance with the Boise Cascade EWP Installation Guide, building codes, and to the extent not inconsistent with the Boise Cascade EWP Installation Guide, usual and customary building practices and standards. Versa-Lam® LVL, ALLJOIST® and BCI® Joists must be wrapped, covered, and stored off of the ground on stickers at all times prior to installation. Versa-Lam® LVL, ALLJOIST® and BCI® Joists are intended

only for applications that assure no exposure to weather or the elements and an environment that is free from moisture from any source, or any pest, organism or substance which degrades or damages wood or glue bonds. Failure to correctly store, use or install Versa-Lam® LVL, ALLJOIST® and BCI® Joist in accordance with the Boise Cascade EWP Installation Guide will void the limited warranty.

SAFETY WARNING

DO NOT ALLOW WORKERS ON BCI® JOISTS UNTIL ALL HANGERS, BCI® RIM JOISTS, RIM BOARDS, BCI® BLOCKING PANELS, X-BRACING AND TEMPORARY 1x4 STRUT LINES ARE INSTALLED AS SPECIFIED BELOW. SERIOUS ACCIDENTS CAN RESULT FROM INSUFFICIENT ATTENTION TO PROPER BRACING DURING CONSTRUCTION. ACCIDENTS CAN BE AVOIDED UNDER NORMAL CONDITIONS BY FOLLOWING THESE GUIDELINES:

- Build a braced end wall at the end of the bay, or permanently install the first eight feet of BCI® Joists and the first course of sheathing. As an alternate, temporary sheathing may be nailed to the first four feet of BCI® Joists at the end of the bay.
- All hangers, BCI® rim joists, rim boards, BCI® blocking panels, and x-bracing must be completely installed and properly nailed as each BCI® Joist is set.
- Install temporary 1x4 strut lines at no more than eight feet on center as additional BCI® Joists are set. Nail the strut lines to the sheathed area, or braced end wall, and to each BCI® Joist with two 8d nails.
- The ends of cantilevers must be temporarily secured by strut lines on both the top and bottom flanges.
- Straighten the BCI® Joists to within ½ inch of true alignment before attaching strut lines and sheathing.
- Remove the temporary strut lines only as required to install the permanent sheathing.
- Failure to install temporary bracing may result in sideways buckling or roll-over under light construction loads.
- Do not stack construction materials (sheathing, drywall, etc) in the middle of BCI® Joist spans, contact Boise Cascade EWP Engineering for proper storage and shoring information.










PRODUCT HANDLING TO AND AT JOB SITES

There are some differences between engineered wood products and traditional lumber products in terms of product handling: Avoid handling and storing BCI® joists in the flat direction. Versa-Lam® LVL is denser and due to the coating applied to the surface, can be more apt to sliding. Please consider these differences when transporting and handling engineered wood products.



Additional floor framing details available with BC Framers® software

END BEARING DETAILS

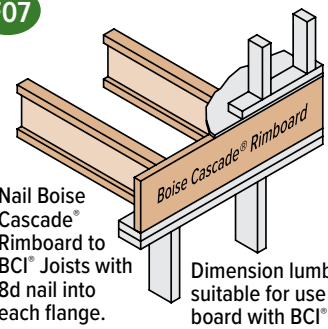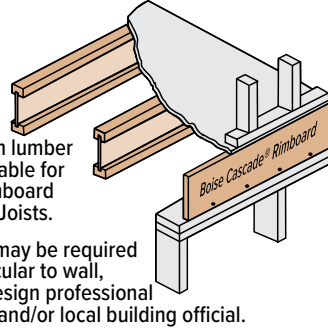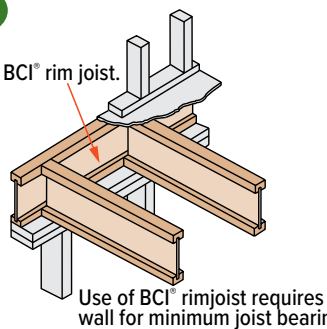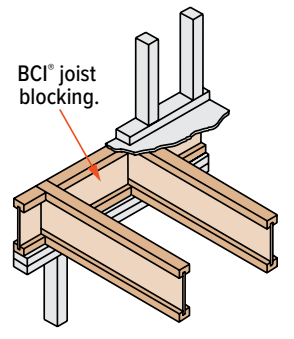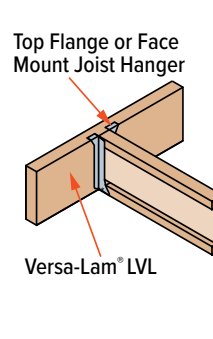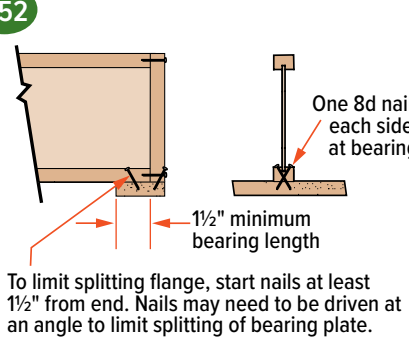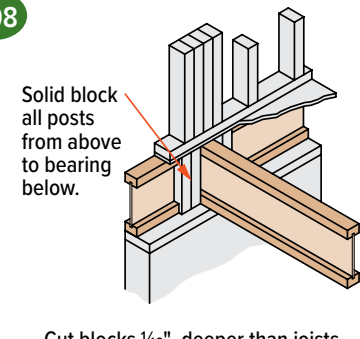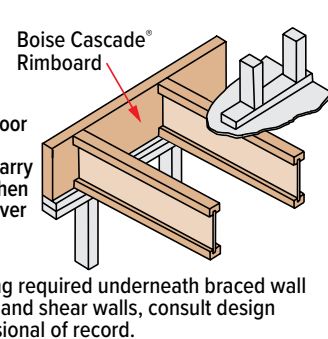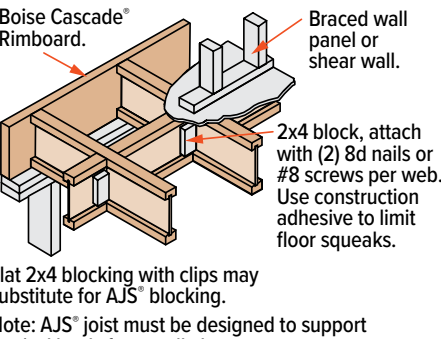F07  Nail Boise Cascade® Rimboard to BCI® Joists with 8d nail into each flange. Dimension lumber is not suitable for use as rim board with BCI® Joists.	F07A  Dimension lumber is not suitable for use as rimboard with BCI® Joists. Blocking may be required perpendicular to wall, consult design professional of record and/or local building official.	F02  BCI® rim joist. Use of BCI® rimjoist requires 2x6 wall for minimum joist bearing.
F01  BCI® joist blocking.	F27A  Top Flange or Face Mount Joist Hanger Versa-Lam® LVL	F52  One 8d nail each side at bearing 1/2" minimum bearing length To limit splitting flange, start nails at least 1 1/2" from end. Nails may need to be driven at an angle to limit splitting of bearing plate.
F08  Solid block all posts from above to bearing below. Cut blocks 1/16" deeper than joists.	F03  Boise Cascade® Rimboard NOTE: BCI® floor joist must be designed to carry wall above when not stacked over wall below. Blocking required underneath braced wall panels and shear walls, consult design professional of record.	F52  Boise Cascade® Rimboard. Braced wall panel or shear wall. 2x4 block, attach with (2) 8d nails or #8 screws per web. Use construction adhesive to limit floor squeaks. Flat 2x4 blocking with clips may substitute for AJS® blocking. Note: AJS® joist must be designed to support vertical loads from wall above.

LATERAL SUPPORT

- BCI® Joists shall be laterally supported at the ends with hangers, rimboard, BCI® rim joist or blocking panels. BCI® blocking panels or rimboard are required at cantilever supports.
- Blocking may be required at intermediate bearings for floor diaphragm per IRC in high seismic areas, consult local building official.

MINIMUM BEARING LENGTH FOR BCI® JOISTS

- Minimum end bearing: 1 1/2" for BCI® 5000, 6000 & 6500; 1 3/4" for BCI® 60 & 90. 3 1/2" is required at cantilever and intermediate supports.
- Longer bearing lengths allow higher reaction values. Refer to the building code evaluation report or the BC Calc® software.

NAILING REQUIREMENTS


- BCI® rim joist, rim board or closure panel to BCI® joist:
 - Rims or closure panel 1 3/4 inches thick and less: 2-8d nails, one each in the top and bottom flange.
 - BCI® 5000 rim joist: 2-10d box nails, one each in the top and bottom flange.
 - BCI® 6000, 60 rim joist: 2-16d box nails, one each in the top and bottom flange.
 - BCI® 6500, 90 rim joist: Toe-nail top flange to rim joist with 2-10d box nails, one each side of flange.

- BCI® rim joist, rim board or BCI® blocking panel to support:
 - Min. 8d nails @ 6" o.c. per IRC.
 - Connection per design professional of record's specification for shear transfer.
- BCI® joist to support:
 - 2-8d nails, one on each side of the web, placed 1 1/2 inches minimum from the end of the BCI® Joist to limit splitting.
- Sheathing to BCI® joist:
 - Prescriptive residential floor sheathing nailing requires 8d common nails @ 6" o.c. on edges and @ 12" o.c. in the field (IRC Table R602.3(1)).
 - See closest allowable nail spacing limits on page 24 for floor diaphragm nailing specified at closer spacing than IRC.
 - Maximum nail spacing for minimum lateral stability: 18" for BCI® 5000, 24" for larger BCI® joist series.
 - 14 gauge staples may be substituted for 8d nails if the staples penetrate at least 1 inch into the joist.
 - Wood screws may be acceptable, contact local building official and/or Boise Cascade EWP Engineering for further information.

INTERMEDIATE BEARING DETAILS


F06

For load bearing wall above (stacked over wall below).

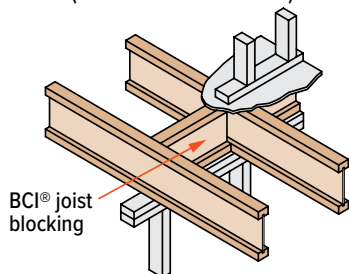


F09

Blocking may be required at intermediate bearings for floor diaphragm per IRC in high seismic areas, consult local building official.

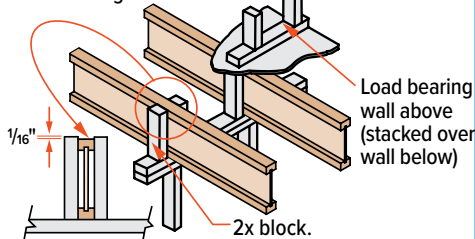


F28

Floor Joist Blocking per IRC® 502.7 Required in seismic design categories D₀ and higher for floor diaphragm (required for all joist types).



Cross bracing OK as blocking only if support below is not a braced wall panel or shear wall and no wall exists above.


F10

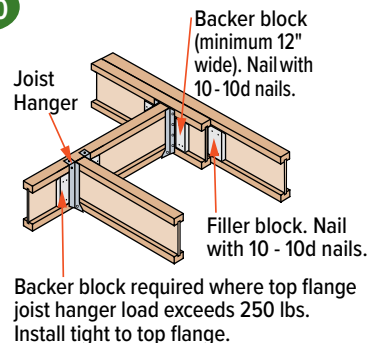

F58

Double BCI® Joist Connection

Filler Block (if required)
See TN IJ-13 for requirements.

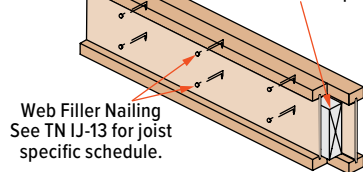


- Web Filler Nailing See TN IJ-13 for joist specific schedule.
- Filler block not required when all loads are top loaded and evenly applied to each ply (except BCI® 90 and AJS® 25, 30). Side loads and/or uneven top loads require filler block.
- See Boise Cascade Technical Note IJ-13 for further information.
- Fasten floor sheathing to each ply per diaphragm nailing schedule.

F14

BCI® Joist Slope Cut Reinforcement

Detail below restores original allowable shear/reaction value to cut end of BCI® joist. BCI® joists shall not be used as a collar or rafter tension tie.

2 x 6 min. rafter. Rafter shall be supported by ridge beam or other upper bearing support

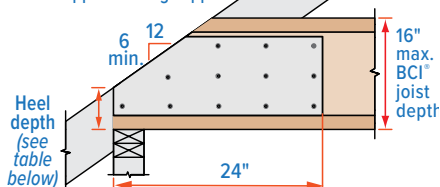


2x blocking required at bearing (not shown for clarity).
2³/₃₂ min. plywood/OSB rated sheathing as reinforcement. Install reinforcement with face grain horizontal. Install on both sides of the joist, tight to bottom flange. Leave minimum 1/4" gap between reinforcement and bottom of top flange. Apply construction adhesive to contact surfaces and fasten with 3 rows of min. 10d box nails at 6" o.c. Alternate nailing from each side and clinch.

End Wall Bearing	Minimum Heel Depth					
	Roof Pitch					
	6/12	7/12	8/12	9/12	10/12	12/12
2 x 4	4 ³ / ₈ "	4 ⁵ / ₁₆ "	4 ¹ / ₄ "	4 ¹ / ₄ "	4 ¹ / ₄ "	4 ¹ / ₄ "
2 x 6	3 ³ / ₈ "	3 ³ / ₁₆ "	2 ⁵ / ₁₆ "	2 ³ / ₄ "	2 ⁹ / ₁₆ "	2 ¹ / ₄ "


F05

Structural Panel reinforcement (when required).

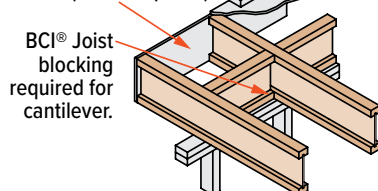

For load bearing cantilever, see page 19. Uplift on backspan shall be considered in all cantilever designs.

Connector strap nailing schedule shall adhere to BCI® closest nailing spacing provisions



See connector manufacturer's code evaluation reports and literature for allowable loading. Axial force in top flange shall be considered in BCI® joist design.

BACKER AND FILLER BLOCK DIMENSIONS

Series	Backer Block Thickness	Filler Block Thickness
5000 1.7	3/4" or 7/8" wood panels	Two 3/4" wood panels or 2x_
6000 1.8	1 1/8" or two 1/2" wood panels	2x_ + 7/16" or 1/2" wood panel
6500 1.8	1 1/8" or two 5/8" wood panels	2x_ + 5/8" or 3/4" wood panel
60 2.0	1 1/8" or two 1/2" wood panels	2x_ + 7/16" or 1/2" wood panel
90 2.0	2x_ lumber	Double 2x_ lumber

- Cut backer and filler blocks to a maximum depth equal to the web depth minus 1/4" to avoid a forced fit.

WEB STIFFENER REQUIREMENTS

- See Web Stiffener Requirements on page 18.

PROTECT BCI® JOISTS FROM THE WEATHER

- BCI® Joists are intended only for applications that provide permanent protection from the weather. Bundles of BCI® Joists should be covered and stored off of the ground on stickers.

BCI® RIM JOISTS AND BCI® BLOCKING

Depth [in]	Series	Vertical Load Capacity	
		No W.S. ⁽¹⁾	W.S. ⁽²⁾
9 1/2"	5000 1.7, 6000 1.8, 6500 1.8	2300	N/A
11 7/8"	5000 1.7, 6000 1.8, 6500 1.8	2150	N/A
	60 2.0, 90 2.0	2500	N/A
14"	5000 1.7, 6000 1.8, 6500 1.8	2000	N/A
	60 2.0, 90 2.0	2400	N/A
16"	6000 1.8, 6500 1.8	1900	2500
	60 2.0, 90 2.0	2300	2700
18"	60 2.0, 90 2.0	N/A	2700
20"	90 2.0	N/A	2700


(1) No web stiffeners required

(2) Web stiffeners required at each end of blocking, values not applicable for rim joists

N/A: Not applicable


Floor Bracing for Endwall

Block spacing per governing code and diaphragm nailing per engineer of record. Intent of blocking is to resist external lateral forces acting perpendicular to wall.

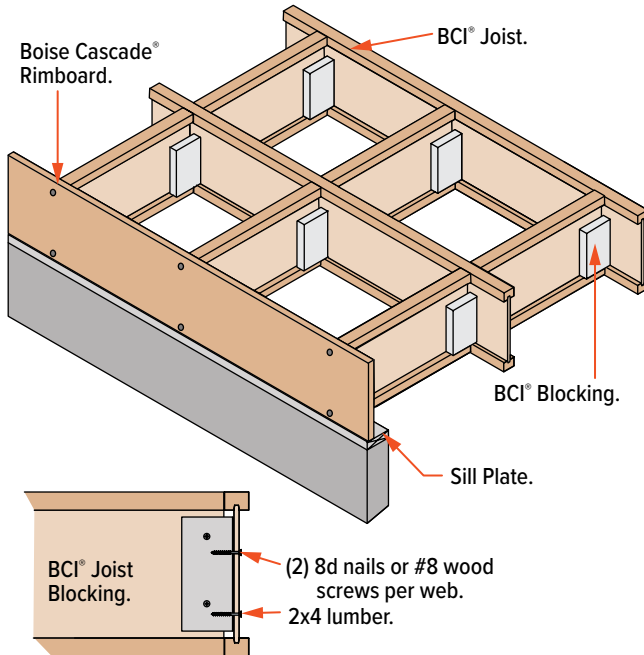


Apply construction adhesive to contact surfaces to limit floor squeaks.

BCI® Joist Fire Cut

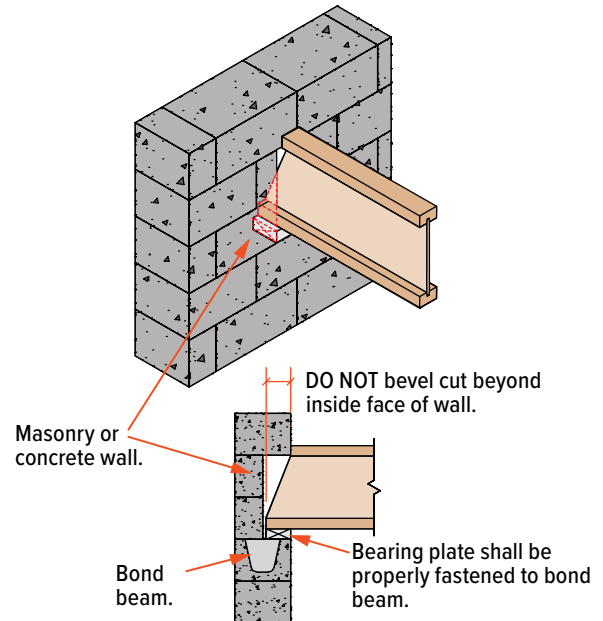

- 1) Joists shall be restrained from rotation at end bearing by installing blocking panels or cross-bridging between joists (not shown for clarity).
- 2) Joists shall not be in direct contact with masonry or concrete. A minimum of 1/2" of air space or an adequate moisture barrier shall be provided between joists and wall pocket.
- 3) Joists are to be installed in dry-use conditions only.


Blocked Diaphragm Nailing Detail

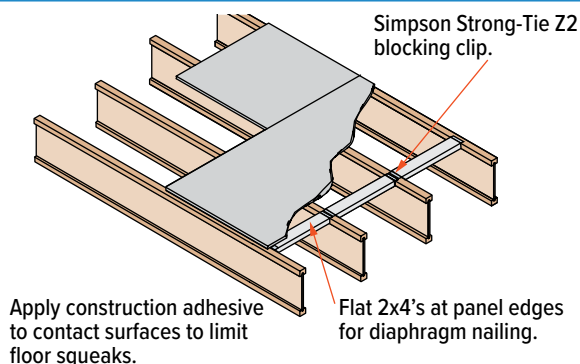

Apply construction adhesive to contact surfaces to limit floor squeaks.

Hanger Connections to BCI® Headers

- Backer blocks shall be at least 12" long per hanger.
- Nails shall be clinched when possible.
- Verify capacity and fastening requirements of hangers and connectors.

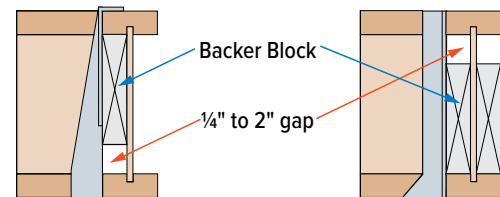


"Top Mount"
Backer block shall be tight to bottom of top flange with 1/4" to 2" gap at bottom flange.

"Face Mount"
Backer block shall be tight to bottom of top flange with 1/4" to 2" gap at top of bottom flange.


Connection on Steel Beam

F15D

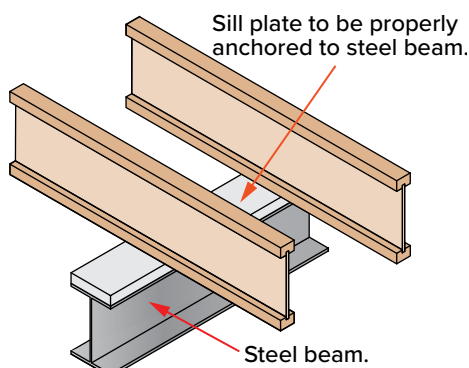



Connection on Hanger with Steel Beam

F15E

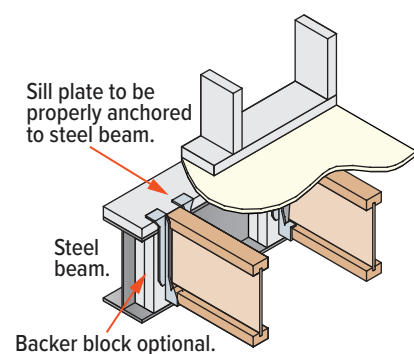

BCI® Joist Hole Location & Sizing


BCI® Joists are manufactured with 1½" round perforated knockouts in the web at approximately 12" on center

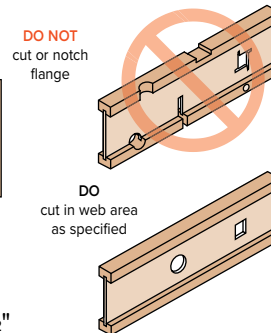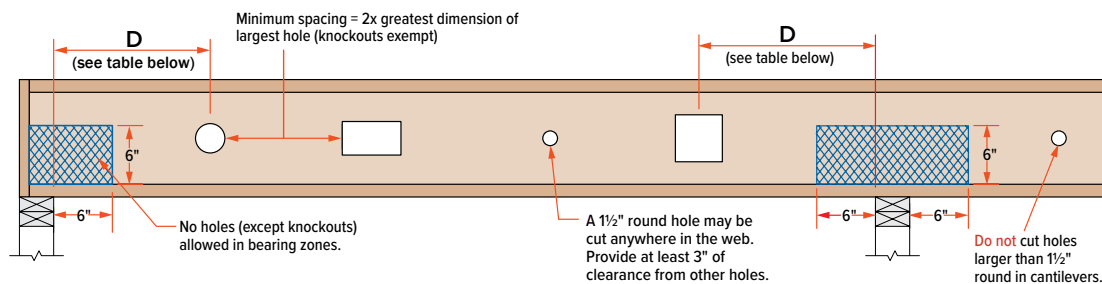

Minimum distance from support, listed in table below, is required for all holes greater than 1½"

MINIMUM DISTANCE (D) FROM ANY SUPPORT TO THE CENTERLINE OF THE HOLE																
Round Hole Diameter [in]			2	3	4	5	6	7	8	8⅞	10	11	12	13	14	15
Rectangular Hole Side [in]			-	-	-	3	5	7	-	-	-	-	-	-	-	-
Any 9½" Joist	Span [ft]	8	1'-0"	1'-1"	1'-8"	2'-4"	2'-11"	3'-7"								
		12	1'-0"	1'-7"	2'-7"	3'-6"	4'-5"	5'-4"								
		16	1'-0"	2'-2"	3'-5"	4'-8"	5'-11"	7'-2"								
Round Hole Diameter [in]			2	3	4	5	6	7	8	8⅞	10	11	12	13	14	15
Rectangular Hole Side [in]			-	-	-	2	3	5	7	8	-	-	-	-	-	-
Any 11⅞" Joist	Span [ft]	8	1'-0"	1'-1"	1'-6"	2'-0"	2'-5"	2'-11"	3'-5"	3'-10"						
		12	1'-0"	1'-7"	2'-3"	3'-0"	3'-8"	4'-5"	5'-1"	5'-9"						
		16	1'-2"	2'-1"	3'-0"	4'-0"	4'-11"	5'-10"	6'-10"	7'-8"						
		20	1'-5"	2'-7"	3'-10"	5'-0"	6'-2"	7'-4"	8'-6"	9'-7"						
Round Hole Diameter [in]			2	3	4	5	6	7	8	8⅞	10	11	12	13	14	15
Rectangular Hole Side [in]			-	-	-	-	2	3	5	6	8	9	-	-	-	-
Any 14" Joist	Span [ft]	8	1'-0"	1'-1"	1'-2"	1'-2"	1'-6"	1'-11"	2'-4"	2'-9"	3'-3"	3'-8"				
		12	1'-0"	1'-1"	1'-2"	1'-7"	2'-3"	2'-11"	3'-6"	4'-1"	4'-10"	5'-6"				
		16	1'-0"	1'-1"	1'-3"	2'-2"	3'-0"	3'-10"	4'-9"	5'-6"	6'-6"	7'-4"				
		20	1'-0"	1'-1"	1'-7"	2'-8"	3'-9"	4'-10"	5'-11"	6'-10"	8'-1"	9'-2"				
		24	1'-0"	1'-1"	1'-11"	3'-3"	4'-6"	5'-10"	7'-1"	8'-3"	9'-9"	11'-0"				
Round Hole Diameter [in]			2	3	4	5	6	7	8	8⅞	10	11	12	13	14	15
Rectangular Hole Side [in]			-	-	-	-	-	2	3	5	6	8	9	10	-	-
Any 16" Joist	Span [ft]	8	1'-0"	1'-1"	1'-2"	1'-2"	1'-3"	1'-3"	1'-7"	1'-11"	2'-4"	2'-9"	3'-2"	3'-7"		
		12	1'-0"	1'-1"	1'-2"	1'-2"	1'-3"	1'-9"	2'-4"	2'-11"	3'-7"	4'-2"	4'-9"	5'-4"		
		16	1'-0"	1'-1"	1'-2"	1'-2"	1'-7"	2'-5"	3'-2"	3'-10"	4'-9"	5'-7"	6'-4"	7'-2"		
		20	1'-0"	1'-1"	1'-2"	1'-2"	2'-0"	3'-0"	4'-0"	4'-10"	5'-11"	6'-11"	7'-11"	8'-11"		
		24	1'-0"	1'-1"	1'-2"	1'-3"	2'-5"	3'-7"	4'-9"	5'-10"	7'-2"	8'-4"	9'-6"	10'-9"		
Round Hole Diameter [in]			2	3	4	5	6	7	8	8⅞	10	11	12	13	14	15
Rectangular Hole Side [in]			-	-	-	-	-	-	2	3	5	6	7	9	10	11
18" BCI® 90 2.0 Joist	Span [ft]	12	1'-0"	1'-1"	1'-2"	1'-2"	1'-5"	1'-11"	2'-4"	2'-9"	3'-3"	3'-9"	4'-2"	4'-8"	5'-1"	5'-7"
		16	1'-0"	1'-1"	1'-2"	1'-4"	1'-11"	2'-7"	3'-2"	3'-8"	4'-5"	5'-0"	5'-7"	6'-3"	6'-10"	7'-5"
		20	1'-0"	1'-1"	1'-2"	1'-8"	2'-5"	3'-3"	4'-0"	4'-8"	5'-6"	6'-3"	7'-0"	7'-9"	8'-7"	9'-4"
		24	1'-0"	1'-1"	1'-2"	2'-0"	2'-11"	3'-10"	4'-9"	5'-7"	6'-7"	7'-6"	8'-5"	9'-4"	10'-3"	11'-2"
		28	1'-0"	1'-1"	1'-4"	2'-5"	3'-5"	4'-6"	5'-7"	6'-6"	7'-9"	8'-9"	9'-10"	10'-11"	12'-0"	13'-1"
Round Hole Diameter [in]			2	3	4	5	6	7	8	8⅞	10	11	12	13	14	15
Rectangular Hole Side [in]			-	-	-	-	-	-	-	2	3	5	6	7	8	10
20" BCI® 90 2.0 Joist	Span [ft]	12	1'-0"	1'-1"	1'-2"	1'-2"	1'-3"	1'-6"	1'-11"	2'-3"	2'-9"	3'-2"	3'-7"	3'-11"	4'-4"	4'-9"
		16	1'-0"	1'-1"	1'-2"	1'-2"	1'-6"	2'-1"	2'-7"	3'-1"	3'-8"	4'-3"	4'-9"	5'-3"	5'-10"	6'-4"
		20	1'-0"	1'-1"	1'-2"	1'-3"	1'-11"	2'-7"	3'-3"	3'-10"	4'-7"	5'-3"	5'-11"	6'-7"	7'-4"	8'-0"
		24	1'-0"	1'-1"	1'-2"	1'-6"	2'-4"	3'-1"	3'-11"	4'-7"	5'-6"	6'-4"	7'-2"	7'-11"	8'-9"	9'-7"
		28	1'-0"	1'-1"	1'-2"	1'-9"	2'-8"	3'-8"	4'-7"	5'-5"	6'-6"	7'-5"	8'-4"	9'-3"	10'-3"	11'-2"


- Select a table row based on joist depth and the actual joist span rounded up to the nearest table span. Scan across the row to the column headed by the appropriate round hole diameter or rectangular hole side. Use the longest side of a rectangular hole. The table value is the closest that the centerline of the hole may be to the centerline of the nearest support.
- The entire web may be cut out. **DO NOT** cut the flanges. Holes apply to either single or multiple joists in repetitive member conditions.
- For multiple holes, the amount of uncut web between holes must equal at least twice the diameter (or longest side) of the largest hole.
- 1½" round knockouts in the web may be removed by using a short piece of metal pipe and hammer.
- Holes may be positioned vertically anywhere in the web. The joist may be set with the 1½" knockout holes turned either up or down.
- This table was designed to apply to the design conditions covered by tables elsewhere in this publication. Use the BC Calc® software to check other hole sizes or holes under other design conditions. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc® software.

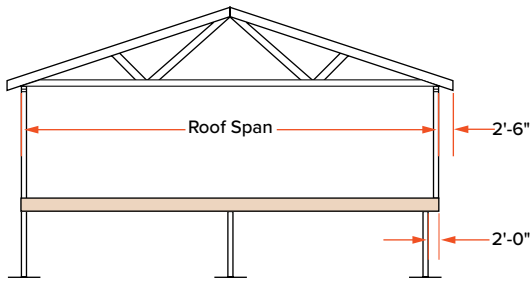

- The tables and details on pages 8 and 9 indicate the type of reinforcements, if any, that are required for load-bearing cantilevers up to a maximum length of 2'-0". Cantilevers longer than 2'-0" cannot be reinforced. **However, longer cantilevers with lower loads may be allowable without reinforcement. Analyze specific applications with the BC Calc® software.**


PLYWOOD / OSB REINFORCEMENT (If Required per Table on page 8 or BC Calc® Analysis)

- $\frac{23}{32}$ " Min. x 48" long plywood / OSB rated sheathing must match the full depth of the BCI® Joist. Nail to the BCI® Joist with 8d nails at 6" o.c. and nail with 4-8d nails into backer block. When reinforcing both sides, stagger nails to limit splitting. Install with horizontal face grain.
- The tables on page 8 assume a wall weight of 100 plf, in addition to the roof loading shown. Applications with loading that exceeds the loads shown shall be analyzed with BC Calc® software.
- These requirements assume a 100 PLF wall load. Additional support may be required for other loadings, see BC Calc® software.

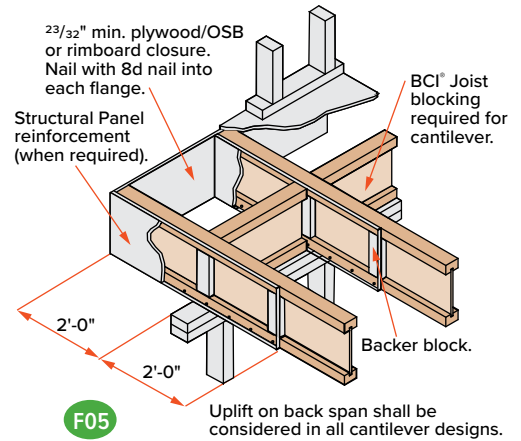


Non-Load Bearing Wall Cantilever Details

BCI® Joists are intended only for applications that provide permanent protection from the weather. Impervious moisture barrier systems shall be detailed and installed in details F15A and F15B in accordance with 2018 IBC® Sections 107.2.5 and 110.3.6.

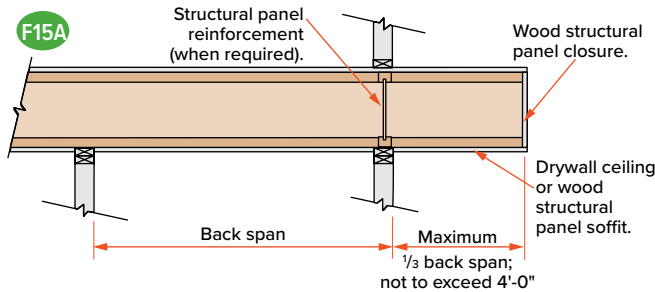


- Analyze BCI® Joist cantilever condition with BC Calc® software.

Fasten the 2x8 minimum to the BCI® Joist by nailing through the backer block and joist web with 2 rows of 10d nails at 6" on-center. Clinch all nails. For BCI® 90 joists, nail each side with 2 rows (4 rows total) of 16d nails at 6" on-center.

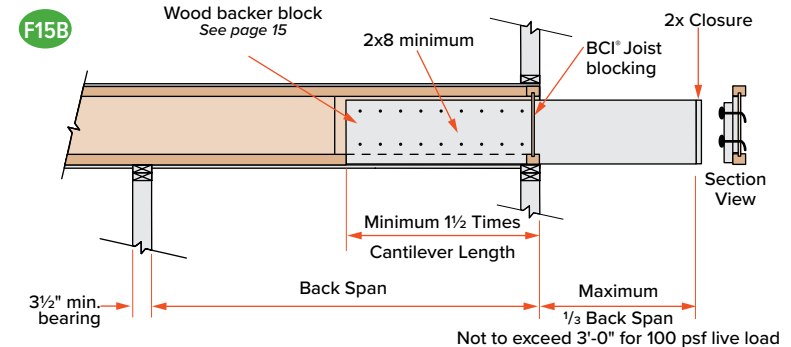

- Loading shall not exceed 60 psf live load and 10 psf dead load. At least three joist members shall be present and spaced at 24" o.c. or less.
- Lumber joist shall be No. 2 Dense Southern Pine, No.1/No.2 SPF, No.2 Hem-fir, or No.2 Douglas fir, or higher grade.
- Provide positive drainage, durable materials, and venting as required in 2018 IBC Sections 2304.12.2.5 and 2304.12.2.6. Lumber joist shall be sloped.

Web Stiffener Requirements

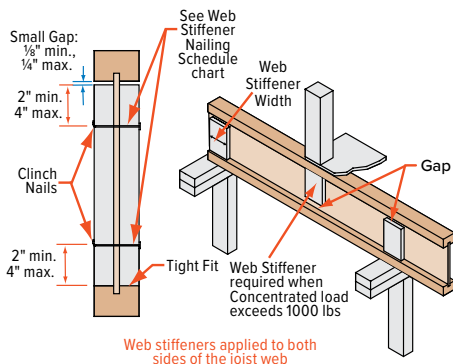

NOTES

- Web stiffeners required at all bearing locations for floor span tables on pages 5-13 (spans without web stiffeners are possible, analyze such conditions with BC Calc sizing software), optional for other applications except as noted below.**
- Web stiffeners are always required for all 18" and 20" BCI® joists at all bearing locations.
- Web stiffeners are always required in hangers that do not extend up to support the top flange of the BCI® Joist. Web stiffeners may be required with certain sloped or skewed hangers or to achieve uplift values. Refer to the hanger manufacturer's installation requirements.
- Web stiffeners are always required in certain roof applications. See *Roof Framing Details* on page 24.
- Web stiffeners are always required under concentrated loads that exceed 1000 pounds. Install the web stiffeners snug to the top flange in this situation. Follow the nailing schedule for intermediate bearings.
- Web stiffeners may be used to increase allowable reaction values. See BCI® *Design Properties* on page 33 or the BC Calc® software.

Structural Panel Web Stiffener			
Series	Minimum Thickness		Minimum Width
	In Hanger	No Hanger	
5000 1.7	$\frac{3}{4}$ "	$\frac{5}{8}$ "	$2\frac{5}{16}$ "
6000 1.8	$\frac{7}{8}$ "	$\frac{3}{4}$ "	$2\frac{5}{16}$ "
6500 1.8	1"	$\frac{3}{4}$ "	$2\frac{5}{16}$ "
60 2.0	$\frac{7}{8}$ "	$\frac{3}{4}$ "	$2\frac{5}{16}$ "
90 2.0	2x4 lumber (vertical)		

Web Stiffener Nailing Schedule			
BCI® Joist Series	Joist Depth	Bearing Location	
		End	Intermediate
5000 1.7	9½"	2-8d	2-8d
	11⅞"	2-8d	3-8d
	14"	2-8d	5-8d
6000 1.8	9½"	2-8d	2-8d
	11⅞"	2-8d	3-8d
	14"	2-8d	5-8d
6500 1.8	9½"	2-8d	2-8d
	11⅞"	2-8d	3-8d
	14"	2-8d	5-8d
60 2.0	11⅞"	2-8d	3-8d
	14"	2-8d	5-8d
	16"	2-8d	6-8d
90 2.0	11⅞"	3-16d	3-16d
	14"	5-16d	5-16d
	16"	6-16d	6-16d
	18"	7-16d	7-16d
	20"	8-16d	8-16d

Allowable Uniform Floor Load (in pounds per lineal foot [PLF])

100% Load Duration

Span Length	BCI® 5000 1.7 Series 2" Flange Width								BCI® 6000 1.8 Series 2 ⁵ / ₁₆ " Flange Width							
	9½" BCI® 5000 1.7		11⅞" BCI® 5000 1.7		14" BCI® 5000 1.7		16" BCI® 5000 1.7		9½" BCI® 6000 1.8		11⅞" BCI® 6000 1.8		14" BCI® 6000 1.8		16" BCI® 6000 1.8	
	Live Load	Total Load	Live Load	Total Load	Live Load	Total Load	Live Load	Total Load	Live Load	Total Load	Live Load	Total Load	Live Load	Total Load	Live Load	Total Load
6	-	280	-	300	-	313	-	316	-	320	-	333	-	346	-	353
7	-	240	-	257	-	268	-	271	-	274	-	285	-	297	-	302
8	-	210	-	225	-	235	-	237	-	240	-	250	-	260	-	265
9	-	186	-	200	-	208	-	211	-	213	-	222	-	231	-	235
10	151	168	-	180	-	188	-	190	175	192	-	200	-	208	-	212
11	117	152	-	163	-	170	-	172	135	174	-	181	-	189	-	192
12	91	136	146	150	-	156	-	158	107	160	-	166	-	173	-	176
13	73	116	117	138	-	144	-	146	85	147	138	153	-	160	-	163
14	59	100	95	128	-	134	-	135	69	129	113	142	-	148	-	151
15	48	87	78	112	115	125	-	126	57	112	93	133	135	138	-	141
16	40	76	65	98	96	116	-	118	47	95	78	125	113	130	-	132
17			55	87	80	103	108	111	40	80	65	112	95	122	-	124
18			47	77	68	92	92	105			56	100	81	115	108	117
19			40	69	58	82	78	94			48	89	70	106	93	111
20					50	74	68	85			41	81	60	96	80	106
21					44	67	59	77					52	87	70	99
22							51	70					46	79	61	90

- Total Load values are limited by shear, moment, or deflection equal to L/240.
- Live Load values are limited by deflection equal to L/480. For deflection limits of L/360 and L/960, multiply the Live Load values by 1.33 and 0.50 respectively.
- Both the Total Load and Live Load columns must be checked. Where a Live Load value is not shown, the Total Load value will control.
- Table values apply to either simple or multiple span joists. Span is measured center to center of the minimum required bearing length. Analyze multiple span joists with the BC Calc® software if the length of any span is less than half the length of an adjacent span.
- Table values do not consider composite action from gluing and nailing floor sheathing (composite action is considered in floor span tables on page 4-13).
- Total Load values assume minimum bearing lengths without web stiffeners for joist depths of 16 inches and less. 18 and 20 inch joists require web stiffeners.
- This table was designed to apply to a broad range of applications. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc® software.

Allowable Uniform Floor Load (in pounds per lineal foot [PLF])

100% Load Duration

Span Length	BCI® 6500 1.8 Series 2 ⁹ / ₁₆ " Flange Width								BCI® 60 2.0 Series 2 ⁵ / ₁₆ " Flange Width					
	9½" BCI® 6500 1.8		11 ⁷ / ₈ " BCI® 6500 1.8		14" BCI® 6500 1.8		16" BCI® 6500 1.8		11 ⁷ / ₈ " BCI® 60 2.0		14" BCI® 60 2.0		16" BCI® 60 2.0	
	Live Load	Total Load	Live Load	Total Load	Live Load	Total Load	Live Load	Total Load	Live Load	Total Load	Live Load	Total Load	Live Load	Total Load
6	-	320	-	333	-	346	-	353	-	366	-	366	-	366
7	-	274	-	285	-	297	-	302	-	314	-	314	-	314
8	-	240	-	250	-	260	-	265	-	275	-	275	-	275
9	-	213	-	222	-	231	-	235	-	244	-	244	-	244
10	190	192	-	200	-	208	-	212	-	220	-	220	-	220
11	147	174	-	181	-	189	-	192	-	200	-	200	-	200
12	116	160	-	166	-	173	-	176	-	183	-	183	-	183
13	93	147	152	153	-	160	-	163	-	169	-	169	-	169
14	76	137	124	142	-	148	-	151	149	157	-	157	-	157
15	62	124	103	133	-	138	-	141	123	146	-	146	-	146
16	52	104	85	125	123	130	-	132	103	137	-	137	-	137
17	44	88	72	117	104	122	-	124	87	129	125	129	-	129
18			61	110	88	115	117	117	74	122	106	122	-	122
19			52	99	76	109	101	111	63	115	92	115	-	115
20			45	89	65	104	87	106	55	110	79	110	105	110
21					57	96	76	100	48	96	69	104	92	104
22					50	88	66	96	42	84	60	100	81	100
23					44	80	58	92			53	95	71	95
24							52	84			47	91	63	91
25							46	77			42	84	56	88
26							41	72					50	84
27													45	81
28													40	78
29														
30														



Allowable Uniform Floor Load (in pounds per lineal foot [PLF])

100% Load Duration


Span Length	BCI® 90 2.0 Series 3½" Flange Width									
	11⅞" BCI® 90 2.0		14" BCI® 90 2.0		16" BCI® 90 2.0		18" BCI® 90 2.0		20" BCI® 90 2.0	
	Live Load	Total Load	Live Load	Total Load	Live Load	Total Load	Live Load	Total Load	Live Load	Total Load
6	-	450	-	453	-	456	-	553	-	573
7	-	385	-	388	-	391	-	474	-	491
8	-	337	-	340	-	342	-	415	-	430
9	-	300	-	302	-	304	-	368	-	382
10	-	270	-	272	-	274	-	332	-	344
11	-	245	-	247	-	249	-	301	-	312
12	-	225	-	226	-	228	-	276	-	286
13	-	207	-	209	-	210	-	255	-	264
14	-	192	-	194	-	195	-	237	-	245
15	174	180	-	181	-	182	-	221	-	229
16	146	168	-	170	-	171	-	207	-	215
17	124	158	-	160	-	161	-	195	-	202
18	106	150	150	151	-	152	-	184	-	191
19	91	142	129	143	-	144	-	174	-	181
20	79	135	112	136	-	137	-	166	-	172
21	69	128	98	129	-	130	-	158	-	163
22	61	122	86	123	115	124	146	150	-	156
23	53	107	76	118	101	119	129	144	-	149
24	47	95	68	113	90	114	115	138	-	143
25	42	85	60	108	80	109	103	132	128	137
26			54	104	72	105	92	127	115	132
27			48	97	65	101	83	122	104	127
28			44	88	58	97	75	118	94	122
29					53	94	68	114	85	118
30					48	91	62	110	77	114

- Total Load values are limited by shear, moment, or deflection equal to L/240.
- Live Load values are limited by deflection equal to L/480. For deflection limits of L/360 and L/960, multiply the Live Load values by 1.33 and 0.50 respectively.
- Both the Total Load and Live Load columns must be checked. Where a Live Load value is not shown, the Total Load value will control.
- Table values apply to either simple or multiple span joists. Span is measured center to center of the minimum required bearing length. Analyze multiple span joists with the

BC Calc® software if the length of any span is less than half the length of an adjacent span.

- Table values do not consider composite action from gluing and nailing floor sheathing (composite action is considered in floor span tables on page 4-13).
- Total Load values assume minimum bearing lengths without web stiffeners for joist depths of 16 inches and less. 18 and 20 inch joists require web stiffeners.
- This table was designed to apply to a broad range of applications. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc® software.

BCI® Rafters

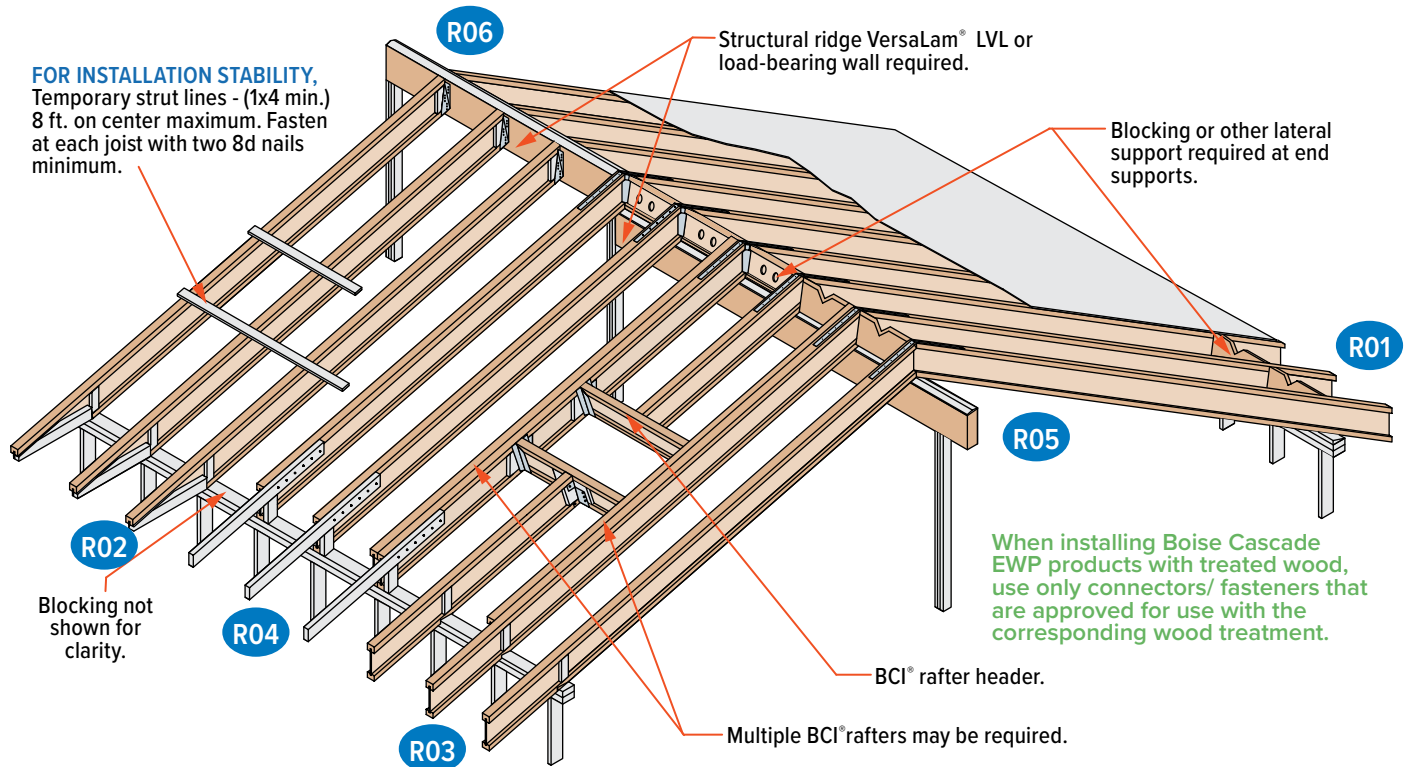

SAFETY WARNING


DO NOT ALLOW WORKERS ON BCI® JOISTS UNTIL ALL HANGERS, BCI® RIM JOISTS, RIM BOARDS, BCI® BLOCKING PANELS, X-BRACING AND TEMPORARY 1x4 STRUT LINES ARE INSTALLED AS SPECIFIED BELOW.

SERIOUS ACCIDENTS CAN RESULT FROM INSUFFICIENT ATTENTION TO PROPER BRACING DURING CONSTRUCTION. ACCIDENTS CAN BE AVOIDED UNDER NORMAL CONDITIONS BY FOLLOWING THESE GUIDELINES:

- Build a braced end wall at the end of the bay, or permanently install the first eight feet of BCI® Joists and the first course of sheathing. As an alternate, temporary sheathing may be nailed to the first four feet of BCI® Joists at the end of the bay.
- All hangers, BCI® rim joists, rim boards, BCI® blocking panels, and x-bracing must be completely installed and properly nailed as each BCI® Joist is set.
- Install temporary 1x4 strut lines at no more than eight feet on center as additional BCI® Joists are set. Nail the strut lines to the sheathed area, or braced end wall, and to each BCI® Joist with two 8d nails.
- The ends of cantilevers must be temporarily secured by strut lines on both the top and bottom flanges.
- Straighten the BCI® Joists to within ½ inch of true alignment before attaching strut lines and sheathing.
- Remove the temporary strut lines only as required to install the permanent sheathing.
- Failure to install temporary bracing may result in sideways buckling or roll-over under light construction loads.



Additional floor framing details available with BC Framers® software

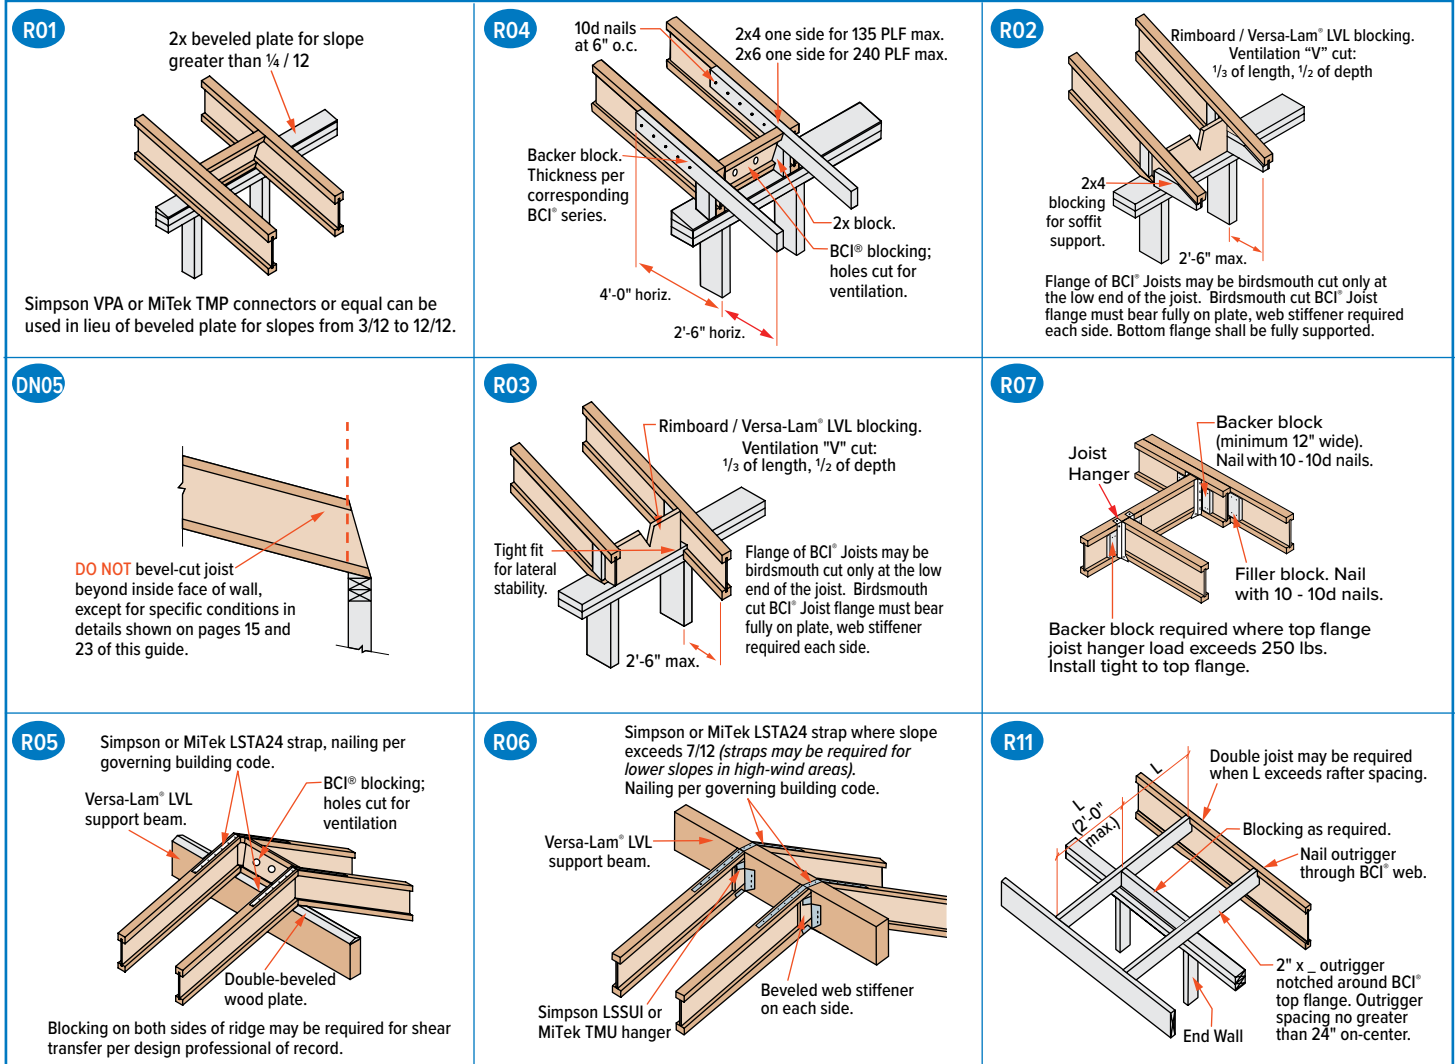

LATERAL SUPPORT

- BCI® Joists must be laterally supported at end supports (including supports adjacent to overhangs) with hangers, rimboard, or blocking (Versa-Lam®, Boise Cascade Rimboard or BCI® Joist). Metal cross bracing or other x-bracing provides adequate lateral support for BCI® Joists, consult governing building code for roof diaphragm connection provisions.

MINIMUM BEARING LENGTH FOR BCI® JOISTS

- Minimum end bearing: 1½" for BCI® 5000, 6000 & 6500; 1¾" for BCI® 60 & 90. 3½" is required at cantilever and intermediate supports.
- Longer bearing lengths allow higher reaction values. Refer to the building code evaluation report or the BC Calc® software.

NAILING REQUIREMENTS

- BCI® rim joist, rim board or closure panel to BCI® joist:
 - Rims or closure panel 1¾ inches thick and less: 2-8d nails, one each in the top and bottom flange.
 - BCI® 5000 rim joist: 2-10d box nails, one each in the top and bottom flange.
 - BCI® 6000, 60 rim joist: 2-16d box nails, one each in the top and bottom flange.
 - BCI® 6500, 90 rim joist: Toe-nail top flange to rim joist with 2-10d box nails, one each side of flange.
- BCI® rim joist, rim board or BCI® blocking panel to support:
 - Min. 8d nails @ 6" o.c. per IRC.
 - Connection per design professional of record's specification for shear transfer.

- BCI® joist to support:

- 2-8d nails, one on each side of the web, placed 1½ inches minimum from the end of the BCI® Joist to limit splitting.

- Sheathing to BCI® joist:

- Prescriptive residential roof sheathing nailing requires 8d common nails @ 6" o.c. on edges and @ 12" o.c. in the field (IRC Table R602.3(1)).
- See closest allowable nail spacing limits on page 24 for floor diaphragm nailing specified at closer spacing than IRC.
- Maximum nail spacing for minimum lateral stability: 18" for BCI® 5000, 24" for larger BCI® joist series.
- 14 gauge staples may be substituted for 8d nails if the staples penetrate at least 1 inch into the joist.
- Wood screws may be acceptable, contact local building official and/or Boise Cascade EWP Engineering for further information.

BACKER AND FILLER BLOCK DIMENSIONS

Series	Backer Block Thickness	Filler Block Thickness
5000 1.7	¾" or 7/8" wood panels	Two ¾" wood panels or 2x
6000 1.8	1½" or two ¾" wood panels	2x + ¾" or 1½" wood panel
6500 1.8	1½" or two ¾" wood panels	2x + ¾" or ¾" wood panel
60 2.0	1½" or two ¾" wood panels	2x + ¾" or 1½" wood panel
90 2.0	2x lumber	Double 2x lumber

- Cut backer and filler blocks to a maximum depth equal to the web depth minus ¼" to avoid a forced fit.

WEB STIFFENER REQUIREMENTS

- See Web Stiffener Requirements on page 18.

PROTECT BCI® JOISTS FROM THE WEATHER

- BCI® Joists are intended only for applications that provide permanent protection from the weather. Bundles of BCI® Joists should be covered and stored off of the ground on stickers.

MAXIMUM SLOPE

- Unless otherwise noted, all roof details are valid for slopes of 12 in 12 or less.

VENTILATION

- The 1½ inch, pre-stamped knock-out holes spaced at 12 inches on center along the BCI® Joist may all be knocked out and used for cross ventilation. Deeper joists than what is structurally needed may be advantageous in ventilation design. Consult local building official and/or ventilation specialist for specific ventilation requirements.

BIRDSMOUTH CUTS

- BCI® Joists may be birdsmouth cut only at the low end support. BCI® joists with birdsmouth cuts may cantilever up to 2'-6" past the low end support. The bottom flange must sit fully on the support and may not overhang the inside face of the support. High end supports and intermediate supports may not be birdsmouth cut.

Maximum clear span in feet and inches, based on horizontal spans.

115% and 125% Load Duration

				BCI® 5000 1.7 Series 2" Flange Width											
				9½" BCI® 5000 1.7			11⅞" BCI® 5000 1.7			14" BCI® 5000 1.7			16" BCI® 5000 1.7		
				4/12 or Less	4/12 to 8/12	8/12 to 12/12	4/12 or Less	4/12 to 8/12	8/12 to 12/12	4/12 or Less	4/12 to 8/12	8/12 to 12/12	4/12 or Less	4/12 to 8/12	8/12 to 12/12
16" o.c.	Non-Snow 125%	20	10	21'-10"	20'-7"	19'-1"	25'-11"	24'-5"	22'-8"	29'-6"	27'-10"	25'-10"	32'-1"	30'-10"	28'-8"
		20	15	20'-8"	19'-5"	17'-11"	24'-6"	23'-0"	21'-3"	27'-8"	26'-3"	24'-3"	29'-7"	28'-9"	26'-10"
		20	20	19'-9"	18'-6"	17'-0"	23'-5"	21'-11"	20'-2"	25'-10"	25'-0"	22'-11"	27'-8"	26'-8"	25'-5"
	Snow 115%	25	10	20'-9"	19'-7"	18'-3"	24'-6"	23'-3"	21'-8"	26'-8"	26'-1"	24'-8"	28'-6"	27'-11"	27'-2"
		25	15	19'-9"	18'-7"	17'-3"	22'-10"	22'-1"	20'-5"	24'-10"	24'-3"	23'-4"	26'-7"	25'-11"	25'-0"
		30	10	19'-10"	18'-9"	17'-6"	22'-11"	22'-3"	20'-9"	24'-11"	24'-6"	23'-8"	26'-8"	26'-2"	25'-7"
		30	15	19'-0"	17'-11"	16'-8"	21'-6"	21'-0"	19'-9"	23'-5"	22'-11"	22'-2"	25'-1"	24'-6"	23'-8"
		40	10	18'-0"	17'-4"	16'-4"	20'-6"	20'-2"	19'-4"	22'-4"	22'-0"	21'-7"	23'-10"	23'-6"	23'-0"
		40	15	17'-2"	16'-10"	15'-8"	19'-6"	19'-1"	18'-7"	21'-3"	20'-10"	20'-3"	22'-8"	22'-3"	21'-8"
		50	10	16'-6"	16'-0"	15'-2"	18'-8"	18'-6"	18'-0"	20'-4"	20'-1"	19'-9"	21'-9"	21'-6"	21'-2"
50	15	15'-10"	15'-6"	14'-10"	17'-11"	17'-7"	17'-3"	19'-6"	19'-2"	18'-9"	20'-10"	20'-6"	20'-1"		
19.2" o.c.	Non-Snow 125%	20	10	20'-6"	19'-4"	18'-0"	24'-4"	22'-11"	21'-4"	27'-5"	26'-2"	24'-3"	29'-3"	28'-7"	26'-11"
		20	15	19'-5"	18'-3"	16'-10"	23'-0"	21'-8"	20'-0"	25'-3"	24'-6"	22'-9"	27'-0"	26'-2"	25'-2"
		20	20	18'-6"	17'-4"	15'-11"	21'-8"	20'-7"	18'-11"	23'-7"	22'-9"	21'-7"	25'-2"	24'-4"	23'-3"
	Snow 115%	25	10	19'-6"	18'-5"	17'-2"	22'-4"	21'-10"	20'-4"	24'-4"	23'-10"	23'-2"	26'-0"	25'-6"	24'-9"
		25	15	18'-4"	17'-6"	16'-2"	20'-10"	20'-3"	19'-2"	22'-8"	22'-1"	21'-4"	24'-3"	23'-7"	22'-9"
		30	10	18'-5"	17'-8"	16'-5"	20'-11"	20'-6"	19'-6"	22'-9"	22'-4"	21'-10"	24'-4"	23'-11"	23'-4"
		30	15	17'-4"	16'-10"	15'-8"	19'-7"	19'-2"	18'-6"	21'-5"	20'-11"	20'-3"	22'-10"	22'-4"	21'-7"
		40	10	16'-6"	16'-3"	15'-4"	18'-8"	18'-5"	18'-0"	20'-4"	20'-1"	19'-8"	21'-9"	21'-5"	21'-0"
		40	15	15'-8"	15'-4"	14'-8"	17'-9"	17'-5"	16'-11"	19'-4"	19'-0"	18'-6"	20'-8"	20'-3"	19'-9"
		50	10	15'-0"	14'-10"	14'-3"	17'-0"	16'-10"	16'-7"	18'-7"	18'-4"	18'-0"	19'-10"	19'-7"	19'-3"
50	15	14'-5"	14'-2"	13'-10"	16'-4"	16'-1"	15'-8"	17'-10"	17'-6"	17'-1"	19'-0"	18'-9"	18'-3"		
24" o.c.	Non-Snow 125%	20	10	19'-0"	17'-11"	16'-8"	22'-5"	21'-3"	19'-9"	24'-6"	23'-11"	22'-6"	26'-2"	25'-6"	24'-9"
		20	15	18'-0"	16'-11"	15'-7"	20'-9"	20'-0"	18'-6"	22'-7"	21'-11"	21'-0"	24'-2"	23'-5"	22'-6"
		20	20	17'-1"	16'-1"	14'-9"	19'-4"	18'-8"	17'-6"	21'-1"	20'-4"	19'-5"	22'-6"	21'-9"	20'-9"
	Snow 115%	25	10	17'-7"	17'-1"	15'-11"	19'-11"	19'-6"	18'-10"	21'-9"	21'-3"	20'-8"	23'-3"	22'-9"	22'-1"
		25	15	16'-5"	15'-11"	15'-0"	18'-7"	18'-1"	17'-5"	20'-3"	19'-9"	19'-0"	21'-8"	21'-1"	20'-4"
		30	10	16'-5"	16'-2"	15'-3"	18'-8"	18'-4"	17'-10"	20'-4"	20'-0"	19'-6"	21'-9"	21'-4"	20'-10"
		30	15	15'-5"	15'-1"	14'-6"	17'-6"	17'-1"	16'-7"	19'-1"	18'-8"	18'-1"	20'-5"	19'-11"	19'-4"
		40	10	14'-8"	14'-6"	14'-2"	16'-8"	16'-5"	16'-1"	18'-2"	17'-11"	17'-7"	19'-5"	19'-2"	18'-9"
		40	15	14'-0"	13'-8"	13'-4"	15'-10"	15'-7"	15'-2"	17'-3"	16'-11"	16'-6"	18'-6"	18'-1"	17'-8"
		50	10	13'-5"	13'-3"	13'-0"	15'-3"	15'-0"	14'-9"	16'-7"	16'-5"	16'-1"	17'-9"	17'-6"	16'-11"
50	15	12'-10"	12'-8"	12'-4"	14'-7"	14'-4"	14'-0"	15'-11"	15'-8"	14'-11"	16'-6"	16'-0"	15'-3"		
32" o.c.	Non-Snow 125%	20	10	17'-1"	16'-3"	15'-1"	19'-5"	18'-11"	17'-10"	21'-2"	20'-8"	20'-0"	22'-7"	22'-1"	21'-4"
		20	15	15'-9"	15'-3"	14'-1"	17'-11"	17'-4"	16'-8"	19'-6"	18'-11"	18'-2"	20'-10"	20'-3"	19'-5"
		20	20	14'-9"	14'-3"	13'-4"	16'-8"	16'-1"	15'-5"	18'-2"	17'-7"	16'-9"	19'-6"	18'-9"	17'-11"
	Snow 115%	25	10	15'-2"	14'-11"	14'-4"	17'-3"	16'-10"	16'-5"	18'-9"	18'-5"	17'-11"	20'-1"	19'-8"	19'-1"
		25	15	14'-2"	13'-9"	13'-3"	16'-1"	15'-8"	15'-1"	17'-6"	17'-1"	16'-5"	18'-9"	18'-3"	17'-7"
		30	10	14'-2"	13'-11"	13'-7"	16'-1"	15'-10"	15'-5"	17'-7"	17'-3"	16'-10"	18'-9"	18'-5"	18'-0"
		30	15	13'-4"	13'-0"	12'-7"	15'-2"	14'-9"	14'-4"	16'-6"	16'-1"	15'-7"	17'-8"	17'-0"	15'-11"
		40	10	12'-8"	12'-6"	12'-3"	14'-5"	14'-2"	13'-11"	15'-8"	15'-4"	14'-9"	16'-1"	15'-8"	15'-0"
		40	15	12'-1"	11'-10"	11'-6"	13'-8"	13'-1"	12'-5"	14'-3"	13'-9"	13'-0"	14'-7"	14'-0"	13'-3"
		50	10	11'-7"	11'-5"	11'-0"	12'-7"	12'-3"	11'-10"	13'-2"	12'-10"	12'-5"	13'-5"	13'-1"	12'-8"
50	15	10'-9"	10'-5"	9'-11"	11'-6"	11'-2"	10'-8"	12'-1"	11'-8"	11'-1"	12'-4"	11'-11"	11'-4"		

- Tables are intended to be used for preliminary sizing of roof members only and not for final sizing. Tables are based on a uniformly loaded roof due to roof live or snow loads and dead load. Wind loading, unbalanced snow loading, snow drifting, sliding and surcharges, and roof-top mechanical units are NOT considered in the tables. The determination of such roof design loads is the responsibility of the project's design professional of record.
- Table values are limited by shear, moment, total load deflection equal to L/180 and live load deflection equal to L/240. Check the local building code for other deflection limits that may apply.
- Table values represent the most restrictive of simple or multiple span applications.

- Table values assume minimum bearing lengths without web stiffeners for joist depths of 16 inches and less. 18 and 20 inch joists require web stiffeners.
- This table was designed to apply to a broad range of applications. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc® software.
- Slope roof joists at least ¼" over 12" to minimize ponding.
- Allowable spans and loads shall be adjusted and checked for wind load as required by local building code.

Maximum clear span in feet and inches, based on horizontal spans.

115% and 125% Load Duration

				BCI® 6000 1.8 Series 2 ⁵ / ₁₆ " Flange Width											
				9½" BCI® 6000 1.8			11⅞" BCI® 6000 1.8			14" BCI® 6000 1.8			16" BCI® 6000 1.8		
		Live Load [psf]	Dead Load [psf]	4/12 or Less	4/12 to 8/12	8/12 to 12/12	4/12 or Less	4/12 to 8/12	8/12 to 12/12	4/12 or Less	4/12 to 8/12	8/12 to 12/12	4/12 or Less	4/12 to 8/12	8/12 to 12/12
16" o.c.	Non-Snow 125%	20	10	23'-2"	21'-10"	20'-3"	27'-7"	26'-0"	24'-2"	31'-5"	29'-7"	27'-6"	34'-9"	32'-9"	30'-5"
		20	15	21'-11"	20'-7"	19'-0"	26'-1"	24'-6"	22'-8"	29'-9"	27'-11"	25'-9"	32'-11"	30'-11"	28'-6"
		20	20	20'-11"	19'-7"	18'-0"	24'-11"	23'-4"	21'-5"	28'-5"	26'-7"	24'-5"	31'-5"	29'-5"	27'-0"
	Snow 115%	25	10	22'-0"	20'-9"	19'-4"	26'-2"	24'-9"	23'-0"	29'-10"	28'-2"	26'-3"	32'-5"	31'-2"	29'-0"
		25	15	20'-11"	19'-9"	18'-3"	24'-11"	23'-6"	21'-9"	28'-3"	26'-9"	24'-10"	30'-3"	29'-5"	27'-5"
		30	10	21'-0"	19'-11"	18'-7"	25'-0"	23'-8"	22'-1"	28'-4"	27'-0"	25'-2"	30'-4"	29'-9"	27'-10"
		30	15	20'-1"	19'-0"	17'-7"	24'-0"	22'-7"	21'-0"	26'-8"	25'-9"	23'-11"	28'-6"	27'-10"	26'-6"
		40	10	19'-1"	18'-4"	17'-3"	22'-9"	21'-10"	20'-7"	25'-5"	24'-11"	23'-6"	27'-2"	26'-9"	26'-0"
		40	15	18'-9"	17'-9"	16'-7"	22'-2"	21'-2"	19'-9"	24'-2"	23'-8"	22'-6"	25'-10"	25'-4"	24'-8"
		50	10	17'-8"	16'-11"	16'-1"	21'-1"	20'-2"	19'-2"	23'-2"	22'-11"	21'-10"	24'-9"	24'-6"	24'-1"
50	15	17'-8"	16'-10"	15'-9"	20'-4"	20'-0"	18'-9"	22'-2"	21'-10"	21'-4"	23'-9"	23'-4"	22'-10"		
19.2" o.c.	Non-Snow 125%	20	10	21'-9"	20'-6"	19'-0"	25'-11"	24'-5"	22'-8"	29'-6"	27'-10"	25'-10"	32'-8"	30'-10"	28'-7"
		20	15	20'-7"	19'-4"	17'-10"	24'-6"	23'-0"	21'-3"	27'-11"	26'-3"	24'-3"	30'-8"	29'-0"	26'-10"
		20	20	19'-7"	18'-4"	16'-11"	23'-4"	21'-11"	20'-2"	26'-8"	24'-11"	22'-11"	28'-8"	27'-7"	25'-5"
	Snow 115%	25	10	20'-7"	19'-6"	18'-2"	24'-7"	23'-3"	21'-8"	27'-8"	26'-6"	24'-8"	29'-7"	28'-11"	27'-3"
		25	15	19'-8"	18'-6"	17'-2"	23'-5"	22'-1"	20'-5"	25'-9"	25'-1"	23'-4"	27'-7"	26'-10"	25'-9"
		30	10	19'-8"	18'-8"	17'-5"	23'-6"	22'-3"	20'-9"	25'-10"	25'-4"	23'-8"	27'-8"	27'-2"	26'-2"
		30	15	18'-11"	17'-10"	16'-7"	22'-4"	21'-3"	19'-9"	24'-4"	23'-9"	22'-6"	26'-0"	25'-5"	24'-7"
		40	10	17'-11"	17'-2"	16'-3"	21'-3"	20'-6"	19'-4"	23'-2"	22'-10"	22'-1"	24'-9"	24'-5"	23'-11"
		40	15	17'-8"	16'-8"	15'-7"	20'-2"	19'-10"	18'-7"	22'-0"	21'-7"	21'-0"	23'-6"	23'-1"	22'-6"
		50	10	16'-7"	15'-11"	15'-1"	19'-5"	19'-0"	18'-0"	21'-1"	20'-10"	20'-6"	22'-7"	22'-4"	21'-11"
50	15	16'-4"	15'-9"	14'-9"	18'-7"	18'-3"	17'-7"	20'-3"	19'-11"	19'-5"	21'-8"	21'-3"	20'-10"		
24" o.c.	Non-Snow 125%	20	10	20'-1"	19'-0"	17'-7"	24'-0"	22'-7"	21'-0"	27'-4"	25'-9"	23'-11"	29'-9"	28'-6"	26'-6"
		20	15	19'-0"	17'-11"	16'-6"	22'-8"	21'-4"	19'-8"	25'-8"	24'-4"	22'-5"	27'-5"	26'-7"	24'-10"
		20	20	18'-2"	17'-0"	15'-8"	21'-8"	20'-3"	18'-8"	23'-11"	23'-1"	21'-3"	25'-7"	24'-9"	23'-6"
	Snow 115%	25	10	19'-1"	18'-1"	16'-10"	22'-8"	21'-6"	20'-0"	24'-8"	24'-2"	22'-10"	26'-5"	25'-10"	25'-2"
		25	15	18'-2"	17'-2"	15'-10"	21'-2"	20'-5"	18'-11"	23'-0"	22'-5"	21'-7"	24'-8"	24'-0"	23'-2"
		30	10	18'-3"	17'-3"	16'-2"	21'-2"	20'-7"	19'-3"	23'-1"	22'-8"	21'-11"	24'-9"	24'-3"	23'-8"
		30	15	17'-6"	16'-6"	15'-4"	19'-11"	19'-6"	18'-3"	21'-9"	21'-3"	20'-6"	23'-3"	22'-8"	21'-11"
		40	10	16'-7"	15'-11"	15'-0"	19'-0"	18'-8"	17'-11"	20'-8"	20'-4"	20'-0"	22'-1"	21'-9"	21'-4"
		40	15	15'-11"	15'-5"	14'-5"	18'-0"	17'-8"	17'-2"	19'-8"	19'-3"	18'-9"	21'-0"	20'-7"	19'-8"
		50	10	15'-3"	14'-8"	14'-0"	17'-4"	17'-1"	16'-8"	18'-10"	18'-8"	18'-4"	19'-10"	19'-5"	18'-9"
50	15	14'-7"	14'-4"	13'-8"	16'-7"	16'-4"	15'-11"	17'-11"	17'-4"	16'-6"	18'-3"	17'-8"	16'-10"		
32" o.c.	Non-Snow 125%	20	10	18'-2"	17'-2"	15'-11"	21'-8"	20'-6"	19'-0"	24'-1"	23'-4"	21'-8"	25'-9"	25'-1"	24'-0"
		20	15	17'-3"	16'-2"	14'-11"	20'-4"	19'-4"	17'-10"	22'-2"	21'-6"	20'-4"	23'-9"	23'-0"	22'-1"
		20	20	16'-5"	15'-5"	14'-2"	19'-0"	18'-4"	16'-10"	20'-8"	20'-0"	19'-1"	22'-2"	21'-4"	20'-4"
	Snow 115%	25	10	17'-3"	16'-4"	15'-3"	19'-7"	19'-2"	18'-2"	21'-4"	20'-11"	20'-4"	22'-10"	22'-4"	21'-9"
		25	15	16'-1"	15'-6"	14'-4"	18'-3"	17'-9"	17'-2"	19'-11"	19'-5"	18'-8"	21'-4"	20'-9"	19'-6"
		30	10	16'-2"	15'-8"	14'-7"	18'-4"	18'-0"	17'-5"	20'-0"	19'-7"	19'-2"	21'-4"	21'-0"	20'-5"
		30	15	15'-2"	14'-10"	13'-10"	17'-3"	16'-10"	16'-3"	18'-9"	18'-4"	17'-3"	19'-8"	18'-9"	17'-7"
		40	10	14'-5"	14'-3"	13'-7"	16'-5"	16'-2"	15'-8"	17'-6"	17'-0"	16'-4"	17'-10"	17'-4"	16'-8"
		40	15	13'-9"	13'-5"	13'-0"	15'-2"	14'-7"	13'-10"	15'-10"	15'-2"	14'-5"	16'-1"	15'-6"	14'-8"
		50	10	13'-2"	13'-0"	12'-8"	14'-0"	13'-8"	13'-2"	14'-7"	14'-2"	13'-9"	14'-10"	14'-6"	14'-0"
50	15	12'-4"	11'-11"	11'-4"	12'-10"	12'-5"	11'-10"	13'-4"	12'-11"	12'-4"	13'-8"	13'-2"	12'-7"		

- Tables are intended to be used for preliminary sizing of roof members only and not for final sizing. Tables are based on a uniformly loaded roof due to roof live or snow loads and dead load. Wind loading, unbalanced snow loading, snow drifting, sliding and surcharges, and roof-top mechanical units are NOT considered in the tables. The determination of such roof design loads is the responsibility of the project's design professional of record.

- Table values are limited by shear, moment, total load deflection equal to L/180 and live load deflection equal to L/240. Check the local building code for other deflection limits that may apply.

- Table values represent the most restrictive of simple or multiple span applications.

- Table values assume minimum bearing lengths without web stiffeners for joist depths of 16 inches and less. 18 and 20 inch joists require web stiffeners.

- This table was designed to apply to a broad range of applications. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc® software.

- Slope roof joists at least ¼" over 12" to minimize ponding.

- Allowable spans and loads shall be adjusted and checked for wind load as required by local building code.

Maximum clear span in feet and inches, based on horizontal spans.

115% and 125% Load Duration

				BCI® 6500 1.8 Series 2 ⁹ / ₁₆ " Flange Width											
				9½" BCI® 6500 1.8			11 ⁷ / ₈ " BCI® 6500 1.8			14" BCI® 6500 1.8			16" BCI® 6500 1.8		
				4/12 or Less	4/12 to 8/12	8/12 to 12/12	4/12 or Less	4/12 to 8/12	8/12 to 12/12	4/12 or Less	4/12 to 8/12	8/12 to 12/12	4/12 or Less	4/12 to 8/12	8/12 to 12/12
16" o.c.	Non-Snow 125%	20	10	23'-11"	22'-7"	20'-11"	28'-5"	26'-10"	24'-11"	32'-5"	30'-6"	28'-4"	35'-10"	33'-9"	31'-4"
		20	15	22'-8"	21'-3"	19'-8"	26'-11"	25'-4"	23'-4"	30'-8"	28'-10"	26'-7"	33'-11"	31'-10"	29'-5"
		20	20	21'-7"	20'-3"	18'-7"	25'-8"	24'-1"	22'-1"	29'-3"	27'-5"	25'-2"	32'-4"	30'-3"	27'-10"
	Snow 115%	25	10	22'-8"	21'-6"	20'-0"	27'-0"	25'-6"	23'-9"	30'-9"	29'-1"	27'-1"	34'-0"	32'-2"	29'-11"
		25	15	21'-8"	20'-5"	18'-11"	25'-9"	24'-3"	22'-5"	29'-4"	27'-7"	25'-7"	31'-10"	30'-6"	28'-3"
		30	10	21'-8"	20'-7"	19'-2"	25'-10"	24'-5"	22'-10"	29'-5"	27'-10"	26'-0"	31'-11"	30'-9"	28'-9"
		30	15	20'-10"	19'-8"	18'-3"	24'-9"	23'-4"	21'-8"	28'-1"	26'-7"	24'-8"	30'-0"	29'-4"	27'-4"
		40	10	19'-9"	18'-11"	17'-10"	23'-6"	22'-6"	21'-3"	26'-9"	25'-8"	24'-3"	28'-7"	28'-2"	26'-9"
		40	15	19'-5"	18'-5"	17'-2"	23'-1"	21'-11"	20'-5"	25'-5"	24'-11"	23'-3"	27'-2"	26'-8"	25'-8"
		50	10	18'-3"	17'-6"	16'-8"	21'-9"	20'-10"	19'-10"	24'-5"	23'-9"	22'-7"	26'-1"	25'-9"	24'-11"
50	15	18'-3"	17'-5"	16'-3"	21'-5"	20'-9"	19'-4"	23'-5"	23'-0"	22'-0"	25'-0"	24'-7"	24'-0"		
19.2" o.c.	Non-Snow 125%	20	10	22'-6"	21'-2"	19'-8"	26'-9"	25'-2"	23'-5"	30'-5"	28'-8"	26'-8"	33'-8"	31'-9"	29'-5"
		20	15	21'-3"	20'-0"	18'-5"	25'-4"	23'-9"	21'-11"	28'-10"	27'-1"	25'-0"	31'-10"	29'-11"	27'-7"
		20	20	20'-3"	19'-0"	17'-6"	24'-2"	22'-7"	20'-9"	27'-6"	25'-9"	23'-8"	30'-2"	28'-5"	26'-2"
	Snow 115%	25	10	21'-4"	20'-2"	18'-9"	25'-4"	24'-0"	22'-4"	28'-11"	27'-4"	25'-5"	31'-1"	30'-2"	28'-1"
		25	15	20'-4"	19'-2"	17'-9"	24'-2"	22'-9"	21'-1"	27'-2"	25'-11"	24'-0"	29'-0"	28'-3"	26'-7"
		30	10	20'-4"	19'-4"	18'-0"	24'-3"	23'-0"	21'-5"	27'-3"	26'-2"	24'-5"	29'-1"	28'-7"	27'-0"
		30	15	19'-6"	18'-5"	17'-1"	23'-3"	21'-11"	20'-4"	25'-7"	25'-0"	23'-2"	27'-5"	26'-9"	25'-8"
		40	10	18'-6"	17'-9"	16'-9"	22'-1"	21'-2"	20'-0"	24'-4"	24'-0"	22'-9"	26'-1"	25'-8"	25'-2"
		40	15	18'-3"	17'-3"	16'-1"	21'-3"	20'-7"	19'-2"	23'-2"	22'-9"	21'-10"	24'-9"	24'-4"	23'-8"
		50	10	17'-1"	16'-5"	15'-7"	20'-5"	19'-7"	18'-7"	22'-3"	22'-0"	21'-2"	23'-9"	23'-6"	23'-1"
50	15	17'-1"	16'-4"	15'-3"	19'-7"	19'-3"	18'-2"	21'-4"	21'-0"	20'-6"	22'-10"	22'-2"	21'-2"		
24" o.c.	Non-Snow 125%	20	10	20'-10"	19'-8"	18'-3"	24'-9"	23'-4"	21'-8"	28'-2"	26'-7"	24'-8"	31'-2"	29'-5"	27'-4"
		20	15	19'-8"	18'-6"	17'-1"	23'-5"	22'-0"	20'-4"	26'-8"	25'-1"	23'-2"	28'-11"	27'-9"	25'-7"
		20	20	18'-9"	17'-7"	16'-2"	22'-4"	20'-11"	19'-3"	25'-3"	23'-10"	21'-11"	26'-11"	26'-0"	24'-3"
	Snow 115%	25	10	19'-9"	18'-8"	17'-5"	23'-6"	22'-3"	20'-8"	26'-0"	25'-4"	23'-7"	27'-10"	27'-3"	26'-1"
		25	15	18'-10"	17'-9"	16'-5"	22'-3"	21'-1"	19'-6"	24'-3"	23'-7"	22'-3"	25'-11"	25'-3"	24'-4"
		30	10	18'-10"	17'-10"	16'-8"	22'-4"	21'-3"	19'-10"	24'-4"	23'-11"	22'-7"	26'-0"	25'-7"	24'-11"
		30	15	18'-1"	17'-1"	15'-10"	21'-0"	20'-4"	18'-10"	22'-10"	22'-4"	21'-6"	24'-5"	23'-11"	23'-1"
		40	10	17'-1"	16'-5"	15'-6"	20'-0"	19'-7"	18'-6"	21'-9"	21'-5"	21'-0"	23'-3"	22'-11"	22'-3"
		40	15	16'-9"	16'-0"	14'-11"	19'-0"	18'-7"	17'-9"	20'-8"	20'-4"	19'-3"	21'-7"	20'-9"	19'-8"
		50	10	15'-10"	15'-2"	14'-5"	18'-3"	18'-0"	17'-3"	19'-6"	19'-0"	18'-5"	19'-10"	19'-5"	18'-9"
50	15	15'-5"	15'-1"	14'-1"	17'-3"	16'-8"	15'-11"	17'-11"	17'-4"	16'-6"	18'-3"	17'-8"	16'-10"		
32" o.c.	Non-Snow 125%	20	10	18'-10"	17'-9"	16'-6"	22'-5"	21'-2"	19'-8"	25'-4"	24'-1"	22'-4"	27'-1"	26'-5"	24'-9"
		20	15	17'-10"	16'-9"	15'-5"	21'-2"	19'-11"	18'-5"	23'-4"	22'-8"	20'-11"	25'-0"	24'-3"	23'-2"
		20	20	17'-0"	15'-11"	14'-8"	20'-0"	18'-11"	17'-5"	21'-10"	21'-1"	19'-10"	23'-4"	22'-4"	20'-4"
	Snow 115%	25	10	17'-10"	16'-11"	15'-9"	20'-8"	20'-1"	18'-9"	22'-6"	22'-0"	21'-4"	24'-1"	23'-7"	22'-11"
		25	15	16'-11"	16'-0"	14'-10"	19'-3"	18'-9"	17'-8"	21'-0"	20'-5"	19'-2"	22'-2"	21'-0"	19'-6"
		30	10	17'-0"	16'-2"	15'-1"	19'-4"	18'-11"	18'-0"	21'-0"	20'-8"	20'-1"	22'-3"	21'-6"	20'-5"
		30	15	16'-0"	15'-5"	14'-4"	18'-2"	17'-8"	16'-7"	19'-4"	18'-5"	17'-3"	19'-8"	18'-9"	17'-7"
		40	10	15'-2"	14'-10"	14'-1"	16'-10"	16'-4"	15'-8"	17'-6"	17'-0"	16'-4"	17'-10"	17'-4"	16'-8"
		40	15	14'-6"	14'-0"	13'-3"	15'-2"	14'-7"	13'-10"	15'-10"	15'-2"	14'-5"	16'-1"	15'-6"	14'-8"
		50	10	13'-5"	13'-1"	12'-8"	14'-0"	13'-8"	13'-2"	14'-7"	14'-2"	13'-9"	14'-10"	14'-6"	14'-0"
50	15	12'-4"	11'-11"	11'-4"	12'-10"	12'-5"	11'-10"	13'-4"	12'-11"	12'-4"	13'-8"	13'-2"	12'-7"		



Maximum clear span in feet and inches, based on horizontal spans.

115% and 125% Load Duration


				BCI® 60 2.0 Series 2 ⁵ / ₁₆ " Flange Width								
				11 ⁷ / ₈ " BCI® 60 2.0			14" BCI® 60 2.0			16" BCI® 60 2.0		
				4/12 or Less	4/12 to 8/12	8/12 to 12/12	4/12 or Less	4/12 to 8/12	8/12 to 12/12	4/12 or Less	4/12 to 8/12	8/12 to 12/12
16" o.c.	Non-Snow 125%	20	10	30'-5"	28'-9"	26'-8"	34'-9"	32'-9"	30'-5"	38'-5"	36'-3"	33'-8"
		20	15	28'-10"	27'-1"	25'-0"	32'-10"	30'-10"	28'-6"	36'-5"	34'-2"	31'-7"
		20	20	27'-6"	25'-9"	23'-8"	31'-4"	29'-4"	27'-0"	34'-9"	32'-6"	29'-11"
	Snow 115%	25	10	28'-11"	27'-4"	25'-5"	32'-11"	31'-2"	29'-0"	36'-6"	34'-6"	32'-1"
		25	15	27'-7"	26'-0"	24'-1"	31'-5"	29'-7"	27'-5"	34'-10"	32'-9"	30'-4"
		30	10	27'-8"	26'-2"	24'-5"	31'-6"	29'-10"	27'-10"	34'-11"	33'-0"	30'-10"
		30	15	26'-6"	25'-0"	23'-3"	30'-2"	28'-6"	26'-6"	33'-5"	31'-7"	29'-4"
		40	10	25'-2"	24'-1"	22'-9"	28'-8"	27'-6"	26'-0"	31'-9"	30'-5"	28'-9"
		40	15	24'-9"	23'-5"	21'-10"	28'-3"	26'-8"	24'-11"	31'-3"	29'-7"	27'-7"
		50	10	23'-3"	22'-4"	21'-2"	26'-6"	25'-5"	24'-2"	29'-5"	28'-2"	26'-9"
50	15	23'-3"	22'-2"	20'-9"	26'-6"	25'-3"	23'-8"	28'-7"	27'-8"	26'-2"		
19.2" o.c.	Non-Snow 125%	20	10	28'-7"	27'-0"	25'-1"	32'-7"	30'-9"	28'-7"	36'-1"	34'-1"	31'-7"
		20	15	27'-1"	25'-5"	23'-6"	30'-10"	29'-0"	26'-9"	34'-2"	32'-1"	29'-8"
		20	20	25'-10"	24'-2"	22'-3"	29'-5"	27'-7"	25'-4"	32'-7"	30'-6"	28'-1"
	Snow 115%	25	10	27'-2"	25'-8"	23'-11"	30'-11"	29'-3"	27'-3"	34'-3"	32'-5"	30'-2"
		25	15	25'-11"	24'-5"	22'-7"	29'-6"	27'-10"	25'-9"	32'-8"	30'-9"	28'-6"
		30	10	25'-11"	24'-7"	22'-11"	29'-7"	28'-0"	26'-2"	32'-9"	31'-0"	29'-0"
		30	15	24'-11"	23'-6"	21'-10"	28'-4"	26'-9"	24'-10"	31'-5"	29'-8"	27'-6"
		40	10	23'-7"	22'-8"	21'-5"	26'-11"	25'-10"	24'-5"	29'-10"	28'-7"	27'-0"
		40	15	23'-3"	22'-0"	20'-6"	26'-6"	25'-1"	23'-5"	28'-1"	27'-0"	25'-7"
		50	10	21'-10"	21'-0"	19'-11"	24'-11"	23'-11"	22'-8"	25'-10"	25'-3"	24'-5"
50	15	21'-10"	20'-10"	19'-6"	23'-9"	23'-0"	21'-11"	23'-9"	23'-0"	21'-11"		
24" o.c.	Non-Snow 125%	20	10	26'-6"	25'-0"	23'-3"	30'-2"	28'-6"	26'-6"	33'-5"	31'-7"	29'-4"
		20	15	25'-1"	23'-7"	21'-9"	28'-7"	26'-10"	24'-10"	31'-8"	29'-9"	27'-6"
		20	20	23'-11"	22'-5"	20'-7"	27'-3"	25'-6"	23'-6"	30'-2"	28'-3"	26'-0"
	Snow 115%	25	10	25'-2"	23'-9"	22'-2"	28'-8"	27'-1"	25'-3"	31'-9"	30'-0"	28'-0"
		25	15	24'-0"	22'-7"	20'-11"	27'-4"	25'-9"	23'-10"	30'-3"	28'-6"	26'-5"
		30	10	24'-0"	22'-9"	21'-3"	27'-5"	25'-11"	24'-3"	30'-4"	28'-9"	26'-10"
		30	15	23'-0"	21'-9"	20'-2"	26'-3"	24'-9"	23'-0"	27'-4"	26'-1"	24'-5"
		40	10	21'-10"	21'-0"	19'-10"	24'-9"	23'-11"	22'-7"	24'-9"	24'-1"	23'-1"
		40	15	21'-6"	20'-4"	19'-0"	22'-5"	21'-6"	20'-5"	22'-5"	21'-6"	20'-5"
		50	10	20'-2"	19'-5"	18'-5"	20'-8"	20'-2"	19'-6"	20'-8"	20'-2"	19'-6"
50	15	19'-0"	18'-4"	17'-6"	19'-0"	18'-4"	17'-6"	19'-0"	18'-4"	17'-6"		
32" o.c.	Non-Snow 125%	20	10	24'-0"	22'-8"	21'-0"	27'-4"	25'-10"	24'-0"	30'-3"	28'-7"	26'-7"
		20	15	22'-8"	21'-4"	19'-8"	25'-10"	24'-4"	22'-6"	28'-6"	26'-10"	24'-9"
		20	20	21'-8"	20'-3"	18'-8"	24'-8"	23'-1"	21'-1"	24'-10"	23'-2"	21'-1"
	Snow 115%	25	10	22'-9"	21'-6"	20'-1"	25'-11"	24'-7"	22'-10"	26'-5"	25'-4"	24'-0"
		25	15	21'-8"	20'-5"	18'-11"	23'-0"	21'-9"	20'-3"	23'-0"	21'-9"	20'-3"
		30	10	21'-9"	20'-7"	19'-3"	23'-2"	22'-4"	21'-3"	23'-2"	22'-4"	21'-3"
		30	15	20'-5"	19'-6"	18'-3"	20'-5"	19'-6"	18'-3"	20'-5"	19'-6"	18'-3"
		40	10	18'-6"	18'-0"	17'-3"	18'-6"	18'-0"	17'-3"	18'-6"	18'-0"	17'-3"
		40	15	16'-9"	16'-1"	15'-3"	16'-9"	16'-1"	15'-3"	16'-9"	16'-1"	15'-3"
		50	10	15'-5"	15'-0"	14'-6"	15'-5"	15'-0"	14'-6"	15'-5"	15'-0"	14'-6"
50	15	14'-2"	13'-8"	13'-1"	14'-2"	13'-8"	13'-1"	14'-2"	13'-8"	13'-1"		

- Tables are intended to be used for preliminary sizing of roof members only and not for final sizing. Tables are based on a uniformly loaded roof due to roof live or snow loads and dead load. Wind loading, unbalanced snow loading, snow drifting, sliding and surcharges, and roof-top mechanical units are NOT considered in the tables. The determination of such roof design loads is the responsibility of the project's design professional of record.
- Table values are limited by shear, moment, total load deflection equal to L/180 and live load deflection equal to L/240. Check the local building code for other deflection limits that may apply.
- Table values represent the most restrictive of simple or multiple span applications.
- Table values assume minimum bearing lengths without web stiffeners for joist depths of 16 inches and less. 18 and 20 inch joists require web stiffeners.
- This table was designed to apply to a broad range of applications. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc® software.
- Slope roof joists at least 1/4" over 12" to minimize ponding.
- Allowable spans and loads shall be adjusted and checked for wind load as required by local building code.

Maximum clear span in feet and inches, based on horizontal spans.

115% and 125% Load Duration

			BCI® 90 2.0 Series 3½" Flange Width															
			11⅝" BCI® 90 2.0			14" BCI® 90 2.0			16" BCI® 90 2.0			18" BCI® 90 2.0			20" BCI® 90 2.0			
			4/12 or Less	4/12 to 8/12	8/12 to 12/12	4/12 or Less	4/12 to 8/12	8/12 to 12/12	4/12 or Less	4/12 to 8/12	8/12 to 12/12	4/12 or Less	4/12 to 8/12	8/12 to 12/12	4/12 or Less	4/12 to 8/12	8/12 to 12/12	
16" o.c.	Non-Snow 125%	20	10	34'-10"	32'-10"	30'-6"	39'-6"	37'-4"	34'-7"	43'-9"	41'-4"	38'-4"	47'-10"	45'-2"	41'-11"	50'-0"	48'-10"	45'-4"
		20	15	33'-0"	31'-0"	28'-7"	37'-5"	35'-2"	32'-6"	41'-5"	38'-11"	36'-0"	45'-4"	42'-7"	39'-4"	49'-0"	46'-1"	42'-6"
		20	20	31'-6"	29'-6"	27'-1"	35'-8"	33'-5"	30'-9"	39'-7"	37'-0"	34'-1"	43'-3"	40'-6"	37'-3"	46'-9"	43'-10"	40'-3"
	Snow 115%	25	10	33'-1"	31'-3"	29'-1"	37'-6"	35'-6"	33'-1"	41'-7"	39'-4"	36'-7"	45'-5"	42'-11"	40'-0"	49'-2"	46'-6"	43'-3"
		25	15	31'-6"	29'-8"	27'-6"	35'-9"	33'-8"	31'-3"	39'-8"	37'-4"	34'-7"	43'-4"	40'-10"	37'-9"	46'-10"	44'-2"	40'-11"
		30	10	31'-7"	29'-11"	27'-11"	35'-10"	34'-0"	31'-9"	39'-9"	37'-8"	35'-2"	43'-5"	41'-2"	38'-5"	47'-0"	44'-6"	41'-6"
		30	15	30'-4"	28'-7"	26'-7"	34'-5"	32'-5"	30'-2"	38'-1"	35'-11"	33'-5"	41'-7"	39'-3"	36'-6"	45'-0"	42'-6"	39'-6"
		40	10	28'-9"	27'-7"	26'-1"	32'-7"	31'-4"	29'-7"	36'-2"	34'-8"	32'-9"	39'-6"	37'-11"	35'-10"	42'-9"	41'-0"	38'-9"
		40	15	28'-4"	26'-9"	25'-0"	32'-1"	30'-5"	28'-4"	35'-7"	33'-8"	31'-5"	38'-10"	36'-10"	34'-4"	42'-1"	39'-10"	37'-2"
		50	10	26'-7"	25'-6"	24'-3"	30'-2"	29'-0"	27'-6"	33'-5"	32'-1"	30'-6"	36'-7"	35'-1"	33'-4"	39'-7"	38'-0"	36'-1"
		50	15	26'-7"	25'-4"	23'-9"	30'-2"	28'-9"	26'-11"	33'-5"	31'-11"	29'-10"	36'-7"	34'-10"	32'-7"	39'-7"	37'-8"	35'-3"
19.2" o.c.	Non-Snow 125%	20	10	32'-9"	30'-11"	28'-8"	37'-2"	35'-0"	32'-6"	41'-2"	38'-10"	36'-0"	44'-11"	42'-5"	39'-4"	48'-8"	45'-11"	42'-7"
		20	15	31'-0"	29'-1"	26'-11"	35'-2"	33'-0"	30'-6"	38'-11"	36'-7"	33'-9"	42'-7"	40'-0"	36'-11"	46'-0"	43'-3"	39'-11"
		20	20	29'-6"	27'-8"	25'-5"	33'-6"	31'-5"	28'-11"	37'-2"	34'-9"	32'-0"	40'-7"	38'-0"	35'-0"	43'-11"	41'-2"	37'-10"
	Snow 115%	25	10	31'-1"	29'-5"	27'-4"	35'-3"	33'-4"	31'-1"	39'-0"	36'-11"	34'-5"	42'-8"	40'-4"	37'-7"	46'-2"	43'-8"	40'-8"
		25	15	29'-7"	27'-11"	25'-10"	33'-7"	31'-8"	29'-4"	37'-3"	35'-1"	32'-6"	40'-8"	38'-4"	35'-6"	44'-0"	41'-6"	38'-5"
		30	10	29'-8"	28'-1"	26'-3"	33'-8"	31'-11"	29'-10"	37'-4"	35'-4"	33'-0"	40'-9"	38'-8"	36'-1"	44'-1"	41'-10"	39'-0"
		30	15	28'-5"	26'-10"	24'-11"	32'-3"	30'-6"	28'-4"	35'-9"	33'-9"	31'-4"	39'-1"	36'-11"	34'-3"	42'-3"	39'-11"	37'-1"
		40	10	27'-0"	25'-11"	24'-6"	30'-7"	29'-5"	27'-9"	33'-11"	32'-7"	30'-9"	37'-1"	35'-7"	33'-7"	40'-1"	38'-6"	36'-5"
		40	15	26'-7"	25'-2"	23'-5"	30'-2"	28'-7"	26'-7"	33'-5"	31'-7"	29'-6"	36'-6"	34'-7"	32'-3"	39'-6"	37'-5"	34'-11"
		50	10	24'-11"	24'-0"	22'-9"	28'-4"	27'-2"	25'-10"	31'-5"	30'-2"	28'-8"	34'-4"	32'-11"	31'-4"	37'-1"	35'-8"	33'-10"
		50	15	24'-11"	23'-10"	22'-3"	28'-4"	27'-0"	25'-3"	29'-8"	28'-8"	27'-5"	34'-4"	32'-8"	30'-7"	37'-1"	35'-5"	33'-1"
24" o.c.	Non-Snow 125%	20	10	30'-4"	28'-7"	26'-7"	34'-5"	32'-5"	30'-2"	38'-1"	35'-11"	33'-5"	41'-7"	39'-3"	36'-6"	45'-0"	42'-6"	39'-6"
		20	15	28'-8"	26'-11"	24'-11"	32'-6"	30'-7"	28'-3"	36'-1"	33'-11"	31'-4"	39'-5"	37'-0"	34'-2"	42'-8"	40'-1"	37'-0"
		20	20	27'-4"	25'-7"	23'-7"	31'-0"	29'-1"	26'-9"	34'-4"	32'-2"	29'-8"	37'-7"	35'-2"	32'-5"	40'-8"	38'-1"	35'-1"
	Snow 115%	25	10	28'-9"	27'-2"	25'-4"	32'-7"	30'-10"	28'-9"	36'-2"	34'-2"	31'-10"	39'-6"	37'-4"	34'-10"	42'-9"	40'-5"	37'-8"
		25	15	27'-5"	25'-10"	23'-11"	31'-1"	29'-4"	27'-2"	34'-5"	32'-6"	30'-1"	37'-8"	35'-6"	32'-11"	40'-9"	38'-5"	35'-7"
		30	10	27'-6"	26'-0"	24'-4"	31'-2"	29'-7"	27'-7"	34'-6"	32'-9"	30'-7"	37'-9"	35'-9"	33'-5"	40'-10"	38'-9"	36'-2"
		30	15	26'-4"	24'-10"	23'-1"	29'-10"	28'-2"	26'-3"	33'-1"	31'-3"	29'-1"	36'-2"	34'-2"	31'-9"	39'-2"	37'-0"	34'-4"
		40	10	24'-11"	24'-0"	22'-8"	28'-4"	27'-2"	25'-9"	30'-11"	30'-0"	28'-6"	34'-4"	32'-11"	31'-2"	37'-1"	35'-8"	33'-8"
		40	15	24'-7"	23'-3"	21'-9"	27'-9"	26'-5"	24'-8"	28'-0"	26'-11"	25'-6"	33'-9"	32'-0"	29'-10"	35'-2"	33'-10"	32'-1"
		50	10	23'-1"	22'-2"	21'-1"	25'-7"	24'-11"	23'-11"	25'-9"	25'-2"	24'-4"	31'-3"	30'-6"	29'-0"	32'-5"	31'-8"	30'-7"
		50	15	23'-1"	22'-0"	20'-7"	23'-6"	22'-9"	21'-8"	23'-8"	22'-11"	21'-10"	28'-9"	27'-10"	26'-7"	29'-10"	28'-10"	27'-6"
32" o.c.	Non-Snow 125%	20	10	27'-5"	25'-11"	24'-1"	31'-1"	29'-5"	27'-4"	34'-6"	32'-7"	30'-3"	37'-8"	35'-7"	33'-1"	40'-9"	38'-6"	35'-9"
		20	15	25'-11"	24'-5"	22'-6"	29'-5"	27'-8"	25'-7"	32'-7"	30'-8"	28'-4"	35'-8"	33'-6"	31'-0"	38'-7"	36'-3"	33'-6"
		20	20	24'-9"	23'-2"	21'-4"	28'-1"	26'-4"	24'-3"	31'-0"	28'-11"	26'-4"	34'-0"	31'-10"	29'-4"	36'-9"	34'-6"	31'-9"
	Snow 115%	25	10	26'-0"	24'-7"	22'-11"	29'-6"	27'-11"	26'-1"	32'-8"	30'-11"	28'-10"	35'-9"	33'-10"	31'-6"	38'-8"	36'-7"	34'-2"
		25	15	24'-9"	23'-4"	21'-8"	28'-1"	26'-6"	24'-7"	28'-8"	27'-2"	25'-4"	34'-1"	32'-1"	29'-9"	36'-1"	34'-3"	31'-10"
		30	10	24'-10"	23'-7"	22'-0"	28'-2"	26'-9"	25'-0"	28'-11"	27'-10"	26'-6"	34'-2"	32'-5"	30'-3"	36'-4"	35'-0"	32'-9"
		30	15	23'-9"	22'-6"	20'-11"	25'-4"	24'-2"	22'-8"	25'-6"	24'-4"	22'-10"	31'-0"	29'-7"	27'-8"	32'-1"	30'-8"	28'-8"
		40	10	22'-7"	21'-8"	20'-6"	22'-11"	22'-3"	21'-5"	23'-1"	22'-5"	21'-7"	28'-1"	27'-3"	26'-2"	29'-1"	28'-3"	27'-2"
		40	15	20'-7"	19'-10"	18'-9"	20'-9"	19'-11"	18'-11"	20'-11"	20'-1"	19'-1"	25'-5"	24'-5"	23'-2"	26'-4"	25'-4"	24'-0"
		50	10	19'-0"	18'-6"	17'-11"	19'-1"	18'-8"	18'-0"	19'-3"	18'-10"	18'-2"	23'-5"	22'-10"	22'-1"	24'-3"	23'-8"	22'-10"
		50	15	17'-5"	16'-10"	16'-1"	17'-7"	17'-0"	16'-3"	17'-8"	17'-1"	16'-4"	21'-6"	20'-9"	19'-10"	22'-3"	21'-7"	20'-7"

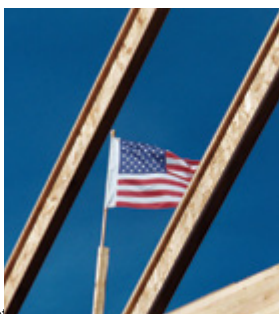

Allowable Uniform Roof Load (in pounds per lineal foot [PLF])

115% and 125% Load Duration

Use of these tables should be limited to roof slopes of 3½" per foot or less.
For steeper slopes, see pages 24-27.

Span Length	BCI® 5000 1.7 Series 2" Flange Width											
	9½" BCI® 5000 1.7			11⅝" BCI® 5000 1.7			14" BCI® 5000 1.7			16" BCI® 5000 1.7		
	Total Load		Deflect.	Total Load		Deflect.	Total Load		Deflect.	Total Load		Deflect.
	Snow (115%)	Non-Snow (125%)	L/240	Snow (115%)	Non-Snow (125%)	L/240	Snow (115%)	Non-Snow (125%)	L/240	Snow (115%)	Non-Snow (125%)	L/240
6	315	343	-	338	367	-	353	383	-	356	387	-
7	270	294	-	289	315	-	302	329	-	305	332	-
8	236	257	-	253	275	-	264	287	-	267	290	-
9	210	228	-	225	245	-	235	255	-	237	258	-
10	189	205	-	202	220	-	211	230	-	214	232	-
11	172	187	-	184	200	-	192	209	-	194	211	-
12	154	167	-	169	183	-	176	191	-	178	193	-
13	131	142	-	156	169	-	162	177	-	164	179	-
14	113	123	110	144	157	-	151	164	-	152	166	-
15	98	107	90	126	137	-	141	153	-	142	155	-
16	86	94	75	110	120	-	131	142	-	133	145	-
17	76	82	63	98	106	-	116	126	-	125	136	-
18	68	70	53	87	95	-	103	112	-	118	128	-
19	59	59	45	78	85	74	93	101	-	106	115	-
20	51	51	39	71	77	64	84	91	-	96	104	-
21				64	70	55	76	83	-	87	94	-
22				58	63	48	69	75	-	79	86	-
23				53	55	42	63	69	62	72	78	-
24							58	63	55	66	72	-
25							53	58	49	61	66	-
26										56	61	-
27										52	57	-
28												

- Tables are intended to be used for preliminary sizing of roof members only and not for final sizing. Tables are based on a uniformly loaded roof due to roof live or snow loads and dead load. Wind loading, unbalanced snow loading, snow drifting, sliding and surcharges, and roof-top mechanical units are NOT considered in the tables. The determination of such roof design loads is the responsibility of the project's design professional of record.
- Total Load values are limited by shear, moment, or deflection equal to L/180.
- Deflection values (Deflect.) are limited by live load deflection equal to L/240. Check the local building code for other deflection limits that may apply.
- Both the Total Load and Deflection columns must be checked. Where a Deflection value is not shown, the Total Load value will control.

- Table values apply to either simple or multiple span joists. Span is measured center to center of the minimum required bearing length. Analyze multiple span joists with the BC Calc® software if the length of any span is less than half the length of an adjacent span.
- Slope roof joists at least ¼ inch over 12 inches to minimize ponding.
- Table values assume minimum bearing lengths without web stiffeners for joist depths of 16 inches and less. 18 and 20 inch joists require web stiffeners.
- This table was designed to apply to a broad range of applications. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc® software.
- Allowable spans and loads shall be adjusted and checked for wind load as required by local building code.

Allowable Uniform Roof Load (in pounds per lineal foot [PLF])

115% and 125% Load Duration

Use of these tables should be limited to roof slopes of 3½" per foot or less.
For steeper slopes, see pages 24-27.

Span Length	BCI® 6000 1.8 Series 2 ⁵ / ₁₆ " Flange Width											
	9½" BCI® 6000 1.8			11⅞" BCI® 6000 1.8			14" BCI® 6000 1.8			16" BCI® 6000 1.8		
	Total Load		Deflect.	Total Load		Deflect.	Total Load		Deflect.	Total Load		Deflect.
	Snow (115%)	Non-Snow (125%)	L/240	Snow (115%)	Non-Snow (125%)	L/240	Snow (115%)	Non-Snow (125%)	L/240	Snow (115%)	Non-Snow (125%)	L/240
6	360	392	-	375	408	-	390	424	-	398	432	-
7	309	336	-	322	350	-	334	364	-	341	371	-
8	270	294	-	281	306	-	293	318	-	298	324	-
9	240	261	-	250	272	-	260	283	-	265	288	-
10	216	235	-	225	245	-	234	254	-	238	259	-
11	196	213	-	204	222	-	213	231	-	217	236	-
12	180	196	-	187	204	-	195	212	-	199	216	-
13	166	180	159	173	188	-	180	196	-	183	199	-
14	145	158	129	161	175	-	167	182	-	170	185	-
15	126	137	106	150	163	-	156	169	-	159	173	-
16	111	115	88	140	153	-	146	159	-	149	162	-
17	97	97	74	126	137	122	137	149	-	140	152	-
18	82	82	63	112	122	103	130	141	-	132	144	-
19	70	70	53	101	110	89	120	130	-	125	136	-
20	60	60	46	91	99	76	108	117	-	119	129	-
21	52	52	40	83	87	66	98	107	97	112	122	-
22				75	76	58	89	97	85	102	111	-
23				67	67	51	82	89	75	93	101	-
24				59	59	45	75	81	66	86	93	-
25				52	52	40	69	75	58	79	86	78
26							64	68	52	73	79	70
27							59	61	47	67	73	63
28							55	55	42	63	68	56



Allowable Uniform Roof Load

(in pounds per lineal foot [PLF])

115% and 125% Load Duration

Use of these tables should be limited to roof slopes of 3½" per foot or less.
For steeper slopes, see pages 24-27.

Span Length	BCI® 6500 1.8 Series 2 ⁹ / ₁₆ " Flange Width											
	9½" BCI® 6500 1.8			11 ⁷ / ₈ " BCI® 6500 1.8			14" BCI® 6500 1.8			16" BCI® 6500 1.8		
	Total Load		Deflect.	Total Load		Deflect.	Total Load		Deflect.	Total Load		Deflect.
	Snow (115%)	Non-Snow (125%)	L/240	Snow (115%)	Non-Snow (125%)	L/240	Snow (115%)	Non-Snow (125%)	L/240	Snow (115%)	Non-Snow (125%)	L/240
6	360	392	-	375	408	-	390	424	-	398	432	-
7	309	336	-	322	350	-	334	364	-	341	371	-
8	270	294	-	281	306	-	293	318	-	298	324	-
9	240	261	-	250	272	-	260	283	-	265	288	-
10	216	235	-	225	245	-	234	254	-	238	259	-
11	196	213	-	204	222	-	213	231	-	217	236	-
12	180	196	-	187	204	-	195	212	-	199	216	-
13	166	180	-	173	188	-	180	196	-	183	199	-
14	154	168	141	161	175	-	167	182	-	170	185	-
15	140	152	116	150	163	-	156	169	-	159	173	-
16	123	126	97	140	153	-	146	159	-	149	162	-
17	106	106	81	132	144	-	137	149	-	140	152	-
18	90	90	69	125	135	114	130	141	-	132	144	-
19	77	77	59	112	122	97	123	134	-	125	136	-
20	66	66	51	101	110	84	117	127	-	119	129	-
21	57	57	44	91	95	73	108	118	106	113	123	-
22	50	50	38	83	83	64	99	107	92	108	118	-
23				73	73	56	90	98	81	103	112	-
24				64	64	49	83	90	72	95	103	-
25				57	57	44	76	83	64	87	95	85
26				51	51	39	71	74	57	81	88	76
27							65	67	51	75	81	68
28							60	60	46	69	76	61
29							54	54	41	65	70	55
30										60	66	50
31										57	60	45
32										53	54	41
33										50	50	38
34												
35												

- Tables are intended to be used for preliminary sizing of roof members only and not for final sizing. Tables are based on a uniformly loaded roof due to roof live or snow loads and dead load. Wind loading, unbalanced snow loading, snow drifting, sliding and surcharges, and roof-top mechanical units are NOT considered in the tables. The determination of such roof design loads is the responsibility of the project's design professional of record.
- Total Load values are limited by shear, moment, or deflection equal to L/180.
- Deflection values (Deflect.) are limited by live load deflection equal to L/240. Check the local building code for other deflection limits that may apply.
- Both the Total Load and Deflection columns must be checked. Where a Deflection value is not shown, the Total Load value will control.

- Table values apply to either simple or multiple span joists. Span is measured center to center of the minimum required bearing length. Analyze multiple span joists with the BC Calc® software if the length of any span is less than half the length of an adjacent span.
- Slope roof joists at least ¼ inch over 12 inches to minimize ponding.
- Table values assume minimum bearing lengths without web stiffeners for joist depths of 16 inches and less. 18 and 20 inch joists require web stiffeners.
- This table was designed to apply to a broad range of applications. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc® software.
- Allowable spans and loads shall be adjusted and checked for wind load as required by local building code.

Allowable Uniform Roof Load (in pounds per lineal foot [PLF])

115% and 125% Load Duration

Use of these tables should be limited to roof slopes of 3½" per foot or less.
For steeper slopes, see pages 24-27.

Span Length	BCI® 60 2.0 Series 2 ⁵ / ₁₆ " Flange Width								
	11 ⁷ / ₈ " BCI® 60 2.0			14" BCI® 60 2.0			16" BCI® 60 2.0		
	Total Load		Deflect.	Total Load		Deflect.	Total Load		Deflect.
	Snow (115%)	Non-Snow (125%)	L/240	Snow (115%)	Non-Snow (125%)	L/240	Snow (115%)	Non-Snow (125%)	L/240
6	413	449	-	413	449	-	413	449	-
7	354	385	-	354	385	-	354	385	-
8	309	336	-	309	336	-	309	336	-
9	275	299	-	275	299	-	275	299	-
10	247	269	-	247	269	-	247	269	-
11	225	245	-	225	245	-	225	245	-
12	206	224	-	206	224	-	206	224	-
13	190	207	-	190	207	-	190	207	-
14	177	192	-	177	192	-	177	192	-
15	165	179	-	165	179	-	165	179	-
16	154	168	-	154	168	-	154	168	-
17	145	158	-	145	158	-	145	158	-
18	137	149	-	137	149	-	137	149	-
19	130	141	118	130	141	-	130	141	-
20	123	133	102	123	134	-	123	134	-
21	116	116	88	118	128	-	118	128	-
22	101	101	77	112	122	-	112	122	-
23	89	89	68	107	117	99	107	117	-
24	79	79	60	103	112	88	103	112	-
25	70	70	53	99	102	78	99	107	-
26	62	62	47	91	91	69	95	103	93
27	56	56	42	81	81	62	91	99	84
28	50	50	38	73	73	56	88	96	75
29				66	66	50	85	89	68
30				60	60	46	81	81	61
31				54	54	41	73	73	56
32							67	67	51
33							61	61	46
34							56	56	43
35							51	51	39



Allowable Uniform Roof Load

(in pounds per lineal foot [PLF])

115% and 125% Load Duration

Use of these tables should be limited to roof slopes of 3½" per foot or less.
For steeper slopes, see pages 24-27.

Span Length	BCI® 90 2.0 Series 3½" Flange Width														
	117/8" BCI® 90 2.0			14" BCI® 90 2.0			16" BCI® 90 2.0			18" BCI® 90 2.0			20" BCI® 90 2.0		
	Total Load		Deflect.	Total Load		Deflect.	Total Load		Deflect.	Total Load		Deflect.	Total Load		Deflect.
	Snow (115%)	Non-Snow (125%)	L/240	Snow (115%)	Non-Snow (125%)	L/240	Snow (115%)	Non-Snow (125%)	L/240	Snow (115%)	Non-Snow (125%)	L/240	Snow (115%)	Non-Snow (125%)	L/240
6	507	551	-	510	555	-	514	559	-	623	677	-	646	702	-
7	434	472	-	437	476	-	441	479	-	534	581	-	553	602	-
8	380	413	-	383	416	-	385	419	-	467	508	-	484	526	-
9	338	367	-	340	370	-	343	372	-	415	451	-	430	468	-
10	304	330	-	306	333	-	308	335	-	374	406	-	387	421	-
11	276	300	-	278	302	-	280	305	-	340	369	-	352	383	-
12	253	275	-	255	277	-	257	279	-	311	338	-	323	351	-
13	234	254	-	235	256	-	237	258	-	287	312	-	298	324	-
14	217	236	-	218	238	-	220	239	-	267	290	-	276	301	-
15	202	220	-	204	222	-	205	223	-	249	271	-	258	280	-
16	190	206	-	191	208	-	192	209	-	233	254	-	242	263	-
17	178	194	-	180	196	-	181	197	-	220	239	-	228	247	-
18	169	183	-	170	185	-	171	186	-	207	225	-	215	234	-
19	160	174	-	161	175	-	162	176	-	196	214	-	204	221	-
20	152	165	148	153	166	-	154	167	-	187	203	-	193	210	-
21	144	157	129	145	158	-	147	159	-	178	193	-	184	200	-
22	138	148	113	139	151	-	140	152	-	170	184	-	176	191	-
23	130	130	100	133	144	-	134	145	-	162	176	-	168	183	-
24	115	115	88	127	138	126	128	139	-	155	169	-	161	175	-
25	103	103	78	122	133	112	123	134	-	149	162	-	155	168	-
26	92	92	70	117	128	100	118	129	-	143	156	-	149	162	-
27	82	82	63	113	118	90	114	124	-	138	150	-	143	156	-
28	74	74	56	106	106	81	110	119	109	133	145	-	138	150	-
29	67	67	51	96	96	73	106	115	98	129	140	127	133	145	-
30	60	60	46	87	87	67	102	111	89	124	135	115	129	140	-
31	55	55	42	79	79	60	99	106	81	120	131	105	125	135	-
32	50	50	38	72	72	55	96	97	74	116	125	96	121	131	120
33				66	66	50	89	89	68	113	114	88	117	127	110
34				60	60	46	81	81	62	105	105	80	114	123	101

- Tables are intended to be used for preliminary sizing of roof members only and not for final sizing. Tables are based on a uniformly loaded roof due to roof live or snow loads and dead load. Wind loading, unbalanced snow loading, snow drifting, sliding and surcharges, and roof-top mechanical units are NOT considered in the tables. The determination of such roof design loads is the responsibility of the project's design professional of record.
- Total Load values are limited by shear, moment, or deflection equal to L/180.
- Deflection values (Deflect.) are limited by live load deflection equal to L/240. Check the local building code for other deflection limits that may apply.
- Both the Total Load and Deflection columns must be checked. Where a Deflection value is not shown, the Total Load value will control.

- Table values apply to either simple or multiple span joists. Span is measured center to center of the minimum required bearing length. Analyze multiple span joists with the BC Calc® software if the length of any span is less than half the length of an adjacent span.
- Slope roof joists at least ¼ inch over 12 inches to minimize ponding.
- Table values assume minimum bearing lengths without web stiffeners for joist depths of 16 inches and less. 18 and 20 inch joists require web stiffeners.
- This table was designed to apply to a broad range of applications. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc® software.
- Allowable spans and loads shall be adjusted and checked for wind load as required by local building code.

BCI® Joist Series	Depth [inches]	Weight [plf]	Moment [ft-lbs]	EI x 10 ⁶ [lb-in ²]	K x 10 ⁶ [lbs]	Shear [lbs]	End Reaction [lbs]				Intermediate Reaction [lbs]			
							1½" Bearing ⁽¹⁾		3½" Bearing		3½" Bearing		5¼" Bearing	
							No WS ⁽²⁾	WS ⁽³⁾	No WS ⁽²⁾	WS ⁽³⁾	No WS ⁽²⁾	WS ⁽³⁾	No WS ⁽²⁾	WS ⁽³⁾
5000 1.7	9½	2.0	2460	160	5.0	1475	950	1125	1125	1275	2100	2350	2525	2750
	11⅞	2.3	3150	265	6.0	1625	950	1425	1425	1475	2250	2850	2525	3000
	14	2.5	3735	390	8.0	1825	950	1525	1475	1725	2350	3050	2525	3200
	16	2.7	4260	530	9.0	1975	950	1625	1500	1975	2400	3200	2525	3350
6000 1.8	9½	2.2	3165	190	5.0	1575	1175	1375	1375	1425	2400	2650	2700	2750
	11⅞	2.5	4060	320	6.0	1675	1175	1425	1425	1475	2500	2850	2900	3000
	14	2.7	4815	470	8.0	1925	1175	1525	1525	1725	2600	3150	2925	3200
	16	2.9	5495	635	9.0	2175	1175	1625	1550	1975	2650	3350	2950	3350
6500 1.8	9½	2.3	3505	210	5.0	1575	1175	1375	1375	1425	2400	2650	2700	2750
	11⅞	2.6	4495	350	7.0	1675	1175	1425	1425	1475	2500	2850	2900	3000
	14	3.0	5330	515	8.0	1925	1175	1525	1525	1725	2600	3150	2925	3200
	16	3.2	6085	695	9.0	2175	1175	1625	1550	1975	2650	3350	2950	3350
60 2.0	11⅞	2.9	6235	430	7.0	1675	1175	1425	1425	1475	2750	2850	3200	3250
	14	3.1	7440	635	8.0	1925	1175	1525	1525	1725	2750	3450	3200	3650
	16	3.3	8520	860	9.0	2175	1175	1625	1550	1975	2750	3650	3200	3750
90 2.0	11⅞	3.9	9550	645	7.0	2150	1425	1850	1800	1950	3375	3700	4000	4300
	14	4.1	11390	940	8.0	2350	1450	1950	1850	2150	3400	3850	4100	4450
	16	4.4	13050	1275	9.0	2550	1475	2150	1900	2350	3425	4000	4200	4650
	18	4.6	14690	1660	10.0	2750	N/A ⁽³⁾	2300	N/A ⁽³⁾	2550	N/A ⁽³⁾	4150	N/A ⁽³⁾	4750
	20	4.8	16310	2100	11.0	2850	N/A ⁽³⁾	2500	N/A ⁽³⁾	2650	N/A ⁽³⁾	4300	N/A ⁽³⁾	4850

NOTES:

- (1) No web stiffeners required.
 - (2) Web stiffeners required.
 - (3) Not applicable, web stiffeners required.
- Moment, shear and reactions values based upon a load duration of 100% and may be adjusted for other load durations.
 - Design values listed are applicable for Allowable Stress Design (ASD).
 - No additional repetitive member increased allowed.

BUILDING CODE EVALUATION REPORT

- ICC ESR 1336 (IBC, IRC)


$$\Delta = \frac{5wl^4}{384EI} + \frac{wl^2}{K}$$

- Δ = deflection [in]
 w = uniform load [lb/in]
 l = clear span [in]
 EI = bending stiffness [lb-in²]
 K = shear deformation coefficient [lb]

BCI® Closest Allowable Nail Spacing

Nailing Perpendicular to Glue Lines (Wide Face)

Nailing Parallel to Glue Lines (Narrow Face)



Nail Size	All BCI® Joists			
	Nailing Perpendicular to Glue Line (Wide Face)		Nailing Parallel to Glue Line (Narrow Face)	
	O.C. Spacing [inches]	End of Joist [inches]	O.C. Spacing [inches]	End of Joist [inches]
8d Box	2	1½	4	1½
8d Common	2	1½	4	3
10d & 12d Box	2	1½	4	3
16d Box	2	1½	4	3
10d & 12d Common	3	2	6	4
16d Sinker	3	2	6	4
16d Common	3	2	6	4

- If more than one row of nails is used, the rows must be offset at least ½ inch.
- Simpson Strong-Tie A35 connectors may be attached to the side of BCI® 60 & 90 joist flanges only. Use nails as specified by Simpson Strong-Tie; do not attach connectors on both sides of a flange at the same location.


BCI® Diaphragm Table ⁽¹⁾

BCI® Series	Diaphragm Capacity ⁽²⁾⁽³⁾ [lb/ft]	
	Unblocked	Blocked
5000	As permitted for 2x framing in building code	320 lb/ft for 6" o.c. nailing @ panel edges 425 lb/ft for 4" o.c. nailing, staggered, @ panel edges
6000, 6500	As permitted for 3x framing in building code	360 lb/ft for 6" o.c. nailing @ panel edges 480 lb/ft for 4" o.c. nailing, staggered @ panel edges
60, 90	As permitted for 3x framing in building code	As permitted for 3x framing in building code with nail spacing no closer than 3" o.c.

NOTES:

- (1) See table 6 of ICC ESR 1336.
- (2) BCI® joists may be substituted for solid sawn framing in horizontal wood diaphragms as shown in Table 2306.3.1 of the IBC.
- (3) Limits controlled by BCI® closest allowable nail spacing limits.

Boise Cascade Rimboard Product Profiles - Western Commercial

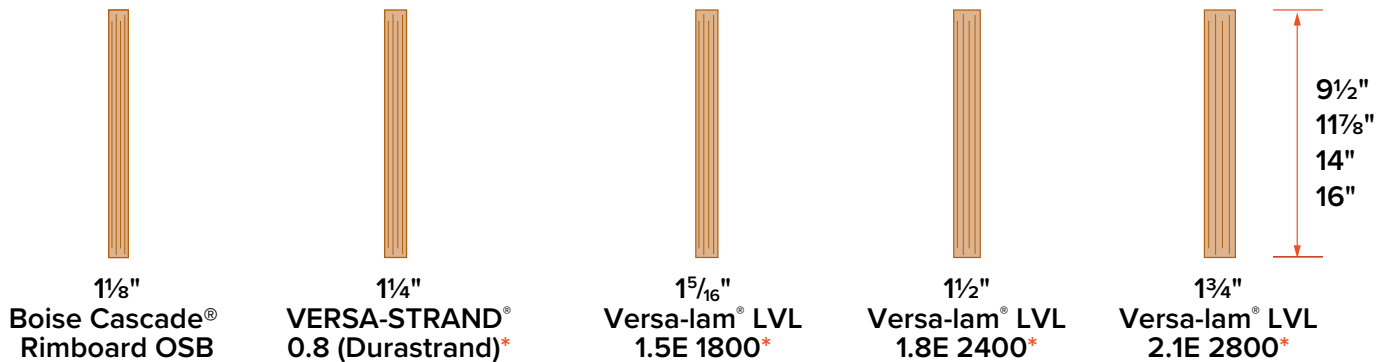

*18 inch and 20 inch deep rimboard are special order products, contact local supplier or Boise Cascade EWP representative for product availability.

F07 Perpendicular

See chart for vertical load capacity.

Min. 8d nails at 6" o.c. per IRC. Connection per design professional of record's specification for shear transfer.

F07A Parallel

See chart for vertical load capacity.

Min. 8d nails at 6" o.c. per IRC. Connection per design professional of record's specification for shear transfer.

F56

Exterior Wall Sheathing Max. 15/32" thickness.

BCI®/AJS® Joists Perpendicular or parallel to rim.

1/2" dia through bolts (ASTM A307 Grades A&B, SAE J429 Grades 1 or 2, or higher with washers and nuts) or 1/2" dia lag screws (full penetration), staggered.

Min. connection for 40/10 psf deck loading:

Deck Joist Length	Connection
12'-0" & less	2 rows 1/2" bolt or lag screw, 24" o.c. (300 plf max.)
12'-1" — 18'-0"	2 rows 1/2" bolt or lag screw, 16" o.c. (450 plf max.)

Notes:
For snow loads greater than 40 psf, and/or dead loads greater than 10 psf, size connection per max plf values shown above.

Treated Ledger -
Use only fasteners that are approved for use with corresponding wood treatment.

Boise Cascade® Rimboard.

Notes:

- Design of moisture control by others (only structural components shown above).
- For information on deck lateral load connections per IRC section R507.9.2, contact Boise Cascade EWP Engineering.
- For use of proprietary screws to attach ledger, consult screw manufacturer literature.
- For further information on residential deck design, see AWC DCA 6, *Prescriptive Residential Wood Deck Construction Guide*.

Boise Cascade Rimboard Properties

Product	Type	Vertical Load Capacity				Maximum Floor Diaphragm Lateral Capacity [lb/ft]	Specific Gravity Equivalency for Lateral Fastener Design	Allowable Design Values			
		Uniform [plf]		Point [lb]				Flexural Stress [lb/in ²]	Modulus of Elasticity [lb/in ²]	Horizontal Shear [lb/in ²]	Compression Perpendicular to Grain [lb/in ²]
		16" Depth & Less	18" & 20" Depth	16" Depth & Less	18" & 20" Depth						
1⅛" Boise Cascade® Rimboard OSB ⁽²⁾	OSB	4850	3200	3500	3500	200	0.5	Limited span capabilities, see note 2			
¼" Versa-Strand™ 0.8 (Dura-Strand) ⁽³⁾	OSB	5700	3500	5900	5500	240 w/ 8d nails @ 6" o.c. 330 w/ 8d nails @ 4" o.c.	— ⁽³⁾	1130	800,000	355	1415
1⅝" Versa-Lam® LVL 1.5E 1800 ⁽¹⁾	LVL	6000	5450	4450	4450	Permitted per building code for all nominal 2" thick framing blocked and unblocked diaphragms (4" nail spacing & greater)	0.5	1800	1,400,000	225	525
1½" Versa-Lam® LVL 1.8E 2400 ⁽¹⁾	LVL	4250	3700	3700	3500	Permitted per building code for all nominal 2" thick framing blocked and unblocked diaphragms (4" nail spacing & greater)	0.5	2400	1,700,000	285	750
1¾" Versa-Lam® LVL 2.1E 2800 ⁽¹⁾	LVL	5700	4300	4300	3900	Permitted per building code for all nominal 2" thick framing blocked and unblocked diaphragms (4" nail spacing & greater)	0.5	2800	2,000,000	285	750

Closest Allowable Nail Spacing - Narrow Face [in]	Product			
	1 1/8" Boise Cascade® Rimboard OSB ⁽²⁾	1/4" Versa-Strand™ 0.8 (Dura-Strand) ⁽³⁾	1 5/16" & 1 1/2" Versa-Lam® LVL ⁽¹⁾	1 3/4" Versa-Lam® LVL
8d Box (0.113"Ø x 2.5")	3	4	3	2
8d Common (0.131"Ø x 2.5")	3	4	3	3
10d & 12d Box (0.128"Ø x 3", 3.25")	See publication in note 2 for further nailing information.	4	3	3
16d Box (0.135"Ø x 3.5")		4	3	3
10d & 12d Common & 16d Sinker (0.148"Ø x 3", 3.25")		4	4	4
16d Common (0.162"Ø x 3.5")		6	6	6

Notes

- Per ICC ESR-1040.
 - See Performance Rated Rim Boards, APA EWS #W345J for further product information.
 - See ICC ESR-1053 for further product information.
- Not all products and depths may be available, check with Boise Cascade representative for product availability.

An Introduction to Versa-Lam® LVL Products



When you specify Versa-Lam® laminated veneer headers/beams, you are building quality into your design. They are excellent as floor and roof framing supports or as headers for doors, windows and garage doors and columns.

Because they have no camber, Versa-Lam® LVL products provide flatter, quieter floors, and consequently, the builder can expect happier customers with significantly fewer call backs.

Versa-Lam® LVL Beam Architectural Specifications

Scope: This work includes the complete furnishing and installation of all Versa-Lam® LVL beams as shown on the drawings, herein specified and necessary to complete the work.

Materials: Douglas Fir-Larch veneers, laminated in a press with all grain parallel with the length of the member. Glues used in lamination are phenol formaldehyde and isocyanate exterior-type adhesives which comply with ASTM D2559.

Design: Versa-Lam® LVL beams shall be sized and detailed to fit the dimensions and loads indicated on the plans. All designs shall be in accordance with allowable values developed in accordance with ASTM D5456 and listed in the governing code evaluation service's report and

section properties based upon standard engineering principles. Verification of design of the Versa-Lam® LVL beams by complete Calculations shall be available upon request.

Drawings: Additional drawings showing layout and detail necessary for determining fit and placement in the buildings are (are not) to be provided by the supplier.


Fabrication: Versa-Lam® LVL beams shall be manufactured in a plant evaluated for fabrication by the governing code evaluation service and under the supervision of a third-party inspection agency listed by the corresponding evaluation service.

Storage and Installation: Versa-Lam® LVL beams, if stored prior to erection, shall be stored on stickers spaced a maximum of 15 ft. apart. Beams shall be stored on a dry, level surface and protected from the weather. They shall be handled with care so they are not damaged.

Versa-Lam® LVL beams are to be installed in accordance with the plans and Boise Cascade EWP's Installation Guide. Temporary construction loads which cause stresses beyond design limits are not permitted. Erection bracing shall be provided to assure adequate lateral support for the individual beams and the entire system until the sheathing material has been applied.

Codes: Versa-Lam® LVL beams shall be evaluated by a model code evaluation service.

Allowable Holes in Versa-Lam® LVL Beams

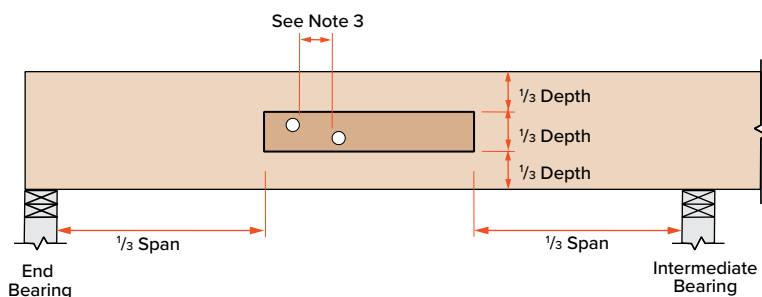


1. Square and rectangular holes are not permitted.
2. Round holes may be drilled or cut with a hole saw anywhere within the shaded area of the beam.
3. The horizontal distance between adjacent holes must be at least two times the size of the larger hole.
4. Do not drill more than three access holes in any four foot long section of beam.

5. The maximum round hole diameter permitted is:

Beam Depth	Max. Hole Diameter
5½"	¾"
7¼"	1"
9¼" and greater	2"


6. These limitations apply to holes drilled for plumbing or wiring access only. The size and location of holes drilled for fasteners are governed by the provisions of the *National Design Specification® for Wood Construction*.
7. Beams deflect under load. Size holes to provide clearance where required.
8. This hole chart is valid for beams supporting uniform load only. For beams supporting concentrated loads or for beams with larger holes, use BC Calc® sizing software (www.BCCalc.com) or contact Boise Cascade EWP Engineering.

BEARING AT CONCRETE/MASONRY WALLS

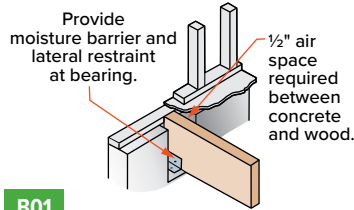


B01

BEARING FOR DOOR OR WINDOW HEADER




B02

BEAM TO BEAM CONNECTOR




B03

BEARING AT COLUMN

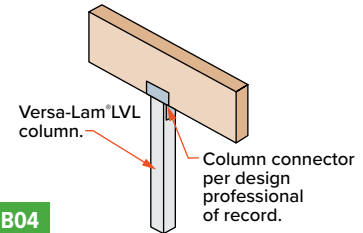


B04

SLOPE SEAT CUT




B06

BEVEL CUT

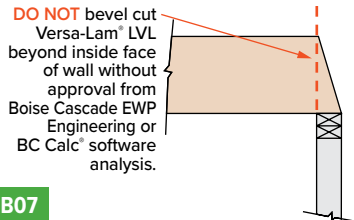


B07

BEAM TO CONCRETE/MASONRY WALLS



B08

BEARING FRAMING INTO WALL



B09

INSTALLATION NOTES

- Minimum of 1/2" air space between beam and wall pocket or adequate barrier must be provided between beam and concrete/masonry.
- Adequate bearing shall be provided. If not shown on plans, please refer to load tables in your region's specifier guide, pages 28-30.
- Versa-Lam® LVL beams are intended for interior applications only and should be kept as dry as possible during construction.
- Continuous lateral support of top of beam shall be provided (side or top bearing framing).

Multiple Member Connectors

Side-Loaded Applications

Number of Members	Maximum Uniform Side Load [plf]							
	Nailed ⁽³⁾		½" Dia. Through Bolt ⁽¹⁾			⅝" Dia. Through Bolt ⁽¹⁾		
	2 rows 16d Sinks @ 12" o.c.	3 rows 16d Sinks @ 12" o.c.	2 rows @ 24" o.c. staggered	2 rows @ 12" o.c. staggered	2 rows @ 6" o.c. staggered	2 rows @ 24" o.c. staggered	2 rows @ 12" o.c. staggered	2 rows @ 6" o.c. staggered
1¾" Versa-Lam® LVL (Depths of 18" and less)								
2	470	705	505	1010	2020	560	1120	2245
3 ⁽²⁾	350	525	375	755	1515	420	840	1685
4 ⁽³⁾	use bolt schedule		335	670	1345	370	745	1495
3½" Versa-Lam® LVL								
2 ⁽²⁾	use bolt schedule		855	1715	N/A	1125	2250	N/A
1¾" Versa-Lam® LVL (Depths of 24" and less)								
Number of Members	Nailed ⁽³⁾		½" Dia. Through Bolt ⁽¹⁾			⅝" Dia. Through Bolt ⁽¹⁾		
	3 rows 16d Sinks @ 12" o.c.	4 rows 16d Sinks @ 12" o.c.	3 rows @ 24" o.c. 8" staggered	3 rows @ 18" o.c. 6" staggered	3 rows @ 12" o.c. 4" staggered	3 rows @ 24" o.c. 8" staggered	3 rows @ 18" o.c. 6" staggered	3 rows @ 12" o.c. 4" staggered
	2	705	940	755	1010	1515	840	1120
3 ⁽²⁾	525	705	565	755	1135	630	840	1260
4 ⁽⁴⁾	use bolt schedule		505	670	1010	560	745	1120

1. Design values apply to common bolts that conform to ANSI/ASME standard B18.21-1981 (ASTM A307 Grades A&B, SAE J429 Grades 1 or 2, or higher). A washer not less than a standard cut washer shall be between the wood and the bolt head and between the

wood and the nut. The distance from the edge of the beam to the bolt holes must be at least 2" for 1/2" bolts and 2 1/2" for 5/8" bolts. Bolt holes shall be the same diameter as the bolt.

2. The nail schedules shown apply to both sides of a 3-member beam.

3. 16d box nails = 0.135" diameter x 3.5" length, 16d sinker nails = 0.148" diameter x 3.25" length.

4. 7" wide beams must be top-loaded or loaded from both sides (lesser side shall be no less than 25% of opposite side).

Top-Loaded Applications

For top-loaded beams and beams with side loads less than shown in Side-Loaded Applications table above:

Plies	Depth	Nailing ⁽²⁾	Maximum Uniform Load From One Side
(2) 1 3/4" plies	Depths 11 1/8" & less	2 rows 16d box/sinker nails @ 12" o.c.	400 plf
	Depths 14" - 18"	3 rows 16d box/sinker nails @ 12" o.c.	600 plf
	Depth = 24"	4 rows 16d box/sinker nails @ 12" o.c.	800 plf
(3) 1 3/4" plies ⁽¹⁾	Depths 11 1/8" & less	2 rows 16d box/sinker nails @ 12" o.c.	300 plf
	Depths 14" - 18"	3 rows 16d box/sinker nails @ 12" o.c.	450 plf
	Depth = 24"	4 rows 16d box/sinker nails @ 12" o.c.	600 plf
(4) 1 3/4" plies	Depths 18" & less	2 rows 1/2" bolts @ 24" o.c., staggered	335 plf
	Depth = 24"	3 rows 1/2" bolts @ 24" o.c., staggered every 8"	505 plf
	Depths 18" & less	2 rows 1/2" bolts @ 24" o.c., staggered	855 plf
(2) 3 1/2" plies	Depth 20" - 24"	3 rows 1/2" bolts @ 24" o.c., staggered every 8"	1285 plf

- The nail schedules shown apply to both sides of a 3-member beam.
- 16d box nails = 0.135" diameter x 3.5" length, 16d sinker nails = 0.148" diameter x 3.25" length.
- Beams wider than 7" must be designed by the engineer of record.
- All values in these tables may be increased by 15% for snow-load roofs and by 25% for


- non-snow load roofs where the building code allows.
- Use allowable load tables or BC Calc® software to size beams.
- An equivalent specific gravity of 0.5 may be used when designing specific connections with Versa-Lam®.
- Connection values are based upon the NDS, 2018 Edition.

- FastenMaster TrussLOK®, Simpson Strong-Tie SDW or SDS, and USP WS screws may also be used to connect multiple member Versa-Lam® LVL beams, contact Boise Cascade EWP Engineering for further information.

Designing Connections For Multiple Versa-Lam® LVL Members

When using multiple ply Versa-Lam® LVL beams to create a wider member, the connection of the plies is as critical as determining the beam size. When side loaded beams are not connected properly, the inside plies do not support their share of the load and thus the load-carrying capacity of the full member decreases significantly. The following is an example of how to size and connect a multiple-ply Versa-Lam® LVL floor beam.

Given: Beam shown below is supporting residential floor load (40 psf live load, 10 psf dead load) and is spanning 16'-0". Beam depth is limited to 14".

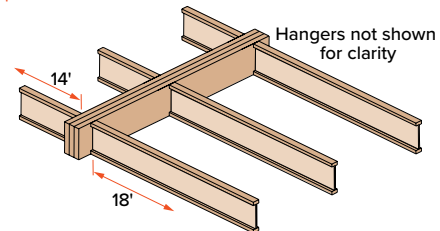

Find: A multiple 1 3/4" ply Versa-Lam® LVL that is adequate to support the design loads and the member's proper connection schedule.

- Calculate the tributary width that beam is supporting:
 $14' / 2 + 18' / 2 = 16'$
- Use PLF tables on pages 3-5 of this guide or BC Calc® to size beam.
A Triple Versa-Lam® LVL 2.1 3100 1 3/4" x 14" is found to adequately support the design loads
- Calculate the maximum plf load from one side (the right side in this case).
 $\text{Max. Side Load} = (18' / 2) \times (40 + 10 \text{ psf}) = 450 \text{ plf}$
- Go to the Multiple Member Connection Table, Side-Loaded Applications, 1 3/4" Versa-Lam® LVL, 3 members.
- The proper connection schedule must have a capacity greater than the max. side load:

Nailed: 3 rows 16d sinkers @ 12" o.c.
525 plf is greater than 450 plf OK
Bolts: 1/2" diameter 2 rows @ 12" staggered:
755 plf is greater than 450 plf OK

Heavy Storage: 250 psf Live Load / 25 psf Dead Load

O.C. Spacing	1½" Versa-Lam® LVL 1.8E 2400				1¾" Versa-Lam® LVL 1.8E 2400					1¾" Versa-Lam® LVL 2.1E 2800			
	7¼	9¼	11¼	14	7¼	9½	11⅞	14	16	9½	11⅞	14	16
12"	7'-8"	9'-10"	12'-0"	15'-0"	8'-1"	10'-8"	13'-4"	15'-9"	18'-1"	11'-3"	14'-1"	16'-8"	19'-1"
16"	7'-0"	8'-11"	10'-11"	13'-7"	7'-4"	9'-8"	12'-1"	14'-4"	16'-5"	10'-3"	12'-10"	15'-1"	17'-4"
19.2"	6'-7"	8'-5"	10'-3"	12'-9"	6'-11"	9'-1"	11'-5"	13'-6"	15'-5"	9'-7"	12'-0"	14'-3"	16'-3"
24"	5'-10"	7'-6"	9'-1"	11'-4"	6'-5"	8'-5"	10'-7"	12'-6"	14'-3"	8'-11"	11'-2"	13'-2"	15'-1"

- Loading based upon Heavy Storage - Table 1607.1 of 2009 International Building Code.
- Spans limited by allowable moment and reaction values, total load deflection of L/240. Live load deflection limited to L/600 with 50 psf, L/360 with 250 psf.
- Table values represent the most restrictive of simple or multiple span applications.
- Table values are the maximum allowable clear distance between supports.
- This table was designed to apply to a broad range of applications. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc® sizing software.
- Table based upon bearing supports of 2x6 framing.
- **Bold spans indicate applications where bearing wider than 2x6 framing may be needed at intermediate supports.**

Light Storage: 125 psf Live Load / 25 psf Dead Load

O.C. Spacing	1½" Versa-Lam® LVL 1.8E 2400				1¾" Versa-Lam® LVL 1.8E 2400					1¾" Versa-Lam® LVL 2.1E 2800			
	7¼	9¼	11¼	14	7¼	9½	11⅞	14	16	9½	11⅞	14	16
12"	9'-9"	12'-5"	15'-2"	18'-11"	10'-3"	13'-6"	16'-10"	19'-11"	22'-9"	14'-3"	17'-10"	21'-0"	24'-1"
16"	8'-10"	11'-3"	13'-9"	17'-2"	9'-3"	12'-3"	15'-4"	18'-1"	20'-8"	12'-11"	16'-2"	19'-1"	21'-10"
19.2"	8'-3"	10'-7"	12'-11"	16'-2"	8'-9"	11'-6"	14'-5"	17'-0"	19'-5"	12'-2"	15'-2"	17'-11"	20'-6"
24"	7'-8"	9'-10"	12'-0"	15'-0"	8'-1"	10'-8"	13'-4"	15'-9"	18'-1"	11'-3"	14'-1"	16'-8"	19'-1"

- Loading based upon Light Storage - Table 1607.1 of 2009 International Building Code.
- Spans limited by allowable moment and reaction values, total load deflection of L/240. Live load deflection limited to L/600 with 50 psf, L/360 with 125 psf.
- Table values represent the most restrictive of simple or multiple span applications.
- Table values are the maximum allowable clear distance between supports.
- This table was designed to apply to a broad range of applications. It may be possible to exceed the limitations of this table by analyzing a specific application with the BC Calc® sizing software.
- Table based upon bearing supports of 2x6 framing.
- **Bold spans indicate applications where bearing wider than 2x6 framing may be needed at intermediate supports.**

Versa-Lam® LVL Floor Load Tables

Versa-Lam® LVL 2.1E 2800 & 2.1E 3100
(100% Load Duration)

KEY TO TABLE:

Top Figure

- Allowable Total Load [plf]

Middle Figure

- Allowable Live Load [plf]

Bottom Figure

- Minimum Required Bearing Length at End / Intermediate Supports [inches]

SPAN (ft)	1¾" Versa-Lam® 2.1E 2800						3½" Versa-Lam® 2.1E 3100						5¼" Versa-Lam® 2.1E 3100						7" Versa-Lam® 2.1E 3100					
	7¼"	9½"	11⅞"	14"	16" ⁽¹⁾	18" ⁽¹⁾	7¼"	9½"	11⅞"	14"	16"	18"	9½"	11⅞"	14"	16"	18"	20"	11⅞"	14"	16"	18"	20"	24"
6	763	1063	1425	1796	2194	2398	1526	2127	2850	3591	4388	4796	3190	4275	5387	6583	7194	7192	5700	7183	8777	9593	9589	9582
	693	-	-	-	-	-	1385	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	1.8 / 4.4	2.4 / 6.1	3.3 / 8.2	4.1 / 10.3	5 / 12.6	5.5 / 13.8	1.8 / 4.4	2.4 / 6.1	3.3 / 8.2	4.1 / 10.3	5 / 12.6	5.5 / 13.8	2.4 / 6.1	3.3 / 8.2	4.1 / 10.3	5 / 12.6	5.5 / 13.8	5.5 / 13.8	3.3 / 8.2	4.1 / 10.3	5 / 12.6	5.5 / 13.8	5.5 / 13.8	5.5 / 13.8
7	614	877	1161	1445	1742	2054	1272	1754	2322	2889	3484	4109	2632	3483	4334	5226	6163	6161	4644	5778	6967	8218	8214	8207
	452	-	-	-	-	-	905	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	1.6 / 4.1	2.4 / 5.9	3.1 / 7.8	3.9 / 9.7	4.7 / 11.7	5.5 / 13.8	1.7 / 4.3	2.4 / 5.9	3.1 / 7.8	3.9 / 9.7	4.7 / 11.7	5.5 / 13.8	2.4 / 5.9	3.1 / 7.8	3.9 / 9.7	4.7 / 11.7	5.5 / 13.8	5.5 / 13.8	3.1 / 7.8	3.9 / 9.7	4.7 / 11.7	5.5 / 13.8	5.5 / 13.8	5.5 / 13.8
8	462	746	979	1208	1444	1702	925	1493	1958	2416	2887	3404	2239	2938	3624	4331	5106	5387	3917	4832	5775	6808	7183	7176
	310	660	-	-	-	-	621	1321	-	-	-	-	1981	-	-	-	-	-	-	-	-	-	-	-
	1.5 / 3.5	2.3 / 5.7	3 / 7.5	3.7 / 9.3	4.4 / 11.1	5.2 / 13	1.5 / 3.5	2.3 / 5.7	3 / 7.5	3.7 / 9.3	4.4 / 11.1	5.2 / 13	2.3 / 5.7	3 / 7.5	3.7 / 9.3	4.4 / 11.1	5.2 / 13	5.5 / 13.8	3 / 7.5	3.7 / 9.3	4.4 / 11.1	5.2 / 13	5.5 / 13.8	5.5 / 13.8
9	329	618	846	1038	1232	1443	659	1299	1693	2076	2465	2886	1948	2539	3113	3697	4328	4786	3386	4151	4930	5771	6381	6374
	222	477	-	-	-	-	444	954	-	-	-	-	1431	-	-	-	-	-	-	-	-	-	-	-
	1.5 / 3	2.1 / 5.3	2.9 / 7.3	3.6 / 8.9	4.3 / 10.6	5 / 12.4	1.5 / 3	2.2 / 5.6	2.9 / 7.3	3.6 / 8.9	4.3 / 10.6	5 / 12.4	2.2 / 5.6	2.9 / 7.3	3.6 / 8.9	4.3 / 10.6	5 / 12.4	5.5 / 13.8	2.9 / 7.3	3.6 / 8.9	4.3 / 10.6	5 / 12.4	5.5 / 13.8	5.5 / 13.8
10	242	500	745	909	1075	1252	485	1056	1491	1819	2150	2504	1584	2236	2728	3225	3756	4304	2981	3638	4299	5008	5739	5732
	164	355	660	-	-	-	327	710	1321	-	-	-	1065	1981	-	-	-	-	2642	-	-	-	-	-
	1.5 / 3	1.9 / 4.8	2.9 / 7.1	3.5 / 8.7	4.1 / 10.3	4.8 / 12	1.5 / 3	2 / 5.1	2.9 / 7.1	3.5 / 8.7	4.1 / 10.3	4.8 / 12	2 / 5.1	2.9 / 7.1	3.5 / 8.7	4.1 / 10.3	4.8 / 12	5.5 / 13.8	2.9 / 7.1	3.5 / 8.7	4.1 / 10.3	4.8 / 12	5.5 / 13.8	5.5 / 13.8
11	183	402	630	809	953	1105	366	804	1331	1618	1906	2211	1205	1997	2428	2858	3316	3803	2662	3237	3811	4422	5071	5207
	124	271	508	798	-	-	248	541	1015	1595	-	-	812	1523	2393	-	-	-	2031	3190	-	-	-	-
	1.5 / 3	1.7 / 4.3	2.7 / 6.7	3.4 / 8.5	4 / 10.1	4.7 / 11.7	1.5 / 3	1.7 / 4.3	2.8 / 7.4	3.4 / 8.5	4 / 10.1	4.7 / 11.7	1.7 / 4.3	2.8 / 7.4	3.4 / 8.5	4 / 10.1	4.7 / 11.7	5.4 / 13.4	2.8 / 7.4	3.4 / 8.5	4 / 10.1	4.7 / 11.7	5.4 / 13.4	5.5 / 13.8
12	141	312	528	722	856	989	282	624	1171	1457	1711	1979	937	1757	2186	2567	2968	3393	2343	2915	3422	3958	4524	4769
	96	211	398	629	-	-	193	422	796	1258	-	-	633	1194	1887	-	-	-	1592	2517	-	-	-	-
	1.5 / 3	1.5 / 3.6	2.4 / 6.1	3.3 / 8.3	3.9 / 9.9	4.6 / 11.4	1.5 / 3	1.5 / 3.6	2.7 / 6.8	3.4 / 8.4	3.9 / 9.9	4.6 / 11.4	1.5 / 3.6	2.7 / 6.8	3.4 / 8.4	3.9 / 9.9	4.6 / 11.4	5.2 / 13	2.7 / 6.8	3.4 / 8.4	3.9 / 9.9	4.6 / 11.4	5.2 / 13	5.5 / 13.8
13	111	247	449	614	776	895	222	494	942	1325	1552	1791	741	1413	1988	2328	2686	3062	1884	2651	3104	3581	4083	4399
	76	168	318	504	728	-	152	335	635	1009	1456	-	503	953	1513	2185	-	-	1270	2017	2913	-	-	-
	1.5 / 3	1.5 / 3.1	2.3 / 5.6	3.1 / 7.7	3.9 / 9.7	4.5 / 11.2	1.5 / 3	1.5 / 3.1	2.4 / 5.9	3.3 / 8.3	3.9 / 9.7	4.5 / 11.2	1.5 / 3.1	2.4 / 5.9	3.3 / 8.3	3.9 / 9.7	4.5 / 11.2	5.1 / 12.7	2.4 / 5.9	3.3 / 8.3	3.9 / 9.7	4.5 / 11.2	5.1 / 12.7	5.5 / 13.8
14	89	198	380	529	682	817	177	397	761	1172	1420	1635	595	1141	1759	2130	2452	2789	1522	2345	2840	3270	3719	4082
	61	135	257	410	594	-	123	270	514	820	1189	-	405	771	1230	1783	-	-	1029	1640	2378	-	-	-
	1.5 / 3	1.5 / 3	2.1 / 5.1	2.9 / 7.1	3.7 / 9.2	4.4 / 11	1.5 / 3	1.5 / 3	3.2 / 7.9	3.8 / 9.6	4.4 / 11	1.5 / 3	2.1 / 5.1	3.2 / 7.9	3.8 / 9.6	4.4 / 11	5 / 12.5	2.1 / 5.1	3.2 / 7.9	3.8 / 9.6	4.4 / 11	5 / 12.5	5.5 / 13.8	
15	72	162	311	460	593	741	143	323	622	1000	1309	1504	485	934	1500	1963	2256	2561	1245	2000	2617	3008	3415	3807
	50	111	211	338	491	680	100	221	422	675	982	1359	332	633	1013	1473	2039	-	844	1350	1964	2718	-	-
	1.5 / 3	1.5 / 3	1.8 / 4.5	2.7 / 6.7	3.4 / 8.6	4.3 / 10.7	1.5 / 3	1.5 / 3	1.8 / 4.5	2.9 / 7.2	3.8 / 9.5	4.3 / 10.9	1.5 / 3	1.8 / 4.5	2.9 / 7.2	3.8 / 9.5	4.3 / 10.9	4.9 / 12.3	1.8 / 4.5	2.9 / 7.2	3.8 / 9.5	4.3 / 10.9	4.9 / 12.3	5.5 / 13.8
16	59	133	257	403	520	651	117	266	515	830	1153	1392	399	772	1246	1730	2088	2367	1030	1661	2306	2784	3156	3566
	41	92	175	281	410	569	83	183	350	562	820	1138	275	526	843	1230	1707	2279	701	1124	1640	2277	3038	-
	1.5 / 3	1.5 / 3	1.6 / 4	2.5 / 6.2	3.2 / 8	4 / 10	1.5 / 3	1.5 / 3	1.6 / 4	2.6 / 6.4	3.6 / 8.9	4.3 / 10.7	1.5 / 3	1.6 / 4	2.6 / 6.4	3.6 / 8.9	4.3 / 10.7	4.9 / 12.2	1.6 / 4	2.6 / 6.4	3.6 / 8.9	4.3 / 10.7	4.9 / 12.2	5.5 / 13.8
17	111	215	348	460	575	97	221	430	696	1020	1276	1376	332	645	1044	1530	1914	2200	861	1393	2040	2552	2933	3354
	77	147	236	346	481	69	153	294	473	691	962	1230	230	441	709	1037	1443	1931	588	945	1382	1924	2575	-
	1.5 / 3	1.5 / 3.6	2.3 / 5.7	3 / 7.6	3.8 / 9.4	1.5 / 3	1.5 / 3	1.5 / 3.6	2.3 / 5.7	3.3 / 8.4	4.2 / 10.5	1.5 / 3	1.5 / 3.6	2.3 / 5.7	3.3 / 8.4	4.2 / 10.5	4.8 / 12	1.5 / 3.6	2.3 / 5.7	3.3 / 8.4	4.2 / 10.5	4.8 / 12	5.5 / 13.8	-
18	93	181	295	409	512	81	186	363	589	867	1136	1376	279	544	884	1301	1704	2055	726	1178	1735	2273	2740	3165
	65	124	201	294	410	58	130	249	401	588	820	1090	194	373	602	882	1230	1650	498	802	1176	1640	2200	-
	1.5 / 3	1.5 / 3.2	2.1 / 5.2	2.9 / 7.1	3.6 / 8.9	1.5 / 3	1.5 / 3	1.5 / 3.2	2.1 / 5.2	3 / 7.6	4 / 9.9	1.5 / 3	1.5 / 3.2	2.1 / 5.2	3 / 7.6	4 / 9.9	4.8 / 11.9	1.5 / 3.2	2.1 / 5.2	3 / 7.6	4 / 9.9	4.8 / 11.9	5.5 / 13.8	-
19	79	154	251	367	459	68	157	308	502	741	1018	1276	236	462	753	1112	1527	1866	617	1004	1483	2036	2488	2996
	55	106	172	252	352	50	110	213	343	504	704	944	166	319	515	756	1056	1420	425	686	1008	1408	1893	-
	1.5 / 3	1.5 / 3	1.9 / 4.7	2.7 / 6.8	3.4 / 8.5	1.5 / 3	1.5 / 3	1.5 / 3	1.9 / 4.7	2.7 / 6.8	3.7 / 9.4	1.5 / 3	1.5 / 3	1.9 / 4.7	2.7 / 6.8	3.7 / 9.4	4.6 / 11.4	1.5 / 3	1.9 / 4.7	2.7 / 6.8	3.7 / 9.4	4.6 / 11.4	5.5 / 13.8	-
20	67	132	216	319	413	57	134	264	431	638	897	1136	201	396	647	957	1346	1682	528	862	1276	1794	2242	2844
	47	92	148	217	304	43	95	183	296	435	609	820	142	275	444	652	913	1230	366	592	870	1218	1640	2718
	1.5 / 3	1.5 / 3	1.7 / 4.2	2.5 / 6.2	3.2 / 8	1.5 / 3	1.5 / 3	1.5 / 3	1.7 / 4.2	2.5 / 6.2	3.5 / 8.7	1.5 / 3	1.5 / 3	1.7 / 4.2	2.5 / 6.2	3.5 / 8.7	4.3 / 10.8	1.5 / 3	1.7 / 4.2	2.5 / 6.2	3.5 / 8.7	4.3 / 10.8	5.5 / 13.8	-
22	98	162	241	340	440	64																		

Versa-Lam® LVL Roof Load Tables

41

Versa-Lam® LVL 2.1E 2800 & 2.1E 3100
(115% Load Duration)

KEY TO TABLE: **Top Figure** - Allowable Total Load [plf]
Middle Figure - Allowable Live Load [plf]
Bottom Figure - Minimum Required Bearing Length at End / Intermediate Supports [inches]

SPAN (ft)	1¾" Versa-Lam® 2.1E 2800						3½" Versa-Lam® 2.1E 3100						5¼" Versa-Lam® 2.1E 3100						7" Versa-Lam® 2.1E 3100					
	7¼"	9½"	11⅞"	14"	16" ⁽¹⁾	18" ⁽¹⁾	7¼"	9½"	11⅞"	14"	16"	18"	9½"	11⅞"	14"	16"	18"	20"	11⅞"	14"	16"	18"	20"	24"
6	878	1224	1640	2066	2399	2398	1756	2447	3279	4132	4798	4796	3671	4919	6198	7197	7194	7192	6558	8264	9596	9593	9589	9582
	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
7	2/5	2.8/7	3.8/9.4	4.7/11.8	5.5/13.8	5.5/13.8	2/5	2.8/7	3.8/9.4	4.7/11.8	5.5/13.8	5.5/13.8	2.8/7	3.8/9.4	4.7/11.8	5.5/13.8	5.5/13.8	5.5/13.8	3.8/9.4	4.7/11.8	5.5/13.8	5.5/13.8	5.5/13.8	5.5/13.8
	707	1009	1336	1662	2004	2054	1464	2019	2672	3325	4008	4109	3028	4008	4987	6013	6163	6161	5344	6649	8017	8218	8214	8207
8	678	-	-	-	-	-	1357	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	1.9/4.7	2.7/6.8	3.6/8.9	4.4/11.1	5.4/13.4	5.5/13.8	2/4.9	2.7/6.8	3.6/8.9	4.4/11.1	5.4/13.4	5.5/13.8	2.7/6.8	3.6/8.9	4.4/11.1	5.4/13.4	5.5/13.8	5.5/13.8	3.6/8.9	4.4/11.1	5.4/13.4	5.5/13.8	5.5/13.8	5.5/13.8
9	541	859	1127	1390	1661	1797	1198	1718	2254	2780	3323	3593	2577	3381	4171	4984	5390	5387	4508	5561	6645	7186	7183	7176
	466	-	-	-	-	-	931	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
10	1.7/4.1	2.6/6.6	3.5/8.6	4.3/10.6	5.1/12.7	5.5/13.8	1.8/4.6	2.6/6.6	3.5/8.6	4.3/10.6	5.1/12.7	5.5/13.8	2.6/6.6	3.5/8.6	4.3/10.6	5.1/12.7	5.5/13.8	5.5/13.8	3.5/8.6	4.3/10.6	5.1/12.7	5.5/13.8	5.5/13.8	5.5/13.8
	426	712	974	1194	1418	1596	881	1495	1948	2389	2837	3192	2242	2923	3583	4255	4788	4786	3897	4778	5673	6384	6381	6374
11	333	-	-	-	-	-	665	1431	-	-	-	-	2146	-	-	-	-	-	-	-	-	-	-	-
	1.5/3.7	2.5/6.1	3.4/8.4	4.1/10.3	4.9/12.2	5.5/13.8	1.5/3.8	2.6/6.4	3.4/8.4	4.1/10.3	4.9/12.2	5.5/13.8	2.6/6.4	3.4/8.4	4.1/10.3	4.9/12.2	5.5/13.8	5.5/13.8	3.4/8.4	4.1/10.3	4.9/12.2	5.5/13.8	5.5/13.8	5.5/13.8
12	324	576	858	1047	1237	1436	648	1276	1716	2094	2474	2871	1913	2574	3140	3711	4307	4304	3431	4187	4949	5743	5739	5732
	246	532	-	-	-	-	491	1065	-	-	-	-	1597	-	-	-	-	-	-	-	-	-	-	-
13	1.5/3.1	2.2/5.5	3.3/8.2	4/10	4.7/11.9	5.5/13.8	1.5/3.1	2.4/6.1	3.3/8.2	4/10	4.7/11.9	5.5/13.8	2.4/6.1	3.3/8.2	4/10	4.7/11.9	5.5/13.8	5.5/13.8	3.3/8.2	4/10	4.7/11.9	5.5/13.8	5.5/13.8	5.5/13.8
	245	475	725	932	1097	1272	490	1053	1532	1863	2194	2545	1579	2299	2795	3290	3817	3911	3065	3726	4387	5090	5214	5207
14	186	406	-	-	-	-	372	812	1523	-	-	-	1218	2285	-	-	-	-	3046	-	-	-	-	-
	1.5/3	2/5	3.1/7.7	3.9/9.8	4.6/11.6	5.4/13.4	1.5/3	2.2/5.6	3.2/8.1	3.9/9.8	4.6/11.6	5.4/13.4	2.2/5.6	3.2/8.1	3.9/9.8	4.6/11.6	5.4/13.4	5.5/13.8	3.2/8.1	3.9/9.8	4.6/11.6	5.4/13.4	5.5/13.8	5.5/13.8
15	189	398	609	831	985	1139	379	835	1349	1678	1970	2278	1253	2023	2517	2955	3417	3582	2697	3356	3940	4556	4777	4769
	144	317	597	-	-	-	289	633	1194	-	-	-	950	1791	-	-	-	-	2389	-	-	-	-	-
16	1.5/3	1.8/4.6	2.8/7	3.8/9.6	4.5/11.3	5.2/13.1	1.5/3	1.9/4.8	3.1/7.8	3.9/9.7	4.5/11.3	5.2/13.1	1.9/4.8	3.1/7.8	3.9/9.7	4.5/11.3	5.2/13.1	5.5/13.8	3.1/7.8	3.9/9.7	4.5/11.3	5.2/13.1	5.5/13.8	5.5/13.8
	149	331	518	708	894	1031	298	662	1147	1526	1787	2062	992	1721	2289	2681	3092	3305	2295	3052	3574	4123	4406	4399
17	114	251	476	-	-	-	229	503	953	1513	-	-	754	1429	2269	-	-	-	1905	3026	-	-	-	-
	1.5/3	1.7/4.1	2.6/6.5	3.5/8.8	4.5/11.2	5.1/12.9	1.5/3	1.7/4.1	2.9/7.2	3.8/9.5	4.5/11.2	5.1/12.9	1.7/4.1	2.9/7.2	3.8/9.5	4.5/11.2	5.1/12.9	5.5/13.8	2.9/7.2	3.8/9.5	4.5/11.2	5.1/12.9	5.5/13.8	5.5/13.8
18	119	266	446	609	785	941	239	532	988	1350	1635	1883	798	1482	2025	2453	2824	3067	1976	2701	3271	3765	4089	4082
	92	203	386	-	-	-	184	405	771	1230	-	-	608	1157	1845	-	-	-	1543	2460	-	-	-	-
19	1.5/3	1.5/3.6	2.4/6	3.3/8.2	4.2/10.6	5.1/12.7	1.5/3	1.5/3.6	2.7/6.7	3.6/9.1	4.4/11	5.1/12.7	1.5/3.6	2.7/6.7	3.6/9.1	4.4/11	5.1/12.7	5.5/13.8	2.7/6.7	3.6/9.1	4.4/11	5.1/12.7	5.5/13.8	5.5/13.8
	97	217	388	530	683	854	193	434	833	1175	1507	1732	650	1250	1762	2261	2598	2861	1667	2349	3014	3464	3814	3807
20	75	166	317	506	-	-	150	332	633	1013	1473	-	497	950	1519	2210	-	-	1266	2025	2946	-	-	-
	1.5/3	1.5/3.2	2.2/5.6	3.1/7.7	3.9/9.9	4.9/12.3	1.5/3	1.5/3.2	2.4/6	3.4/8.5	4.3/10.9	5/12.5	1.5/3.2	2.4/6	3.4/8.5	4.3/10.9	5/12.5	5.5/13.8	2.4/6	3.4/8.5	4.3/10.9	5/12.5	5.5/13.8	5.5/13.8
21	79	179	340	465	599	749	159	358	690	1031	1328	1603	536	1035	1546	1993	2405	2680	1380	2062	2657	3207	3573	3566
	62	137	263	421	-	-	124	275	526	843	1230	-	412	788	1264	1845	-	-	1051	1686	2460	-	-	-
22	1.5/3	1.5/3	2.1/5.3	2.9/7.2	3.7/9.2	4.6/11.5	1.5/3	1.5/3	2.1/5.3	3.2/7.9	4.1/10.2	4.9/12.3	1.5/3	2.1/5.3	3.2/7.9	4.1/10.2	4.9/12.3	5.5/13.8	2.1/5.3	3.2/7.9	4.1/10.2	4.9/12.3	5.5/13.8	5.5/13.8
	66	149	289	411	530	663	132	298	577	912	1175	1470	447	866	1368	1763	2204	2521	1155	1823	2350	2939	3361	3354
23	52	115	220	354	518	-	104	230	441	709	1037	1443	345	661	1063	1555	2165	-	882	1418	2074	2886	-	-
	1.5/3	1.5/3	1.9/4.8	2.7/6.8	3.5/8.7	4.3/10.9	1.5/3	1.5/3	1.9/4.8	3/7.5	3.9/9.6	4.8/12	1.5/3	1.9/4.8	3/7.5	3.9/9.6	4.8/12	5.5/13.8	1.9/4.8	3/7.5	3.9/9.6	4.8/12	5.5/13.8	5.5/13.8
24	55	125	244	366	472	590	110	251	487	790	1047	1309	376	731	1184	1570	1964	2367	975	1579	2093	2618	3156	3165
	44	97	187	301	441	-	87	194	373	602	882	1230	291	560	902	1322	1845	-	747	1203	1763	2460	-	-
25	1.5/3	1.5/3	1.7/4.3	2.6/6.4	3.3/8.2	4.1/10.3	1.5/3	1.5/3	1.7/4.3	2.8/6.9	3.6/9.1	4.5/11.4	1.5/3	1.7/4.3	2.8/6.9	3.6/9.1	4.5/11.4	5.5/13.7	1.7/4.3	2.8/6.9	3.6/9.1	4.5/11.4	5.5/13.7	5.5/13.8
	46	106	207	328	423	529	93	212	415	674	938	1173	319	622	1011	1407	1760	2150	829	1347	1876	2347	2867	2996
26	37	83	160	257	378	528	74	166	319	515	756	1056	249	479	772	1133	1584	2130	638	1029	1511	2112	2839	-
	1.5/3	1.5/3	1.5/3.8	2.4/6	3.1/7.8	3.9/9.7	1.5/3	1.5/3	1.5/3.8	2.5/6.2	3.4/8.6	4.3/10.8	1.5/3	1.5/3.8	2.5/6.2	3.4/8.6	4.3/10.8	5.3/13.1	1.5/3.8	2.5/6.2	3.4/8.6	4.3/10.8	5.3/13.1	5.5/13.8
27	91	178	289	381	477	79	181	355	579	845	1057	1457	272	533	868	1267	1586	1938	711	1158	1690	2115	2584	2844
	1.5/3	1.5/3.5	2.3/5.6	3/7.4	3.7/9.2	1.5/3	1.5/3	1.5/3.5	2.3/5.6	3.3/8.2	4.1/10.2	1.5/3	1.5/3.5	2.3/5.6	3.3/8.2	4.1/10.2	5/12.5	1.5/3.5	2.3/5.6	3.3/8.2	4.1/10.2	5/12.5	5.5/13.8	-
28	67	133	218	314	393	58	135	266	436	646	871	1202	399	654	970	1307	1597	2130	532	871	1293	1742	2129	2582
	54	104	168	248	348	48	107	208	336	496	696	961	311	504	743	1044	1410	1910	415	672	991	1392	1880	-
29																								

Versa-Lam® LVL Roof Load Tables

Versa-Lam® LVL 2.1E 2800 & 2.1E 3100
(125% Load Duration)

KEY TO TABLE:

Top Figure

- Allowable Total Load [plf]

Middle Figure

- Allowable Live Load [plf]


Bottom Figure

- Minimum Required Bearing Length at End / Intermediate Supports [inches]

SPAN (ft)	1¾" Versa-Lam® 2.1E 2800						3½" Versa-Lam® 2.1E 3100						5¼" Versa-Lam® 2.1E 3100						7" Versa-Lam® 2.1E 3100					
	7¼"	9½"	11¾"	14"	16" ⁽¹⁾	18" ⁽¹⁾	7¼"	9½"	11¾"	14"	16"	18"	9½"	11¾"	14"	16"	18"	20"	11¾"	14"	16"	18"	20"	24"
6	955	1330	1783	2246	2399	2398	1909	2661	3565	4492	4798	4796	3991	5348	6738	7197	7194	7192	7131	8984	9596	9593	9589	9582
	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	2.2/5.5	3.1/7.6	4.1/10.2	5.1/12.9	5.5/13.8	5.5/13.8	2.2/5.5	3.1/7.6	4.1/10.2	5.1/12.9	5.5/13.8	5.5/13.8	3.1/7.6	4.1/10.2	5.1/12.9	5.5/13.8	5.5/13.8	5.5/13.8	4.1/10.2	5.1/12.9	5.5/13.8	5.5/13.8	5.5/13.8	5.5/13.8
7	769	1098	1453	1807	2055	2054	1592	2195	2905	3615	4111	4109	3293	4358	5422	6166	6163	6161	5810	7229	8221	8218	8214	8207
	678	-	-	-	-	-	1357	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	2.1/5.1	2.9/7.3	3.9/9.7	4.8/12.1	5.5/13.8	5.5/13.8	2.1/5.3	2.9/7.3	3.9/9.7	4.8/12.1	5.5/13.8	5.5/13.8	2.9/7.3	3.9/9.7	4.8/12.1	5.5/13.8	5.5/13.8	5.5/13.8	3.9/9.7	4.8/12.1	5.5/13.8	5.5/13.8	5.5/13.8	5.5/13.8
8	588	934	1225	1512	1797	1797	1235	1868	2451	3023	3595	3593	2802	3676	4535	5392	5390	5387	4901	6047	7190	7186	7183	7176
	466	-	-	-	-	-	931	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	1.8/4.5	2.9/7.1	3.8/9.4	4.6/11.6	5.5/13.8	5.5/13.8	1.9/4.7	2.9/7.1	3.8/9.4	4.6/11.6	5.5/13.8	5.5/13.8	2.9/7.1	3.8/9.4	4.6/11.6	5.5/13.8	5.5/13.8	5.5/13.8	3.8/9.4	4.6/11.6	5.5/13.8	5.5/13.8	5.5/13.8	5.5/13.8
9	440	774	1059	1299	1542	1596	881	1625	2119	2598	3085	3192	2438	3178	3897	4627	4788	4786	4238	5195	6169	6384	6381	6374
	333	715	-	-	-	-	665	1431	-	-	-	-	2146	-	-	-	-	-	-	-	-	-	-	-
	1.5/3.8	2.7/6.7	3.7/9.1	4.5/11.2	5.3/13.3	5.5/13.8	1.5/3.8	2.8/7	3.7/9.1	4.5/11.2	5.3/13.3	5.5/13.8	2.8/7	3.7/9.1	4.5/11.2	5.3/13.3	5.5/13.8	5.5/13.8	3.7/9.1	4.5/11.2	5.3/13.3	5.5/13.8	5.5/13.8	5.5/13.8
10	324	626	933	1138	1345	1436	648	1387	1866	2277	2691	2871	2081	2799	3415	4036	4307	4304	3732	4554	5381	5743	5739	5732
	246	532	-	-	-	-	491	1065	-	-	-	-	1597	-	-	-	-	-	-	-	-	-	-	-
	1.5/3.1	2.4/6	3.6/8.9	4.4/10.9	5.2/12.9	5.5/13.8	1.5/3.1	2.7/6.6	3.6/8.9	4.4/10.9	5.2/12.9	5.5/13.8	2.7/6.6	3.6/8.9	4.4/10.9	5.2/12.9	5.5/13.8	5.5/13.8	3.6/8.9	4.4/10.9	5.2/12.9	5.5/13.8	5.5/13.8	5.5/13.8
11	245	517	789	1013	1193	1304	490	1074	1667	2026	2386	2609	1611	2500	3039	3578	3913	3911	3333	4052	4771	5218	5214	5207
	186	406	762	-	-	-	372	812	1523	-	-	-	1218	2285	-	-	-	-	3046	-	-	-	-	-
	1.5/3	2.2/5.5	3.3/8.3	4.3/10.7	5/12.6	5.5/13.8	1.5/3	2.3/5.7	3.5/8.8	4.3/10.7	5/12.6	5.5/13.8	2.3/5.7	3.5/8.8	4.3/10.7	5/12.6	5.5/13.8	5.5/13.8	3.5/8.8	4.3/10.7	5/12.6	5.5/13.8	5.5/13.8	5.5/13.8
12	189	418	662	904	1071	1195	379	835	1467	1825	2142	2390	1253	2200	2737	3214	3585	3582	2934	3650	4285	4780	4777	4769
	144	317	597	-	-	-	289	633	1194	-	-	-	950	1791	-	-	-	-	2389	-	-	-	-	-
	1.5/3	1.9/4.8	3.1/7.6	4.2/10.4	4.9/12.3	5.5/13.8	1.5/3	1.9/4.8	3.4/8.4	4.2/10.5	4.9/12.3	5.5/13.8	1.9/4.8	3.4/8.4	4.2/10.5	4.9/12.3	5.5/13.8	5.5/13.8	3.4/8.4	4.2/10.5	4.9/12.3	5.5/13.8	5.5/13.8	5.5/13.8
13	149	331	563	770	972	1102	298	662	1248	1660	1944	2205	992	1872	2490	2916	3307	3305	2496	3320	3888	4410	4406	4399
	114	251	476	756	-	-	229	503	953	1513	-	-	754	1429	2269	-	-	-	1905	3026	-	-	-	-
	1.5/3	1.7/4.1	2.8/7	3.8/9.6	4.8/12.1	5.5/13.8	1.5/3	1.7/4.1	3.1/7.8	4.1/10.4	4.8/12.1	5.5/13.8	1.7/4.1	3.1/7.8	4.1/10.4	4.8/12.1	5.5/13.8	5.5/13.8	3.1/7.8	4.1/10.4	4.8/12.1	5.5/13.8	5.5/13.8	5.5/13.8
14	119	266	485	663	854	1023	239	532	1018	1469	1779	2046	798	1527	2203	2668	3069	3067	2036	2938	3558	4093	4089	4082
	92	203	386	615	-	-	184	405	771	1230	-	-	608	1157	1845	-	-	-	1543	2460	-	-	-	-
	1.5/3	1.5/3.6	2.6/6.5	3.6/8.9	4.6/11.5	5.5/13.8	1.5/3	1.5/3.6	2.7/6.9	4/9.9	4.8/12	5.5/13.8	1.5/3.6	2.7/6.9	4/9.9	4.8/12	5.5/13.8	5.5/13.8	2.7/6.9	4/9.9	4.8/12	5.5/13.8	5.5/13.8	5.5/13.8
15	97	217	417	576	743	929	193	434	833	1278	1639	1884	650	1250	1917	2459	2826	2861	1667	2556	3279	3768	3814	3807
	75	166	317	506	737	-	150	332	633	1013	1473	-	497	950	1519	2210	-	-	1266	2025	2946	-	-	-
	1.5/3	1.5/3.2	2.4/6	3.3/8.3	4.3/10.7	5.4/13.4	1.5/3	1.5/3.2	2.4/6	3.7/9.2	4.7/11.8	5.4/13.6	1.5/3.2	2.4/6	3.7/9.2	4.7/11.8	5.4/13.6	5.5/13.8	2.4/6	3.7/9.2	4.7/11.8	5.4/13.6	5.5/13.8	5.5/13.8
16	79	179	345	506	652	815	159	358	690	1111	1445	1744	536	1035	1667	2168	2616	2680	1380	2223	2890	3488	3573	3566
	62	137	263	421	615	-	124	275	526	843	1230	1707	412	788	1264	1845	2561	-	1051	1686	2460	3415	-	-
	1.5/3	1.5/3	2.1/5.3	3.1/7.8	4/10	5/12.5	1.5/3	1.5/3	2.1/5.3	3.4/8.6	4.4/11.1	5.4/13.4	1.5/3	2.1/5.3	3.4/8.6	4.4/11.1	5.4/13.4	5.5/13.8	2.1/5.3	3.4/8.6	4.4/11.1	5.4/13.4	5.5/13.8	5.5/13.8
17	66	149	289	447	577	721	132	298	577	933	1278	1599	447	866	1399	1918	2398	2521	1155	1865	2557	3198	3361	3354
	52	115	220	354	518	-	104	230	441	709	1037	1443	345	661	1063	1555	2165	-	882	1418	2074	2886	-	-
	1.5/3	1.5/3	1.9/4.8	2.9/7.3	3.8/9.5	4.7/11.8	1.5/3	1.5/3	1.9/4.8	3.1/7.7	4.2/10.5	5.2/13.1	1.5/3	1.9/4.8	3.1/7.7	4.2/10.5	5.2/13.1	5.5/13.8	1.9/4.8	3.1/7.7	4.2/10.5	5.2/13.1	5.5/13.8	5.5/13.8
18	55	125	244	395	514	642	110	251	487	790	1139	1424	376	731	1184	1708	2137	2379	975	1579	2278	2849	3172	3165
	44	97	187	301	441	615	87	194	373	602	882	1230	291	560	902	1322	1845	-	747	1203	1763	2460	-	-
	1.5/3	1.5/3	1.7/4.3	2.8/6.9	3.6/8.9	4.5/11.2	1.5/3	1.5/3	1.7/4.3	2.8/6.9	4/9.9	4.9/12.3	1.5/3	1.7/4.3	2.8/6.9	4/9.9	4.9/12.3	5.5/13.8	1.7/4.3	2.8/6.9	4/9.9	4.9/12.3	5.5/13.8	5.5/13.8
19	46	106	207	337	460	576	93	212	415	674	993	1277	319	622	1011	1490	1915	2253	829	1347	1986	2553	3004	2996
	37	83	160	257	378	528	74	166	319	515	756	1056	249	479	772	1133	1584	2130	638	1029	1511	2112	2839	-
	1.5/3	1.5/3	1.5/3.8	2.5/6.2	3.4/8.5	4.2/10.6	1.5/3	1.5/3	1.5/3.8	2.5/6.2	3.6/9.1	4.7/11.7	1.5/3	1.5/3.8	2.5/6.2	3.6/9.1	4.7/11.7	5.5/13.8	1.5/3.8	2.5/6.2	3.6/9.1	4.7/11.7	5.5/13.8	5.5/13.8
20	39	91	178	289	415	519	79	181	355	579	855	1151	272	533	868	1283	1726	2109	711	1158	1711	2301	2812	2844
	32	71	137	222	326	457	64	142	275	444	652	913	214	412	666	979	1370	1845	549	887	1305	1827	2460	-
	1.5/3	1.5/3	1.5/3.5	2.3/5.6	3.2/8	4/10	1.5/3	1.5/3	1.5/3.5	2.3/5.6	3.3/8.3	4.4/11.1	1.5/3	1.5/3.5	2.3/5.6	3.3/8.3	4.4/11.1	5.4/13.6	1.5/3.5	2.3/5.6	3.3/8.3	4.4/11.1	5.4/13.6	5.5/13.8
22	67	133	218	323	427	58	135	266	436	646	912	202	399	654	970	1367	1738	532	871	1293	1823	2317	2582	-
	54	104	168	248	348	48	107	208	336	496	696	161	311	504	743	1044</								

Closest Allowable Nail Spacing

Versa-Lam® LVL Products Nail Size	Nailing Parallel to Glue Lines (Narrow Face) ⁽¹⁾						Nailing Perpendicular to Glue Lines (Wide Face)	
	Versa-Lam® LVL 1.5E 1800 1 ⁵ / ₁₆ "		Versa-Lam® LVL 1 ³ / ₄ "		Versa-Lam® LVL 3 ¹ / ₂ " & Wider		All Products	
	O.C. [in]	End [in]	O.C. [in]	End [in]	O.C. [in]	End [in]	O.C. [in]	End [in]
8d Box (0.113"ø x 2.5")	3	1 ¹ / ₂	2	1	2	1 ¹ / ₂	2	1 ¹ / ₂
8d Common (0.131"ø x 2.5")	3	2	3	2	2	1	2	1
10d & 12d Box (0.128"ø x 3", 3.25")	3	2	3	2	2	1	2	1
16d Box (0.135"ø x 3.5")	3	2	3	2	2	1	2	1
10d & 12d Common & 16d Sinker (0.148"ø x 3", 3.25")	4	3	4	3	2	2	2	2
16d Common (0.162"ø x 3.5")	6	4	6	3	2	2	2	2

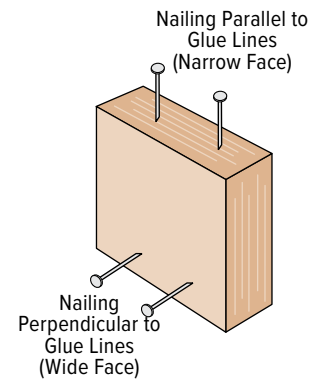

1) For 1³/₄" thickness and greater, 2 rows of nails (such as for a metal strap) are allowed (use 1/2" minimum offset between rows and stagger nails).

- Offset and stagger nail rows from floor sheathing and wall sole plate.
- Simpson Strong-Tie A35 and LPT4 connectors may be attached to the side Versa-Lam® LVL/Versa-Rim® LVL. Use nails as specified by Simpson Strong-Tie.

Versa-Lam® LVL Design Values

Grade	Width [in]	Depth [in]	Weight [lb/ft]	Allowable Shear [lb]	Allowable Moment [ft-lb]	Moment of Inertia [in ⁴]
Versa-Lam® 1.5E 1800	1 ⁵ / ₁₆	9 ¹ / ₂	3.2	1,870	3,039	93.8
		11 ⁷ / ₈	4.0	2,338	4,632	183.2
		14	4.7	2,756	6,322	300.1
		16	5.4	3,150	8,136	448.0
		18	6.1	3,544	10,163	637.9
		20	6.7	3,938	12,401	875.0
Versa-Lam® 1.8E 2400	1 ¹ / ₂	3 ¹ / ₂	1.3	998	702	5.4
		5 ¹ / ₂	2.1	1,568	1,649	20.8
		7 ¹ / ₄	2.8	2,066	2,779	47.6
		9 ¹ / ₄	3.6	2,636	4,404	98.9
		9 ¹ / ₂	3.7	2,708	4,631	107.2
		11 ¹ / ₄	4.3	3,206	6,374	178.0
		11 ⁷ / ₈	4.6	3,384	7,059	209.3
		14	5.4	3,990	9,634	343.0
		16	6.2	4,560	12,397	512.0
Versa-Lam® 2.1E 2800	1 ³ / ₄	5 ¹ / ₂	2.5	1,829	2,245	24.3
		7 ¹ / ₄	3.3	2,411	3,783	55.6
		9 ¹ / ₄	4.2	3,076	5,994	115.4
		9 ¹ / ₂	4.3	3,159	6,304	125.0
		11 ¹ / ₄	5.1	3,741	8,675	207.6
		11 ⁷ / ₈	5.3	3,948	9,608	244.2
		14	6.3	4,655	13,112	400.2
		16	7.2	5,320	16,874	597.3
		18	8.1	5,985	21,079	850.5
Versa-Lam® 2.1E 3100	3 ¹ / ₂	5 ¹ / ₂	4.9	3,658	4,971	48.5
		7 ¹ / ₄	6.5	4,821	8,377	111.1
		9 ¹ / ₄	8.3	6,151	13,272	230.8
		9 ¹ / ₂	8.5	6,318	13,958	250.1
		11 ¹ / ₄	10.1	7,481	19,210	415.3
		11 ⁷ / ₈	10.7	7,897	21,275	488.4
		14	12.6	9,310	29,035	800.3
		16	14.4	10,640	37,364	1194.7
		18	16.2	11,970	46,674	1701.0
		20	18.0	13,300	56,952	2333.3
	5 ¹ / ₄	5 ¹ / ₄	7.1	5,237	6,830	63.3
		5 ¹ / ₂	7.4	5,486	7,457	72.8
		7 ¹ / ₄	9.8	7,232	12,566	166.7
		9 ¹ / ₄	12.5	9,227	19,908	346.3
		9 ¹ / ₂	12.8	9,476	20,937	375.1
		11 ¹ / ₄	15.2	11,222	28,814	622.9
		11 ⁷ / ₈	16.0	11,845	31,913	732.6
		14	18.9	13,965	43,552	1200.5
		16	21.6	15,960	56,046	1792.0
		18	24.3	17,955	70,011	2551.5
		20	27.0	19,950	85,428	3500.0
		24	32.4	23,940	120,549	6048.0
	7	9 ¹ / ₄	16.6	12,303	26,544	461.7
		9 ¹ / ₂	17.1	12,635	27,916	500.1
		11 ¹ / ₄	20.2	14,963	38,419	830.6
		11 ⁷ / ₈	21.4	15,794	42,550	976.8
		14	25.2	18,620	58,069	1600.7
		16	28.8	21,280	74,728	2389.3
		18	32.4	23,940	93,348	3402.0
		20	36.0	26,600	113,904	4666.7
		24	43.2	31,920	160,732	8064.0

Versa-Lam® LVL Allowable Stress Values

Design Property	Grade	Modulus of Elasticity True (Shear-Free)	Modulus of Elasticity Apparent	Modulus of Elasticity for Stability	Bending	Horizontal Shear	Tension Parallel to Grain	Compression Parallel to Grain	Compression Perpendicular to Grain	Equivalent Specific Gravity for Fastener Design
		E (x 10 ⁶ psi) ⁽¹⁾⁽⁷⁾	E (x 10 ⁶ psi) ⁽⁸⁾	E _{min} (x 10 ⁶ psi) ⁽¹⁾⁽⁸⁾	F _b (psi) ⁽²⁾⁽³⁾	F _v (psi) ⁽²⁾⁽⁴⁾	F _t (psi) ⁽²⁾⁽⁵⁾	F _c (psi) ⁽²⁾	F _{c⊥} (psi) ⁽¹⁾⁽⁶⁾	(SG)
Versa-Lam® LVL Beams 1 ³ / ₄ "	2.1 E 2800	2.1	2.0	1.1	2800	285	1950	3000	750	0.5
Versa-Lam® LVL Beams 3 ¹ / ₂ " & Wider	2.1 E 3100	2.1	2.0	1.1	3100	285	1950	3000	750	0.5
Versa-Lam® LVL Studs	1.8E 2400	1.8	1.7	0.9	2650	285	1500	3000	750	0.5
Versa-Lam® LVL Columns	1.8E 2650	1.8	1.7	0.9	2650	285	1650	3000	750	0.5

1. This value cannot be adjusted for load duration.
2. This value is based upon a load duration of 100% and may be adjusted for other load durations.
3. Fiber stress bending value shall be multiplied by the depth factor, (12/d)^{1/3} where d = member depth [in].
4. Stress applied perpendicular to the glue lines.
5. Tension value shall be multiplied by a length factor, (4/L)^{1/8} where L = member length [ft]. Use L = 4 for members less than four feet long.
6. Stress applied parallel to the glue lines.

7. True or shear-free modulus of elasticity does not account for shear deformation.
 8. E_{min} is the reference modulus of elasticity for beam and column stability calculations. It is calculated using E_{apparent} in accordance with Appendix D of the 2018 NDS. When calculating E_{min}, the coefficient of modulus of elasticity, COV_E, may be taken as 0.10, and the adjustment factor to convert E to a pure bending basis may be taken as 1.05.
- * Design properties are limited to dry conditions of use where the maximum moisture content of the material will not exceed 16%.

Versa-Lam® LVL 1.8E 2650 Columns

Column Length [ft]	3½" Allowable Axial Load (lb)								
	3½" x 3½"			3½" x 5¼"			3½" x 7"		
	100%	115%	125%	100%	115%	125%	100%	115%	125%
4	14,700	16,090	16,930	22,070	24,165	25,430	29,450	32,240	33,920
5	12,270	13,150	13,660	18,425	19,740	20,515	24,580	26,330	27,365
6	10,080	10,650	10,980	15,140	15,995	16,495	20,195	21,335	22,000
7	8,310	8,705	8,930	12,480	13,075	13,415	16,650	17,435	17,890
8	6,930	7,205	7,370	10,405	10,825	11,070	13,880	14,440	14,760
9	5,840	6,050	6,160	8,770	9,080	9,260	11,700	12,115	12,350
10	4,980	5,135	5,225	7,480	7,715	7,850	9,975	10,290	10,470
11	4,290	4,410	4,480	6,445	6,625	6,730	8,595	8,835	8,975
12	3,730	3,825	3,880	5,600	5,745	5,830	7,475	7,665	7,775
13	3,270	3,350	3,390	4,915	5,030	5,095	6,555	6,710	6,795
14	2,890	2,950	2,990	4,340	4,435	4,490	5,790	5,915	5,990

Column Length [ft]	5¼" Allowable Axial Load (lb)									7" Allowable Axial Load (lb)					
	5¼" x 5¼"			5¼" x 5½"			5¼" x 7"			5¼" x 7¼"			7" x 7"		
	100%	115%	125%	100%	115%	125%	100%	115%	125%	100%	115%	125%	100%	115%	125%
6	33,070	36,220	38,110	34,670	37,950	39,930									
7	29,420	31,730	33,085	30,830	33,240	34,660									
8	25,875	27,570	28,565	27,110	28,880	29,930	34,525	36,790	38,115	35,760	38,090	39,480			
9	22,690	23,970	24,715	23,770	25,110	25,900	30,275	31,985	32,980	31,360	33,130	34,160			
10	19,930	20,920	21,495	20,880	21,920	22,520	26,600	27,920	28,685	27,550	28,920	29,710			
11	17,585	18,375	18,820	18,420	19,250	19,720	23,465	24,510	25,125	24,310	25,400	26,010			
12	15,590	16,220	16,585	16,340	16,990	17,380	20,805	21,650	22,130	21,550	22,420	22,930			
13	13,895	14,410	14,700	14,560	15,100	15,400	18,545	19,225	19,620	19,210	19,920	20,320			
14	12,450	12,870	13,115	13,040	13,480	13,740	16,615	17,180	17,500	17,210	17,790	18,130	33,260	34,825	35,740
15	11,210	11,560	11,760	11,740	12,110	12,320	14,960	15,425	15,695	15,490	15,980	16,260	30,325	31,645	32,395
16	10,135	10,430	10,600	10,620	10,930	11,110	13,525	13,920	14,150	14,010	14,420	14,650	27,720	28,835	29,490
17	9,205	9,455	9,600	9,650	9,910	10,060	12,285	12,620	12,810	12,730	13,070	13,270	25,415	26,375	26,920
18	8,395	8,610	8,735	8,800	9,020	9,150	11,205	11,495	11,655	11,610	11,900	12,070	23,370	24,195	24,665
19	7,685	7,870	7,975	8,050	8,250	8,360	10,260	10,505	10,645	10,620	10,880	11,030	21,550	22,270	22,670
20	7,060	7,220	7,310	7,400	7,560	7,660	9,420	9,635	9,760	9,760	9,980	10,110	19,925	20,550	20,910
21	6,505	6,645	6,725	6,820	6,960	7,050	8,680	8,870	8,980	8,990	9,190	9,300	18,475	19,020	19,330
22													17,165	17,650	17,925
23													15,990	16,420	16,660
24													14,930	15,310	15,525

- Table assumes that the column is braced at column ends only. Effective column length is equal to actual column length.
- Allowable loads are based upon one-piece (solid) column members used in dry service conditions. BC Calc® sizing software (www.BCCalc.com) may be used for multi-piece column design.
- Allowable loads are based on an eccentricity value equal to 0.167 multiplied by either the column thickness or width (worst case).
- Allowable loads are based on axial loaded columns using the design provisions of the 2018 National Design Specification (NDS) for Wood Construction. Table capacity values based upon a buckling length coefficient, K_e , equal to 1.0

- (rotation free, translation fixed at each column end per NDS Appendix G). A K_e coefficient of 1.0 conservatively models typical wood column applications. For other end fixity conditions, contact Boise Cascade EWP Engineering. For side or other combined bending and axial loads, see provisions in 2018 NDS.
- Load values are not shown for short lengths due to loads exceeding common connector capacities. Load values are not shown for longer lengths if the controlling slenderness ratio exceeds 50 (per NDS).
 - Lateral loads (wind loading) are not considered in this table. BC Calc® sizing software (www.BCCalc.com) may be used for out of plane lateral load column application design.

Versa-Stud® LVL 1.8E 2400

Reference Design Values

Product	Bending F_b [psi]	Compression Parallel to Grain F_c [psi]	Compression Perp to Grain $F_{c\perp}$ [psi]	Modulus of Elasticity - Apparent E [psi]	Horizontal Shear F_v [psi]
Versa-Stud® 1.8E 2400 1½" x 5½"	2617	3000	450	1,700,000	285
Douglas-Fir # 2 Grade 2 x 6	1170	1350	625	1,600,000	180
Spruce Pine Fir (North) # 1 / 2 Grade 2 x 6	1138	1150	425	1,400,000	135
Hem-Fir # 2 Grade 2 x 6	1105	1300	405	1,300,000	150
Western Woods # 2 Grade 2 x 6	878	900	335	1,000,000	135

- Design values are for loads applied to the narrow face of the studs.
- Repetitive member factors have not been applied to the bending values. Depth (size) factors per ICC-ES®/APA® ESR-1040 and 2018 NDS have been applied to the corresponding bending values.
- Dimension lumber values taken from 2018 NDS Supplement: Design Values for Wood Construction (per 2018 IBC®/IRC®).

For further design information, please see Versa-Stud 1.8E 2400 Western Tall Wall Guide.

Glued laminated timbers from Boise Cascade Engineered Wood Products add functional beauty to any residential or commercial project.

Just ask for BOISE GLULAM® beams.

No discussion of engineered wood products is complete without mention of glued laminated timber. Glulams are sometimes forgotten in what has become an increasingly crowded field of newer products.

Laminated timbers are often the most cost-effective and easy-to-install alternative for beam applications to residential, commercial and light industrial construction. It is usually easy to determine whether to specify a balanced or unbalanced layup and whether to choose Architectural, Industrial or Framing Appearance Classification beams.

The benefit to BOISE GLULAM® beams is that they can be manufactured either with or without camber. Most stock beams are available with either a small amount of camber (5000' radius) or no camber, depending on market demands.

BOISE GLULAM® beams are manufactured primarily from Douglas Fir- Larch and other softwood species and carry the APA trademark.

STOCK BEAMS

For most residential applications, stock beams are the product of choice. BOISE GLULAM® stock beams are available through our trusted distributors, located strategically throughout the country. Our beams are manufactured in widths of 3⅞", 3½", 5⅞", 5½", 6¾", and 8¾", with depths ranging from 6" to 24" and lengths up to 66 feet, with or without camber. Stock beams are available in Architectural appearance classification except 3½" and 5½" which are Framing header classification only. Architectural Appearance is intended for exposed applications but can also be used for concealed beams, headers, columns, and rafters. Check with your local distributor for availability.

I-JOIST COMPATIBLE BEAMS

IJC (I-Joist Compatible) sizes are readily available. Consult your local distributor for availability. IJC sizes have proven to be cost-effective product options to other structural members such as LVL.

BOISE GLULAM® MANUFACTURING STANDARDS

PA Mill Number: 1107

APA EWS Trademarked Glulam Under These Standards:

- ANSI A190.1-2017
- CSA O122-16 and CSA O177-06



Rough Sawn Glulam
Just one of our appearance grades

KING BEAM® 3000

A high-strength glulam beam fabricated from select Douglas fir and southern pine laminates. The KING BEAM™ 3000 meets or exceeds all design values of parallel strand lumber, and has all the benefits and cost competitiveness of glulam. Boise Cascade design software and literature allows the product to be analyzed for all structural beam applications.

LAMINATED WOOD ROOF DECKING

The elegance of laminated wood decking will grace any building design where natural wood is desired. Boise Cascade decking is manufactured from Douglas fir, ponderosa pine, inland red cedar and Alaska yellow cedar. The face is a sound, tight-knot grade that is machine sanded to accentuate the grain and growth characteristics of the wood. The lumber is kiln-dried and laminated with a water-proof exterior phenolic resorcinol adhesive.

APPEARANCE GRADES

BOISE GLULAM® may be finished to several different appearance grades, which do not have any affect on strength values. As noted, stock beams in standard glulam widths (3⅞", 5⅞", 6¾", 8¾") are finished to the architectural appearance standard, the perfect look for most all applications. 3½" and 5½" wide beams have a framing grade appearance intended for enclosed applications. Premium appearance is available on a custom order basis for visible commercial and religious structure applications. For an old timber frame look, rough sawn appearance is available on all beams as well.

For availability on these and many other structural wood products,
please contact BOISE GLULAM® at 800 -237-4013

ARCHITECTURAL APPEARANCE BEAMS

These beams are the beams of choice in applications where members are exposed to view, because they have a smooth, attractive finish. Stock beams are often supplied with this appearance so they may be exposed to view in the finished structure. Voids greater than 3/4" are filled, three sides (excluding the top) are planed or sanded, and edges are eased on the bottom face of the member.

INDUSTRIAL APPEARANCE BEAMS

These beams are used in concealed applications or in other places where appearance is not of primary importance, such as such as commercial buildings, warehouses, and garages. Voids are not filled, and only the two wide faces are planed.

COLUMNS

Glulam columns are straight and dimensionally true, making framing an easy task. Because columns are available in long lengths, the members do not have to be spliced together, as is often necessary with sawn lumber. The columns can be exposed to view as a unique architectural feature of the framing system.

BOISE GLULAM® columns have all four edges eased to match the widths of the Architectural glulams beams and have the same architectural appearance. All sides may be exposed to view.



FRAMING GRADE APPEARANCE HEADERS

BOISE GLULAM® headers are commonly used in concealed spaces, such as within walls for headers above doors and windows, where appearance is not of importance. BOISE GLULAM® headers are available in two common widths, 3 1/2" and 5 1/2". Please check with your Boise Cascade representative for availability.

BALANCED AND UNBALANCED BEAM LAYUPS

The most critical areas of a glulam beam are the outside laminations. Thus, the strongest laminations are placed in these areas in either unbalanced or balanced layups.

In unbalanced beams, typically known as V4s, the bottom lamination is stronger than all the other laminations. This allows for a more efficient use of timber resources. It is very important to install unbalanced BOISE GLULAM® beams with the top side up. *(The word "top" is always printed on the corresponding side.)* V4 glulams may be designed and installed in both single and multiple-span applications, and in relatively short cantilevers.

Balanced glulam beams, or V8s, have the same high-strength laminations on both the top and bottom of the beam, creating a symmetric layup. A V8 glulam can be designed for multiple-span conditions and cantilevers. V8s can also be used for single spans, but V4s are most cost-effective for this type of application. V8 BOISE GLULAM® beams may be special ordered at an additional cost; check with your local distributor for availability.

LAYUP COMBINATIONS

Balanced Versus Unbalanced Layup Example

No. 2D	T.L.	T.L. = Tension Lamination
No. 2	No. 1	
No. 2	No. 2	
No. 3	No. 3	
No. 2	No. 2	
No. 1	No. 1	
T.L.	T.L.	
Unbalanced (V4)	Balanced (V8)	

CUSTOM GLULAM PRODUCTS AND CUTS

Larger beams sizes are available on a made-to-order basis, in depths up to 48" and widths of 12¼" or possibly wider subject to inquiry.

Curved beams may be custom ordered for specific length and radius specifications per the project's architect. Beams with standard 1½" thick laminations may be ordered with a radius not smaller than 27.5 ft. For tighter radius beams, ¾" thick laminations are utilized. Both single and double tapered beams may be manufactured for roof beam applications.

Custom cuts for bearing locations, top edges and cantilever ends are possible with the proper specification. Boise Cascade EWP Engineering can provide design assistance to the project's architect or engineer in the sizing of all custom products. For further information on specifications, ordering, and availability, please contact the BOISE GLULAM® sales office at 800-237-4013.



**Clamping of Tight Radius Curve –
¾" Thick Laminations**



Finished Curved Beams



Bevel Top Cut



Allowable Design Stresses

Product	Species	Grade	Bending F_b [psi]		Horizontal Shear F_v [psi]	Modulus of Elasticity E [psi]	Compression Parallel to Grain F_c [psi]	Compression Perp to Grain F_c [psi]
			Tension Zone in Tension	Compression Zone in Tension				
BOISE GLULAM®	Douglas fir	24F-V4	2400	1850	265	1,800,000	1650	650
		24F-V8	2400	2400	265	1,800,000	1650	650
		26F-V1	2600	1950	265	2,000,000	1850	650
KING BEAM™ 3000	Douglas fir / SYP	30F-E4	3000	3000	300	2,300,000	1800	650
BOISE CEDAR GLULAM™	Alaska Yellow Cedar	20F-V12	2000	1400	265	1,500,000	1500	560
	Port Orford Cedar	22F-V14	2200	1650	265	1,700,000	2100	560

Notes:

- Reductions factors shall be applied to design stresses in wet-use conditions.

BOISE GLULAM® 24F-V4 Design Values

Width (in)	Depth (in)	Weight (plf)	Allowable Shear (lbs)	Allowable Moment (ft-lbs)	Moment of Inertia (in ⁴)
3 1/8	6	4.6	3313	3750	56.3
	7 1/2	5.7	4141	5859	109.9
	9	6.8	4969	8438	189.8
	10 1/2	8.0	5797	11484	301.5
	12	9.1	6625	15000	450.0
	13 1/2	10.3	7453	18984	640.7
	15	11.4	8281	23438	878.9
	16 1/2	12.5	9109	28359	1169.8
	18	13.7	9938	33750	1518.8
	19 1/2	14.8	10766	39609	1931.0
	21	16.0	11594	45640	2411.7
	22 1/2	17.1	12422	52033	2966.3
	24	18.2	13250	58821	3600.0
3 1/2	4 1/2	3.8	2783	2363	26.6
	6	5.1	3710	4200	63.0
	7 1/2	6.4	4638	6563	123.0
	9	7.7	5565	9450	212.6
	10 1/2	8.9	6493	12863	337.6
	12	10.2	7420	16800	504.0
	13 1/2	11.5	8348	21263	717.6
	15	12.8	9275	26250	984.4
	16 1/2	14.0	10203	31763	1310.2
	18	15.3	11130	37709	1701.0
	19 1/2	16.6	12058	43903	2162.7
	21	17.9	12985	50541	2701.1
	22 1/2	19.1	13913	57620	3322.3
	24	20.4	14840	65137	4032.0

Width (in)	Depth (in)	Weight (plf)	Allowable Shear (lbs)	Allowable Moment (ft-lbs)	Moment of Inertia (in ⁴)
5 1/8	6	7.5	5433	6150	92.3
	7 1/2	9.3	6791	9609	180.2
	9	11.2	8149	13838	311.3
	10 1/2	13.1	9507	18834	494.4
	12	14.9	10865	24600	738.0
	13 1/2	16.8	12223	30770	1050.8
	15	18.7	13581	37589	1441.4
	16 1/2	20.6	14939	45052	1918.5
	18	22.4	16298	53151	2490.8
	19 1/2	24.3	17656	61881	3166.8
	21	26.2	19014	71237	3955.2
	22 1/2	28.0	20372	81215	4864.7
	24	29.9	21730	91810	5904.0
	25 1/2	31.8	23088	103019	7081.6
5 1/2	27	33.6	24446	114837	8406.3
	28 1/2	35.5	25804	127261	9886.6
	30	37.4	27163	140288	11531.3
	31 1/2	39.2	28521	153915	13348.9
	33	41.1	29879	168139	15348.1
	34 1/2	43.0	31237	182956	17537.6
	36	44.8	32595	198365	19926.0

BOISE GLULAM® 24F-V4 Design Values

49

Width (in)	Depth (in)	Weight (plf)	Allowable Shear (lbs)	Allowable Moment (ft-lbs)	Moment of Inertia (in ⁴)
5½	6	8.0	5830	6600	99.0
	7½	10.0	7288	10313	193.4
	9	12.0	8745	14850	334.1
	10½	14.0	10203	20213	530.6
	12	16.0	11660	26214	792.0
	13½	18.0	13118	32789	1127.7
	15	20.1	14575	40056	1546.9
	16½	22.1	16033	48008	2058.9
	18	24.1	17490	56638	2673.0
	19½	26.1	18948	65941	3398.5
	21	28.1	20405	75912	4244.6
	22¾	30.1	21863	86544	5220.7
	24	32.1	23320	97835	6336.0
	25½	34.1	24778	109779	7599.8
	27	36.1	26235	122372	9021.4
	28½	38.1	27693	135612	10610.0
	30	40.1	29150	149494	12375.0
	31½	42.1	30608	164015	14325.6
	33	44.1	32065	179172	16471.1
	34½	46.1	33523	194962	18820.8
	36	48.1	34980	211382	21384.0
6¾	7½	12.3	8944	12656	237.3
	9	14.8	10733	18225	410.1
	10½	17.2	12521	24457	651.2
	12	19.7	14310	31520	972.0
	13½	22.1	16099	39425	1384.0
	15	24.6	17888	48163	1898.4
	16½	27.1	19676	57724	2526.8
	18	29.5	21465	68102	3280.5
	19½	32.0	23254	79288	4170.9
	21	34.5	25043	91276	5209.3
	22½	36.9	26831	104061	6407.2
	24	39.4	28620	117636	7776.0
	25½	41.8	30409	131998	9327.0
	27	44.3	32198	147140	11071.7
	28½	46.8	33986	163059	13021.4
	30	49.2	35775	179750	15187.5
	31½	51.7	37564	197210	17581.4
	33	54.1	39353	215435	20214.6
	34½	56.6	41141	234421	23098.3
	36	59.1	42930	254164	26244.0
7¼	7½	13.2	9606	13594	254.9
	9	15.9	11528	19459	440.4
	10½	18.5	13449	26081	699.4
	12	21.1	15370	33614	1044.0
	13½	23.8	17291	42044	1486.5
	15	26.4	19213	51362	2039.1
	16½	29.1	21134	61559	2714.0
	18	31.7	23055	72625	3523.5
	19½	34.4	24976	84554	4479.8
	21	37.0	26898	97339	5595.2
	22½	39.6	28819	110973	6881.8
	24	42.3	30740	125450	8352.0
	25½	44.9	32661	140766	10017.9
	27	47.6	34583	156914	11891.8
	28½	50.2	36504	173890	13985.9
	30	52.9	38425	191691	16312.5
	31½	55.5	40346	210310	18883.8
	33	58.2	42268	229745	21711.9
	34½	60.8	44189	249992	24809.3
	36	63.4	46110	271047	28188.0

Width (in)	Depth (in)	Weight (plf)	Allowable Shear (lbs)	Allowable Moment (ft-lbs)	Moment of Inertia (in ⁴)
8¾	9	19.1	13913	23048	531.6
	10½	22.3	16231	30891	844.1
	12	25.5	18550	39812	1260.0
	13½	28.7	20869	49798	1794.0
	15	31.9	23188	60834	2460.9
	16½	35.1	25506	72911	3275.5
	18	38.3	27825	86018	4252.5
	19½	41.5	30144	100147	5406.7
	21	44.7	32463	115290	6752.8
	22½	47.9	34781	131438	8305.7
	24	51.0	37100	148585	10080.0
	25½	54.2	39419	166725	12090.6
	27	57.4	41738	185851	14352.2
	28½	60.6	44056	205958	16879.6
	30	63.8	46375	227041	19687.5
	31½	67.0	48694	249094	22790.7
	33	70.2	51013	272113	26204.1
	34 ½	73.4	53331	296094	29942.2
	36	76.6	55650	321032	34020.0
10¾	12	31.4	22790	47916	1548.0
	13½	35.3	25639	59933	2204.1
	15	39.2	28488	73216	3023.4
	16½	43.1	31336	87751	4024.2
	18	47.0	34185	103527	5224.5
	19½	51.0	37034	120531	6642.5
	21	54.9	39883	138756	8296.3
	22½	58.8	42731	158191	10204.1
	24	62.7	45580	178828	12384.0
	25½	66.6	48429	200660	14854.1
	27	70.5	51278	223679	17632.7
	28½	74.5	54126	247879	20737.8
	30	78.4	56975	273253	24187.5
	31½	82.3	59824	299795	28000.1
	33	86.2	62673	327499	32193.6
	34½	90.1	65521	356361	36786.2
	36	94.1	68370	386375	41796.0
12¼	13½	40.2	29216	67410	2511.6
	15	44.7	32463	82350	3445.3
	16½	49.1	35709	98698	4585.7
	18	53.6	38955	116441	5953.5
	19½	58.1	42201	135567	7569.4
	21	62.5	45448	156065	9453.9
	22½	67.0	48694	177924	11627.9
	24	71.5	51940	201136	14112.0
	25½	75.9	55186	225691	16926.8
	27	80.4	58433	251582	20093.1
	28½	84.9	61679	278801	23631.4
	30	89.3	64925	307340	27562.5
	31½	93.8	68171	337193	31907.0
	33	98.3	71418	368354	36685.7
	34½	102.7	74664	400816	41919.1
	36	107.2	77910	434574	47628.0

Notes:

1) Allowable moment calculated using glulam volume factor (C_v) with a span length of 21 ft. Allowable moment shall be multiplied by $(21/\text{Span Length [ft]})^{1/10}$ for longer spans.

BOISE GLULAM® 26F-V1 Design Values

Width (in)	Depth (in)	Weight (plf)	Allowable Shear (lbs)	Allowable Moment (ft-lbs)	Moment of Inertia (in ⁴)
3 ¹ / ₈	6	4.6	3313	4063	56.3
	7 ¹ / ₂	5.7	4141	6348	109.9
	9	6.8	4969	9141	189.8
	10 ¹ / ₂	8.0	5797	12441	301.5
	12	9.1	6625	16250	450.0
	13 ¹ / ₂	10.3	7453	20566	640.7
	15	11.4	8281	25391	878.9
	16 ¹ / ₂	12.5	9109	30723	1169.8
	18	13.7	9938	36563	1518.8
	19 ¹ / ₂	14.8	10766	42910	1931.0
	21	16.0	11594	49444	2411.7
	22 ³ / ₄	17.1	12422	56369	2966.3
	34 ¹ / ₂	18.2	13250	63723	3600.0
	24	48.1	34980	211382	21384.0
3 ¹ / ₂	6	3.8	2783	2559	26.6
	7 ¹ / ₂	5.1	3710	4550	63.0
	9	6.4	4638	7109	123.0
	10 ¹ / ₂	7.7	5565	10238	212.6
	12	8.9	6493	13934	337.6
	13 ¹ / ₂	10.2	7420	18200	504.0
	15	11.5	8348	23034	717.6
	16 ¹ / ₂	12.8	9275	28438	984.4
	18	14.0	10203	34409	1310.2
	19 ¹ / ₂	15.3	11130	40851	1701.0
	21	16.6	12058	47561	2162.7
	22 ³ / ₄	17.9	12985	54753	2701.1
	34 ¹ / ₂	19.1	13913	62422	3322.3
	24	20.4	14840	70565	4032.0
5 ¹ / ₈	6	7.5	5433	6663	92.3
	7 ¹ / ₂	9.3	6791	10410	180.2
	9	11.2	8149	14991	311.3
	10 ¹ / ₂	13.1	9507	20404	494.4
	12	14.9	10865	26650	738.0
	13 ¹ / ₂	16.8	12223	33334	1050.8
	15	18.7	13581	40722	1441.4
	16 ¹ / ₂	20.6	14939	48806	1918.5
	18	22.4	16298	57580	2490.8
	19 ¹ / ₂	24.3	17656	67038	3166.8
	21	26.2	19014	77174	3955.2
	22 ¹ / ₂	28.0	20372	87983	4864.7
	24	29.9	21730	99461	5904.0
	25 ¹ / ₂	31.8	23088	111604	7081.6
	27	33.6	24446	124407	8406.3
	28 ¹ / ₂	35.5	25804	137866	9886.6
	30	37.4	27163	151979	11531.3
	31 ¹ / ₂	39.2	28521	166741	13348.9
	33	41.1	29879	182150	15348.1
	34 ¹ / ₂	43.0	31237	198202	17537.6
	36	44.8	32595	214896	19926.0

Notes:
 1) Allowable moment calculated using glulam volume factor (C_v) with a span length of 21 ft. Allowable moment shall be multiplied by (21/Span Length [ft])^{1/10} for longer spans.

Width (in)	Depth (in)	Weight (plf)	Allowable Shear (lbs)	Allowable Moment (ft-lbs)	Moment of Inertia (in ⁴)
5 ¹ / ₂	6	8.0	5830	7150	99.0
	7 ¹ / ₂	10.0	7288	11172	193.4
	9	12.0	8745	16088	334.1
	10 ¹ / ₂	14.0	10203	21897	530.6
	12	16.0	11660	28399	792.0
	13 ¹ / ₂	18.0	13118	35521	1127.7
	15	20.1	14575	43394	1546.9
	16 ¹ / ₂	22.1	16033	52008	2058.9
	18	24.1	17490	61358	2673.0
	19 ¹ / ₂	26.1	18948	71437	3398.5
	21	28.1	20405	82238	4244.6
	22 ¹ / ₂	30.1	21863	93757	5220.7
	24	32.1	23320	105988	6336.0
	25 ¹ / ₂	34.1	24778	118927	7599.8
	27	36.1	26235	132570	9021.4
	28 ¹ / ₂	38.1	27693	146913	10610.0
	30	40.1	29150	161952	12375.0
	31 ¹ / ₂	42.1	30608	177683	14325.6
	33	44.1	32065	194103	16471.1
	34 ¹ / ₂	46.1	33523	211208	18820.8
	36	48.1	34980	228997	21384.0
6 ³ / ₄	7 ¹ / ₂	12.3	8944	13711	237.3
	9	14.8	10733	19744	410.1
	10 ¹ / ₂	17.2	12521	26495	651.2
	12	19.7	14310	34146	972.0
	13 ¹ / ₂	22.1	16099	42711	1384.0
	15	24.6	17888	52177	1898.4
	16 ¹ / ₂	27.1	19676	62535	2526.8
	18	29.5	21465	73777	3280.5
	19 ¹ / ₂	32.0	23254	85895	4170.9
	21	34.5	25043	98882	5209.3
	22 ¹ / ₂	36.9	26831	112732	6407.2
	24	39.4	28620	127439	7776.0
	25 ¹ / ₂	41.8	30409	142997	9327.0
	27	44.3	32198	159402	11071.7
	28 ¹ / ₂	46.8	33986	176647	13021.4
	30	49.2	35775	194730	15187.5
7 ¹ / ₄	31 ¹ / ₂	51.7	37564	213645	17581.4
	33	54.1	39353	233388	20214.6
	34 ¹ / ₂	56.6	41141	253956	23098.3
	36	59.1	42930	275345	26244.0
	7 ¹ / ₂	13.2	9606	14727	254.9
	9	15.9	11528	21081	440.4
	10 ¹ / ₂	18.5	13449	28255	699.4
	12	21.1	15370	36415	1044.0
	13 ¹ / ₂	23.8	17291	45548	1486.5
	15	26.4	19213	55642	2039.1
	16 ¹ / ₂	29.1	21134	66689	2714.0
	18	31.7	23055	78677	3523.5
	19 ¹ / ₂	34.4	24976	91601	4479.8
	21	37.0	26898	105451	5595.2
	22 ¹ / ₂	39.6	28819	120221	6881.8
	24	42.3	30740	135905	8352.0
	25 ¹ / ₂	44.9	32661	152496	10017.9
	27	47.6	34583	169990	11891.8
	28 ¹ / ₂	50.2	36504	188381	13985.9
	30	52.9	38425	207665	16312.5
	31 ¹ / ₂	55.5	40346	227836	18883.8
	33	58.2	42268	248891	21711.9
	34 ¹ / ₂	60.8	44189	270825	24809.3
	36	63.4	46110	293635	28188.0

BOISE GLULAM® IJC 24F-V4 Design Values

Width (in)	Depth (in)	Weight (plf)	Allowable Shear (lbs)	Allowable Moment (ft-lbs)	Moment of Inertia (in ⁴)
3½	9½	8.1	5874	10529	250.1
	11⅞	10.1	7343	16452	488.4
	14	11.9	8657	22867	800.3
	16	13.6	9893	29867	1194.7
	18	15.3	11130	37709	1701.0
	20	17.0	12367	46066	2333.3
	22	18.7	13603	55212	3105.7
	24	20.4	14840	65137	4032.0
5½	9½	12.7	9231	16546	393.0
	11 7/8	15.9	11539	25698	767.5
	14	18.7	13603	35135	1257.7
	16	21.4	15547	45281	1877.3
	18	24.1	17490	56638	2673.0
	20	26.7	19433	69191	3666.7
	22	29.4	21377	82927	4880.3
	24	32.1	23320	97835	6336.0
7¼	9½	16.7	12168	21565	518.0
	11⅞	20.9	15210	32951	1011.7
	14	24.7	17932	45052	1657.8
	16	28.2	20493	58063	2474.7
	18	31.7	23055	72625	3523.5
	20	35.2	25617	88721	4833.3
	22	38.8	28178	106334	6433.2
	24	42.3	30740	125450	8352.0

BOISE GLULAM® IJC 26F-V1 Design Values

Width (in)	Depth (in)	Weight (plf)	Allowable Shear (lbs)	Allowable Moment (ft-lbs)	Moment of Inertia (in ⁴)
3½	9½	8.1	5874	11407	250.1
	11⅞	10.1	7343	17823	488.4
	14	11.9	8657	24772	800.3
	16	13.6	9893	32356	1194.7
	18	15.3	11130	40851	1701.0
	20	17.0	12367	49905	2333.3
	22	18.7	13603	59813	3105.7
	24	20.4	14840	70565	4032.0
5½	9½	12.7	9231	17925	393.0
	11⅞	15.9	11539	27839	767.5
	14	18.7	13603	38063	1257.7
	16	21.4	15547	49055	1877.3
	18	24.1	17490	61358	2673.0
	20	26.7	19433	74957	3666.7
	22	29.4	21377	89838	4880.3
	24	32.1	23320	105988	6336.0
7¼	9½	16.7	12168	23362	518.0
	11⅞	20.9	15210	35697	1011.7
	14	24.7	17932	48806	1657.8
	16	28.2	20493	62901	2474.7
	18	31.7	23055	78677	3523.5
	20	35.2	25617	96115	4833.3
	22	38.8	28178	115196	6433.2
	24	42.3	30740	135905	8352.0

Width (in)	Depth (in)	Weight (plf)	Allowable Shear (lbs)	Allowable Moment (ft-lbs)	Moment of Inertia (in ⁴)
3½	7¼	6.2	5075	7665	111.1
	9½	8.1	6650	13161	250.1
	11⅞	10.1	8313	20565	488.4
	14	11.9	9800	28583	800.3
	16	13.6	11200	37333	1194.7
	18	15.3	12600	47136	1701.0
	20	17.0	14000	57583	2333.3
	22	18.7	15400	69015	3105.7
	24	20.4	16800	81421	4032.0
	25	21.7	17850	91362	4836.2
	26	22.1	18200	94795	5126.3
	28	23.8	19600	109128	6402.7
	30	25.5	21000	124414	7875.0
5½	7¼	9.7	7975	12046	174.7
	9½	12.7	10450	20682	393.0
	11⅞	15.9	13063	32122	767.5
	14	18.7	15400	43918	1257.7
	16	21.4	17600	56602	1877.3
	18	24.1	19800	70798	2673.0
	20	26.7	22000	86489	3666.7
	22	29.4	24200	103659	4880.3
	24	32.1	26400	122294	6336.0
	25	34.1	28050	137224	7599.8
	26	34.8	28600	142381	8055.7
	28	37.4	30800	163909	10061.3
	30	40.1	33000	186867	12375.0
7	7¼	12.3	10150	15331	222.3
	9½	16.2	13300	26118	500.1
	11⅞	20.2	16625	39909	976.8
	14	23.8	19600	54564	1600.7
	16	27.2	22400	70322	2389.3
	18	30.6	25200	87959	3402.0
	20	34.0	28000	107454	4666.7
	22	37.4	30800	128786	6211.3
	24	40.8	33600	151938	8064.0
	25	43.4	35700	170487	9672.5
	26	44.2	36400	176894	10252.7
	28	47.6	39200	203641	12805.3
	30	51.0	42000	232164	15750.0

Alaska Yellow Cedar 20F-V12 Design Values

Width (in)	Depth (in)	Weight (plf)	Allowable Shear (lbs)	Allowable Moment (ft-lbs)	Moment of Inertia (in ⁴)
3⅜	6	4.6	3313	3125	56.3
	7½	5.7	4141	4883	109.9
	9	6.8	4969	7031	189.8
	10½	8.0	5797	9570	301.5
	12	9.1	6625	12500	450.0
	13½	10.3	7453	15820	640.7
	15	11.4	8281	19531	878.9
	16½	12.5	9109	23633	1169.8
	18	13.7	9938	28125	1518.8
	19½	14.8	10766	33008	1931.0
	21	16.0	11594	38034	2411.7
	22¾	17.1	12422	43361	2966.3
	24	18.2	13250	49018	3600.0
5⅝	6	7.5	5433	5125	92.3
	7½	9.3	6791	8008	180.2
	9	11.2	8149	11531	311.3
	10½	13.1	9507	15695	494.4
	12	14.9	10865	20500	738.0
	13½	16.8	12223	25642	1050.8
	15	18.7	13581	31324	1441.4
	16½	20.6	14939	37543	1918.5
	18	22.4	16298	44292	2490.8
	19½	24.3	17656	51567	3166.8
	21	26.2	19014	59364	3955.2
	22¾	28.0	20372	67679	4864.7
	24	29.9	21730	76509	5904.0
6¾	7½	12.3	8944	10547	237.3
	9	14.8	10733	15188	410.1
	10½	17.2	12521	20381	651.2
	12	19.7	14310	26267	972.0
	13½	22.1	16099	32854	1384.0
	15	24.6	17888	40136	1898.4
	16½	27.1	19676	48104	2526.8
	18	29.5	21465	56751	3280.5
	19½	32.0	23254	66073	4170.9
	21	34.5	25043	76063	5209.3
	22¾	36.9	26831	86717	6407.2
	24	39.4	28620	98030	7776.0

Notes:

1) Allowable moment calculated using glulam volume factor (C_v) with a span length of 21 ft. Allowable moment shall be multiplied by $(21/\text{Span Length [ft]})^{1/10}$ for longer spans.

Port Orford Cedar 22F-V14 Design Values

Width (in)	Depth (in)	Weight (plf)	Allowable Shear (lbs)	Allowable Moment (ft-lbs)	Moment of Inertia (in ⁴)
3⅜	6	4.6	3313	3438	56.3
	7½	5.7	4141	5371	109.9
	9	6.8	4969	7734	189.8
	10½	8.0	5797	10527	301.5
	12	9.1	6625	13750	450.0
	13½	10.3	7453	17402	640.7
	15	11.4	8281	21484	878.9
	16½	12.5	9109	25996	1169.8
	18	13.7	9938	30938	1518.8
	19½	14.8	10766	36309	1931.0
	21	16.0	11594	41837	2411.7
	22¾	17.1	12422	47697	2966.3
	24	18.2	13250	53919	3600.0
5⅝	6	7.5	5433	5638	92.3
	7½	9.3	6791	8809	180.2
	9	11.2	8149	12684	311.3
	10½	13.1	9507	17265	494.4
	12	14.9	10865	22550	738.0
	13½	16.8	12223	28206	1050.8
	15	18.7	13581	34457	1441.4
	16½	20.6	14939	41297	1918.5
	18	22.4	16298	48721	2490.8
	19½	24.3	17656	56724	3166.8
	21	26.2	19014	65301	3955.2
	22¾	28.0	20372	74447	4864.7
	24	29.9	21730	84160	5904.0
6¾	7½	12.3	8944	11602	237.3
	9	14.8	10733	16706	410.1
	10½	17.2	12521	22419	651.2
	12	19.7	14310	28893	972.0
	13½	22.1	16099	36140	1384.0
	15	24.6	17888	44149	1898.4
	16½	27.1	19676	52914	2526.8
	18	29.5	21465	62426	3280.5
	19½	32.0	23254	72680	4170.9
	21	34.5	25043	83670	5209.3
	22¾	36.9	26831	95389	6407.2
	24	39.4	28620	107833	7776.0

Notes:

1) Allowable moment calculated using glulam volume factor (C_v) with a span length of 21 ft. Allowable moment shall be multiplied by $(21/\text{Span Length [ft]})^{1/10}$ for longer spans.

BOISE CEDAR GLULAM™ can be used as columns. Please contact BOISE GLULAM® at 800-237-4013 for additional information.

BOISE GLULAM® COLUMNS

Allowable Axial Load — Combination 3 Column Grade

Column Length [ft]	3 1/8" Wide Column Allowable Axial Load (lb)						5 1/8" Wide Column Allowable Axial Load (lb)								
	3 1/8" x 6"			3 1/8" x 7 1/2"			5 1/8" x 5 1/8"			5 1/8" x 6"			5 1/8" x 7 1/2"		
	100%	115%	125%	100%	115%	125%	100%	115%	125%	100%	115%	125%	100%	115%	125%
4	20,200	22,160	23,340	25,260	27,710	29,180	31,380	35,530	38,170						
5	16,940	18,150	18,850	21,180	22,690	23,570	29,520	33,080	35,340	35,890	40,450	43,330			
6	13,890	14,650	15,090	17,370	18,320	18,860	27,360	30,300	32,110	33,760	37,640	39,950			
7	11,400	11,920	12,210	14,260	14,890	15,270	24,990	27,300	28,690	31,060	33,850	35,520	34,870	37,470	38,990
8	9,460	9,820	10,030	11,830	12,280	12,530	22,530	24,270	25,290	27,870	29,960	31,180	30,990	32,950	34,080
9	7,940	8,210	8,360	9,930	10,260	10,450	20,110	21,440	22,210	24,780	26,340	27,250	27,470	28,960	29,830
10	6,750	6,950	7,060	8,440	8,690	8,830	17,900	18,920	19,520	21,970	23,160	23,850	24,380	25,550	26,220
11	5,800	5,950	6,040	7,250	7,440	7,550	15,940	16,760	17,230	19,490	20,430	20,970	21,700	22,640	23,190
12	5,030	5,150	5,220	6,290	6,440	6,530	14,240	14,900	15,280	17,350	18,110	18,530	19,400	20,160	20,600
13	4,400	4,500	4,550	5,500	5,620	5,698	12,770	13,310	13,610	15,520	16,120	16,480	17,420	18,050	18,410
14							11,500	11,940	12,200	13,930	14,440	14,720	15,720	16,240	16,540
15							10,400	10,770	10,980	12,570	12,980	13,220	14,240	14,670	14,930
16							9,440	9,750	9,930	11,380	11,740	11,930	12,950	13,320	13,530
17							8,600	8,860	9,010	10,350	10,650	10,820	11,820	12,140	12,320
18							7,860	8,090	8,220	9,450	9,710	9,850	10,830	11,100	11,270
19							7,220	7,410	7,520	8,660	8,880	9,010	9,960	10,200	10,340
20							6,640	6,810	6,910	7,960	8,160	8,260	9,190	9,390	9,510
21							6,130	6,280	6,370	7,340	7,510	7,610	8,580	8,780	8,900
22															
23															
24															

Column Length [ft]	6¾" Wide Column Allowable Axial Load (lb)						8¾" Wide Column Allowable Axial Load (lb)			Notes: 1) Table assumes that the column is braced at column ends only. Effective column length is equal to actual column length. 2) Allowable loads are based on one-piece column members used in dry service conditions. 3) Allowable loads are based on an eccentricity value equal to 0.167 multiplied by the column thickness or width (worst case). 4) Allowable loads are based on axial loading columns using the design provisions of the National Design Specification for Wood Construction (NDS), 2001 edition. For side or other combined bending and axial loads, use BC Calc® software to analyze such conditions. 5) See below for allowable design stresses. 6) Load values are not shown for short lengths due to loads exceeding common connector capacities. Load values are not shown for longer lengths if the controlling slenderness ratio exceeds 50 (per NDS). 7) It may be possible to exceed the limitations of the table by analyzing a specific application with the BC Calc® software.
	6¾" x 6"			6¾" x 7½"			8¾" x 9"			
	100%	115%	125%	100%	115%	125%	100%	115%	125%	
4										
5										
6										
7										
8										
9	35,920	38,870	40,620							
10	32,700	35,020	36,390							
11	29,620	31,470	32,540							
12	26,820	28,310	29,180	39,870	42,340	43,790				
13	24,310	25,530	26,240	36,390	38,420	39,600				
14	22,080	23,100	23,680	33,240	34,920	35,900				
15	20,100	20,960	21,460	30,410	31,830	32,640				
16	18,360	19,090	19,500	27,870	29,070	29,760				
17	16,820	17,440	17,800	25,620	26,650	27,230				
18	15,460	15,990	16,300	23,600	24,480	24,990				
19	14,250	14,710	14,970	21,800	22,570	23,000				
20	13,170	13,570	13,800	20,180	20,850	21,240				
21	12,200	12,550	12,750	18,730	19,320	19,650				
22	11,330	11,640	11,820	17,430	17,940	18,240	39,360	41,030	41,950	
23	10,550	10,820	10,980	16,250	16,710	16,970	36,940	38,400	39,250	
24	9,840	10,090	10,230	15,180	15,590	15,820	34,710	36,020	36,760	
25							32,660	33,830	34,510	
26							30,780	31,840	32,440	
27							29,060	30,010	30,560	
28							27,460	28,330	28,830	
29							26,000	26,780	27,240	
30							24,630	25,360	25,780	

BOISE GLULAM® Column Allowable Design Stresses

Combination 3 Column Grade

Compression Parallel to Grain F_c [psi]	Bending F_b [psi]		Modulus of Elasticity E [psi]		Compression Perpendicular to Grain (limiting direction) F_c [psi]	Tension Parallel to Grain F_t [psi]
	Load Perpendicular to Gluelines	Load Parallel to Gluelines	Load Perpendicular to Gluelines	Load Parallel to Gluelines		
2300	2000	2100	1,900,000	1,900,000	650	1450


Equivalent specific gravity for fastener design: SG = 0.5.

BOISE GLULAM® BEAM HANGERS




Width	Depth	Top Mount Hanger		Face Mount Hanger	
		Model No. ⁽¹⁾	Allow Load (Floor 100%)	Model No. ⁽¹⁾	Allow Load (Floor 100%)
3 ¹ / ₈ "	6"	HW3.25X	5285	HU26-2	1610
	7 ¹ / ₂ "	GLT3	8165	HU28-2	1875
	9" - 10 ¹ / ₂ "	GLT3	8165	HGUS3.25/10	8780
	12"	GLT3	8165	HGUS3.25/12	9155
	13 ¹ / ₂ " - 18"	HGLT3	11590	HGUS3.25/12	9155
3 ¹ / ₂ "	7 ¹ / ₂ "	HW3.56X	5285	HGUS48	6805
	9"	GLTV4	7000	HGUS48	6805
	10 ¹ / ₂ " - 12"	GLTV4	7000	HGUS412	9155
	13 ¹ / ₂ " - 15"	HGLTV4	8665	HGUS414	10015
5 ¹ / ₈ "	6"	HW5.25X	5285	HU38-2	2015
	7 ¹ / ₂ "	GLT5	8165	HU38-2	2015
	9"	GLT5	8165	HU310-2	2015
	10 ¹ / ₂ " - 12"	GLT5	8165	HGUS5.25/12	9155
	13 ¹ / ₂ " - 16 ¹ / ₂ "	HGLT5	11930	HGUS5.25/12	9155
	18" - 19 ¹ / ₂ "	MEG5	19710	HGUS5.25/12	9155
5 ¹ / ₂ "	21" - 24"	EG5	20895	---	---
	9" - 10 ¹ / ₂ "	GLTV6	7000	HGUS5.50/10	8780
	12"	GLTV6	7000	HGUS5.50/12	9155
6 ³ / ₄ "	7 ¹ / ₂ "	GLT7	8165	---	---
	9" - 10 ¹ / ₂ "	GLT7	8165	HGUS6.88/10	8780
	12"	GLT7	8165	HGUS6.88/12	9835
	13 ¹ / ₂ " - 16 ¹ / ₂ "	HGLT7	11930	HGUS6.88/14	11110
	18" - 24"	EG7	25320	HGU7.00	14060
8 ³ / ₄ "	9" - 10 ¹ / ₂ "	HGLT9	12750	---	---
	12" - 15"	HGLT9	12750	HGU9.00	14060


- 1) Specify height when ordering.
- 2) Specify width when ordering.
- 3) Loads assume Douglas Fir-Larch/Douglas Fir-Larch configuration, adjust accordingly for other wood species.
- 4) Consult current Simpson products catalog for required fasteners, design values and other information at 1-800-999-5099 or visit their website at www.strongtie.com.




EG




GLT




HGLT

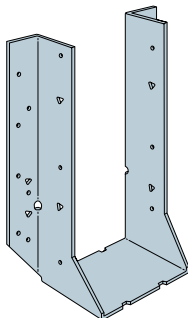


HU



HGUS

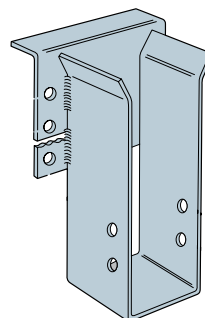

LEG/MEG



WP




BOISE GLULAM® BEAM HANGERS


Width	Depth	Top Mount Hanger		Face Mount Hanger	
		Model No. ⁽¹⁾	Allow Load (Floor 100%)	Model No. ⁽¹⁾	Allow Load (Floor 100%)
3 1/8"	6"	KHW3	5295	HD26-2	1680
	7 1/2"	KGLT3	7545	HD28-2	1960
	9" - 10 1/2"	KGLT3	7545	THDH3210	8170
	12"	KGLT3	7545	THDH3212	9870
	13 1/2" - 18"	KHGLT3	12965	THDH3212	9870
3 1/2"	7 1/2"	KGLT4	7545	THDH48	6465
	9"	KGLT4	7545	THDH410	8170
	10 1/2" - 12"	KGLT4	7545	THDH412	9875
	13 1/2" - 15"	KGLT4	7545	THDH414	11100
5 1/8"	6"	KGLT5	7545	THDH26-3	3880
	7 1/2"	KGLT5	7545	THDH28-3	6465
	9"	KGLT5	7545	THDH5210	8640
	10 1/2"	KGLT5	7545	THDH5210	8640
	12"	KGLT5	7545	THDH5212	9935
	13 1/2" - 16 1/2"	KHGLT5	12965	THDH614	11645
	18" - 19 1/2"	KMEG5	12185	THDH614	11645
	21" - 24"	KEG5	16115	THDH614	11645
5 1/2"	9" - 10 1/2"	KGLT6	7545	THDH610	8640
	12"	KGLT6	7545	THDH612	9935
6 3/4"	7 1/2"	KGLT7	7545	GHF67750	3505
	9" - 10 1/2"	KGLT7	7545	THDH6710	8170
	12"	KGLT7	7545	THDH6712	9875
	13 1/2" - 16 1/2"	KHGLT7	13400	THDH6714	11580
	18" - 24"	KEG7	17005	THDH6714	11580
8 3/4"	9" - 15"	KHGLT9	13400	-- --	-- --

- 1) Specify height when ordering.
- 2) Loads assume Douglas Fir-Larch header/joist material, adjust for other species.
- 3) KGLT load values based on 460 psi perpendicular to grain loading. KHGLT load values based on 625 psi perpendicular to grain loading.
- 4) Loads depicted are for 100% duration of load factors. Refer to USP Full Line Catalog for load values applicable to other durations of load.


- 5) KEG and KMEG load values are for a supporting member with a width of 5 1/2" and 460 psi perpendicular to grain loading in single shear.
- 6) For additional product information on loading, web stiffeners, nail schedules, and code evaluations, call 1-800-328-5934 or visit their website @ www.USPconnectors.com.




GHF




HD




KEG




KGLT



KHW



KMEG




THDH

BC Framer®

BC Framer® helps customers create floor and roof framing layouts quickly. This easy-to-use computer-aided 3D drafting program frames layouts and creates piece and price reports. It also draws framing drawings that use Boise Cascade's engineered wood products (EWP) and develops schedules. BC Framer's editing and drawing tools allow flexibility when modifying framing layouts. You can also customize the layout drawing with framing details, notes, symbols, and accessories.

Information can also be obtained at 1-800-405-5969 or email us at EWPSupport@BC.com.

Technical Specs: This program is designed to work on stand-alone computers.

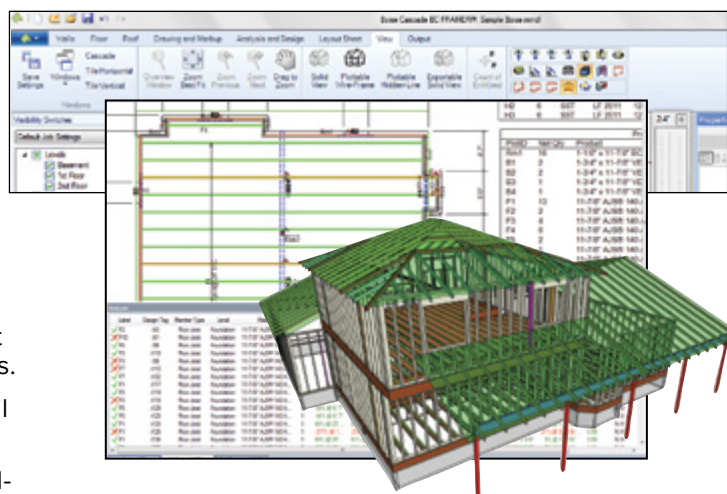

RECOMMENDED HARDWARE

- CPU: 2.8GHz 6th Gen+ Core i7 or Xeon v4+
- L2 Cache: 3MB/Core
- RAM: 16GB
- Video: Full support for DirectX 9; Single monitor 512MB; Dual monitor 1GB (Resolution 1366x768 Minimum)
- Free Storage: 80GB (average 6,000-8,000 jobs)
- Operating Systems: Windows 10 (Pro or Enterprise Edition 64-bit)*, Windows 8.1 (Professional Edition 64-bit), Windows 7 (Professional Edition 64-bit),

*Apple Mac or Windows Emulator not supported

Actual specifications vary by user and will be assessed prior to installation.

BC Calc® Sizing Software

BC Calc® is now a web-based application available at www.bccalc.com and can be used on Windows or Apple operating systems via Internet Explorer, Edge, Chrome or Safari browsers as well as on iOS and Android tablets. An offline version is available to BC Connect® or registered BC Calc® users for use without an internet connection or in cases of limited connection availability. It can be downloaded once users have signed in to the application.

In addition to BCI® & AJS® Joists, Versa-Lam® LVL, and BOISE GLULAM®, BC Calc® also offers the analysis of solid sawn lumber and timber members. Thus BC Calc® is the only program needed to analyze structural wood members.

BC Calc®


















Boise Cascade has provided BC Calc® free of charge to the design community since 1994.

COMPUTER REQUIREMENTS

PC with any current version of MS Windows®, along with an internet connection. For questions regarding BC Calc®, call 1-800-405-5969 or email EWPSupport@BC.com.

To Download BC CALC US, www.bccalc.com

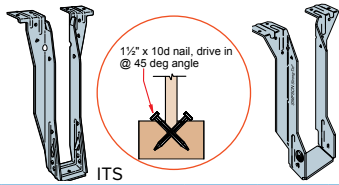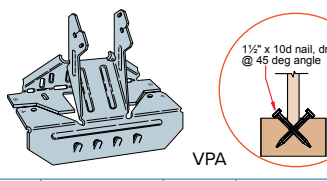Single Joist - Top Flange						Single Joist - Face Mount						Face Mount Skewed 45° Joist Hanger					
																	
Joist Depth	BCI*	Hanger	Capacity [lbs]	Nailing		Joist Depth	BCI*	Hanger	Capacity [lbs]	Nailing		Joist Depth	BCI*	Hanger	Capacity [lbs]	Nailing	
				Header	Joist					Header	Joist					Header	Joist
9 1/2"	5000 1.7	ITS2.06/9.5	993	6-10d	2-10dx1 1/2"	9 1/2"	5000 1.7	IUS2.06/9.5	935	8-10d	-	9 1/2"	5000 1.7	SUR/L2.06/9	1251	14-16d	6-10dx1 1/2"
	6000 1.8	ITS2.37/9.5	1225	6-10d	2-10dx1 1/2"		6000 1.8	IUS2.37/9.5	935	8-10d	-		6000 1.8	SUR/L2.37/9	1417	14-16d	6-10dx1 1/2"
	6500 1.8	ITS2.56/9.5	1225	6-10d	2-10dx1 1/2"		6500 1.8	IUS2.56/9.5	935	8-10d	-		6500 1.8	SUR/L2.56/9	1417	14-16d	6-10dx1 1/2"
	5000 1.7	ITS2.06/11.88	1068	6-10d	2-10dx1 1/2"		5000 1.7	IUS2.06/11.88	1068	10-10d	-		5000 1.7	SUR/L2.06/11	1467	14-16d	6-10dx1 1/2"
11 1/8"	5000 1.8	ITS2.37/11.88	1237	6-10d	2-10dx1 1/2"	11 1/8"	6000 1.8	IUS2.37/11.88	1170	10-10d	-	11 1/8"	6000 1.8	SUR/L2.37/11	1467	16-16d	6-10dx1 1/2"
	6500 1.8	ITS2.56/11.88	1237	6-10d	2-10dx1 1/2"		6500 1.8	IUS2.56/11.88	1170	10-10d	-		6500 1.8	SUR/L2.56/11	1467	14-16d	2-10dx1 1/2"
	60 2.0	ITS2.37/11.88	1210	6-10d	2-10dx1 1/2"		60 2.0	IUS2.37/11.88	1170	10-10d	-		60 2.0	SUR/L2.37/11	1466	14-16d	6-10dx1 1/2"
	90 2.0	ITS3.56/11.88	1478	6-10d	2-10dx1 1/2"		90 2.0	IUS3.56/11.88	1405	10-10d	-		90 2.0	SUR/L410	1860	14-16d	6-16d
14"	5000 1.7	ITS2.06/14	1081	6-10d	2-10dx1 1/2"	14"	5000 1.7	IUS2.06/14	1081	12-10d	-	14"	5000 1.7	SUR/L2.06/11	1693	18-16d	8-10dx1 1/2"
	6000 1.8	ITS2.37/14	1262	6-10d	2-10dx1 1/2"		6000 1.8	IUS2.37/14	1262	12-10d	-		6000 1.8	SUR/L2.37/14	1693	18-16d	8-10dx1 1/2"
	6500 1.8	ITS2.56/14	1262	6-10d	2-10dx1 1/2"		6500 1.8	IUS2.56/14	1262	12-10d	-		6500 1.8	SUR/L2.56/14	1693	18-16d	8-10dx1 1/2"
	60 2.0	ITS2.37/14	1225	6-10d	2-10dx1 1/2"		60 2.0	IUS2.37/14	1225	12-10d	-		60 2.0	SUR/L2.37/14	1689	18-16d	8-10dx1 1/2"
16"	90 2.0	ITS3.56/14	1507	6-10d	2-10dx1 1/2"	16"	90 2.0	IUS3.56/14	1405	12-10d	-	16"	90 2.0	SUR/L414	2035	18-16d	8-16d
	5000 1.8	ITS2.37/16	1268	6-10d	2-10dx1 1/2"		6000 1.8	IUS2.37/16	1268	14-10d	-		6000 1.8	SUR/L2.37/14	1920	18-16d	8-10dx1 1/2"
	6500 1.8	ITS2.56/16	1362	6-16d	2-10dx1 1/2"		6500 1.8	IUS2.56/16	1268	14-10d	-		6500 1.8	SUR/L2.56/14	1920	18-16d	8-10dx1 1/2"
	60 2.0	ITS2.37/16	1228	6-16d	2-10dx1 1/2"		60 2.0	IUS2.37/16	1228	14-10d	-		60 2.0	SUR/L2.37/14	1912	18-16d	8-10dx1 1/2"
18"	90 2.0	ITS3.56/16	1520	6-10d	2-10dx1 1/2"	18"	90 2.0	IUS3.56/16	1640	14-10d	-	18"	90 2.0	SUR/L414	2235	18-16d	8-16d
	90 2.0	MIT418	2400	6-16d	2-10dx1 1/2"		90 2.0	MIU3.56/18	2407	22-16d	2-10dx1 1/2"		90 2.0	SUR/L414	2395	18-16d	8-16d
20"	90 2.0	MIT420	2400	6-16d	2-10dx1 1/2"	20"	90 2.0	MIU3.56/20	2564	24-16d	2-10dx1 1/2"	20"	90 2.0	SUR/L414	2395	18-16d	8-16d
Double Joist - Top Flange						Double Joist - Face Mount						Variable Pitch Joist Connector					
																	
Joist Depth	BCI*	Hanger	Capacity [lbs]	Nailing		Joist Depth	BCI*	Hanger	Capacity [lbs]	Nailing		Joist Depth	BCI*	Hanger	Capacity [lbs]	Fastener	
				Header	Joist					Header	Joist				Top Plate	Rafter	
9 1/2"	5000 1.7	MIT4.12/9.5	2305	10-16d	2-10dx1 1/2"	9 1/2"	5000 1.7	MIU4.12/9	2270	14-16d	6-10d	9 1/2"	5000 1.7	VPA2.06	993	8-10d	2-10dx1 1/2"
	6000 1.8	MIT359.5-2	2400	8-16d	2-10dx1 1/2"		6000 1.8	MIU4.75/9	1860	14-16d	2-10dx1 1/2"		6000 1.8	VPA35	1225	8-10d	2-10dx1 1/2"
	6500 1.8	MIT39.5	2400	8-16d	2-10dx1 1/2"		6500 1.8	MIU5.12/9	2270	14-16d	2-10dx1 1/2"		6500 1.8	VPA3	1225	9-10d	2-10dx1 1/2"
	5000 1.7	MIT4.12/11.88	2305	10-16d	2-10dx1 1/2"		5000 1.7	MIU4.12/11	2840	16-16d	6-10d		5000 1.7	VPA2.06	1068	8-10d	2-10dx1 1/2"
11 1/8"	6000 1.8	MIT3511.88-2	2000	8-16d	2-10dx1 1/2"	11 1/8"	6000 1.8	MIU4.75/11	2130	16-16d	2-10dx1 1/2"	11 1/8"	6000 1.8	VPA35	1230	8-10d	2-10dx1 1/2"
	6500 1.8	MIT311.88-2	2400	8-16d	2-10dx1 1/2"		6500 1.8	MIU5.12/11	2840	16-16d	2-10dx1 1/2"		6500 1.8	VPA3	1230	9-10d	2-10dx1 1/2"
	60 2.0	MIT3511.88-2	2000	8-16d	2-10dx1 1/2"		60 2.0	MIU4.75/11	2130	16-16d	2-10dx1 1/2"		60 2.0	VPA35	1210	9-10d	2-10dx1 1/2"
	90 2.0	B712/11.88	3785	14-16d	6-16d		90 2.0	HU412-2	2145	16-16d	6-16d		90 2.0	VPA4	1230	11-10d	2-10dx1 1/2"
14"	5000 1.7	MIT4.12/14	2305	8-16d	2-10dx1 1/2"	14"	5000 1.7	MIU4.12/14	3125	18-16d	2-10dx1 1/2"	14"	5000 1.7	VPA2.06	1081	9-10d	2-10dx1 1/2"
	6000 1.8	MIT3514-2	2400	8-16d	2-10dx1 1/2"		6000 1.8	MIU4.75/14	2395	18-16d	2-10dx1 1/2"		6000 1.8	VPA35	1230	9-10d	2-10dx1 1/2"
	6500 1.8	MIT314-2	2400	8-16d	2-10dx1 1/2"		6500 1.8	MIU5.12/14	3125	18-16d	2-10dx1 1/2"		6500 1.8	VPA3	1230	9-10d	2-10dx1 1/2"
	60 2.0	MIT3514-2	2400	8-16d	2-10dx1 1/2"		60 2.0	MIU4.75/14	2395	18-16d	2-10dx1 1/2"		60 2.0	VPA35	1225	9-10d	2-10dx1 1/2"
16"	90 2.0	B712/14	3800	14-16d	6-10d	16"	90 2.0	HU414-2	2680	20-16d	8-16d	16"	90 2.0	VPA4	1230	11-10d	2-10dx1 1/2"
	6000 1.8	MIT4.75/16	2305	8-16d	2-10dx1 1/2"		6000 1.8	MIU4.75/16	2660	20-16d	2-10dx1 1/2"		6000 1.8	VPA35	1230	9-10d	2-10dx1 1/2"
	6500 1.8	MIT5.12/16	2400	8-16d	2-10dx1 1/2"		6500 1.8	MIU5.12/16	3125	20-16d	2-10dx1 1/2"		6500 1.8	VPA3	1230	9-10d	2-10dx1 1/2"
	60 2.0	MIT4.75/16	2305	3-16d	2-10dx1 1/2"		60 2.0	MIU4.75/16	2660	20-16d	2-10dx1 1/2"		60 2.0	VPA35	1228	9-10d	2-10dx1 1/2"
18"	90 2.0	B712/16	3800	14-16d	6-16d	18"	90 2.0	HU414-2	2680	20-16d	8-16d	18"	90 2.0	VPA4	1230	11-10d	2-10dx1 1/2"
	90 2.0	B712/18	3800	3-16d	6-16d		90 2.0	HU414-2	2680	20-16d	8-16d		90 2.0	VPA4	1230	11-10d	2-10dx1 1/2"
20"	90 2.0	B712/20	3800	3-16d	6-16d	20"	90 2.0	HU414-2	2680	20-16d	8-16d	20"	90 2.0	VPA4	1230	11-10d	2-10dx1 1/2"
Adjustable Height Joist Hanger						Field Slope and Skew Joist Hanger						SIMPSON Strong-Tie® CONNECTORS					
																	
Joist Depth	BCI*	Hanger	Capacity [lbs]	Nailing		Joist Depth	BCI*	Hanger	Capacity [lbs]	Nailing		General Notes					
				Header	Joist					Header	Joist	- Bold Italic hangers require web stiffeners. - Capacities will vary with different nailing criteria and/or support conditions; contact supplier or Simpson Strong-Tie for further information. - Capacity values shown are either hanger capacity values (see support requirements below) or BCI* Joist end reaction capacities – whichever less. - All capacity values are downward loads at 100% load duration. - Use sloped seat hangers when BCI* Joist slope exceeds 1/4" per foot. - Use sloped seat hangers and beveled web stiffeners when BCI* Joist slope exceeds 1/4" per foot. - Leave 1/8" clearance (1/8" maximum) between the end of the supported joist and the head of the hanger. - At max design capacity shown, hangers may exceed standard 1/2" deflection by 1/32". - For proper installation of the VPA, the 2-10dx1 1/2" joist nails through the bend tabs must be installed at approximately a 45-degree angle.					
9 1/2"	5000 1.7	THAI2.06/22	1181	6-10d	2-10dx1 1/2"	9 1/2"	5000 1.7	LSSU2.06	995	9-10d	7-10dx1 1/2"	Support Requirements					
	6000 1.8	THAI3522	1393	6-10d	2-10dx1 1/2"		6000 1.8	LSSU35	995	9-10d	7-10dx1 1/2"	- Support material assumed to be VERSA-LAM® or BOISE GLULAM® or sawn lumber (Douglas fir or southern pine species).					
	6500 1.8	THAI322	1393	6-10d	2-10dx1 1/2"		6500 1.8	LSSUH310	1425	14-10d	12-10dx1 1/2"	- Minimum support width for single- and double-joist top mount hangers is 3".					
	5000 1.7	THAI2.06/22	1443	6-10d	2-10dx1 1/2"		5000 1.7	LSSU2.06	995	9-10d	7-10dx1 1/2"	- Minimum support width for face mount hangers with 10d and 16d nails is 1 1/4" and 2", respectively.					
11 1/8"	6000 1.8	THAI3522	1443	6-10d	2-10dx1 1/2"	11 1/8"	6000 1.8	LSSU35	995	9-10d	7-10dx1 1/2"						
	6500 1.8	THAI322	1443	6-10d	2-10dx1 1/2"		6500 1.8	LSSUH310	1475	14-10d	12-10dx1 1/2"						
	60 2.0	THAI3522	1439	6-10d	2-10dx1 1/2"		60 2.0	LSSU35	995	9-10d	7-10dx1 1/2"						
	90 2.0	THAI422	1715	6-10d	2-10dx1 1/2"		90 2.0	LSSU410	1625	14-16d	12-10dx1 1/2"						
14"	5000 1.7	THAI2.06/22	1600	6-10d	2-10dx1 1/2"	14"	5000 1.7	LSSU2.06	995	9-10d	7-10dx1 1/2"						
	6000 1.8	THAI3522	1600	6-10d	2-10dx1 1/2"		6000 1.8	LSSU35	995	9-10d	7-10dx1 1/2"						
	6500 1.8	THAI322	1600	6-10d	2-10dx1 1/2"		6500 1.8	LSSUH310	1600	14-10d	12-10dx1 1/2"						
	60 2.0	THAI3522	1582	6-10d	2-10dx1 1/2"		60 2.0	LSSU35	995	9-10d	7-10dx1 1/2"						
18"	90 2.0	THAI422	1715	6-10d	2-10dx1 1/2"	18"	90 2.0	LSSU410	1625	14-16d	12-10dx1 1/2"						
	90 2.0	THAI422	1715	6-10d	2-10dx1 1/2"		90 2.0	LSSU410	1625	14-16d	12-10dx1 1/2"						

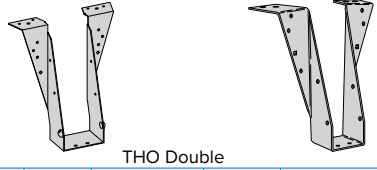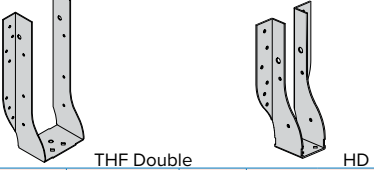
Single Joist - Top Flange						Single Joist - Face Mount						Face Mount Skewed 45° Joist Hanger					
 THO TFL						 THF						 SKH					
Joist Depth	BCI*	Hanger	Capacity [lbs]	Nailing		Joist Depth	BCI*	Hanger	Capacity [lbs]	Nailing		Joist Depth	BCI*	Hanger	Capacity [lbs]	Nailing	
9½"	5000 1.7	TFL2095	993	(6) 10d	2-10dx1½"	9½"	5000 1.7	THF20925	910	(8) 10d	2-10dx1½"	9½"	5000 1.7	SKH2020L/R	1153	(14) 10d	10-10dx1½"
	6000 1.8	TFL2395	1225	(6) 10d	2-10dx1½"		6000 1.8	THF23925	1275	(12) 10d	2-10dx1½"		6000 1.8	SKH2320L/R	1384	(14) 10d	10-10dx1½"
	6500 1.8	TFL2595	1225	(6) 10d	2-10dx1½"		6500 1.8	THF26925	1275	(12) 10d	2-10dx1½"		6500 1.8	SKH2520L/R	1384	(14) 10d	10-10dx1½"
	5000 1.7	TFL20118	1068	(6) 10d	2-10dx1½"		5000 1.7	THF20112	910	(8) 10d	2-10dx1½"		5000 1.7	SKH2020L/R	1434	(16) 10d	10-10dx1½"
11⅞"	6000 1.8	TFL23118	1237	(6) 10d	2-10dx1½"	11⅞"	6000 1.8	THF23118	1300	(14) 10d	2-10dx1½"	11⅞"	6000 1.8	SKH2320L/R	1434	(16) 10d	10-10dx1½"
	6500 1.8	TFL25118	1237	(6) 10d	2-10dx1½"		6500 1.8	THF26112	1300	(14) 10d	2-10dx1½"		6500 1.8	SKH2520L/R	1434	(16) 10d	10-10dx1½"
	60 2.0	TFL23118	1210	(6) 10d	2-10dx1½"		60 2.0	THF23118	1282	(14) 10d	2-10dx1½"		60 2.0	SKH2320L/R	1428	(16) 10d	10-10dx1½"
	90 2.0	THO35118	1558	(10) 10d	2-10dx1½"		90 2.0	THF35112	1585	(16) 10d	2-10dx1½"		90 2.0	SKH410L/R*	1892	(16) 16d	10-16d
14"	5000 1.7	TFL2014	1081	(6) 10d	2-10dx1½"	14"	5000 1.7	THF20140	1081	(12) 10d	2-10dx1½"	14"	5000 1.7	SKH2024L/R	1562	(16) 10d	10-10dx1½"
	6000 1.8	TFL2314	1262	(6) 10d	2-10dx1½"		6000 1.8	THF23140	1350	(18) 10d	2-10dx1½"		6000 1.8	SKH2324L/R	1562	(16) 10d	10-10dx1½"
	6500 1.8	TFL2514	1262	(6) 10d	2-10dx1½"		6500 1.8	THF26140	1350	(18) 10d	2-10dx1½"		6500 1.8	SKH2524L/R	1562	(16) 10d	10-10dx1½"
	60 2.0	TFL2314	1225	(6) 10d	2-10dx1½"		60 2.0	THF23140	1325	(18) 10d	2-10dx1½"		60 2.0	SKH2324L/R	1539	(16) 10d	10-10dx1½"
16"	90 2.0	THO35140	1592	(12) 10d	2-10dx1½"	16"	90 2.0	THF35140	1621	(20) 10d	2-10dx1½"	16"	90 2.0	SKH414L/R*	2035	(22) 16d	10-16d
	6000 1.8	TFL2316	1268	(6) 10d	2-10dx1½"		6000 1.8	THF23160	1362	(22) 10d	2-10dx1½"		6000 1.8	SKH2324L/R	1690	(16) 10d	10-10dx1½"
	6500 1.8	TFL2516	1268	(6) 10d	2-10dx1½"		6500 1.8	THF26160	1362	(22) 10d	2-10dx1½"		6500 1.8	SKH2524L/R	1690	(16) 10d	10-10dx1½"
	60 2.0	TFL2316	1228	(6) 10d	2-10dx1½"		60 2.0	THF23160	1335	(22) 10d	2-10dx1½"		60 2.0	SKH2324L/R	1650	(16) 10d	10-10dx1½"
18"	90 2.0	THO35160	1626	(12) 10d	2-10dx1½"	18"	90 2.0	THF35157	1657	(22) 10d	2-10dx1½"	18"	90 2.0	SKH414L/R*	2235	(22) 16d	10-16d
20"	90 2.0	THO35180	2389	(14) 10d	2-10dx1½"	20"	90 2.0	THF35165	2407	(24) 10d	8-10dx1½"	20"	90 2.0	SKH418L/R*	2407	(28) 16d	10-16d
20"	90 2.0	THO35200	2553	(14) 10d	2-10dx1½"	20"	90 2.0	THF35165	2564	(24) 10d	8-10dx1½"	20"	90 2.0	SKH418L/R*	2564	(28) 16d	10-16d
Double Joist - Top Flange						Double Joist - Face Mount						Variable Pitch Joist Connector					
 THO Double BPH						 THF Double HD						 TMP					
Joist Depth	BCI*	Hanger	Capacity [lbs]	Nailing		Joist Depth	BCI*	Hanger	Capacity [lbs]	Nailing		Joist Depth	BCI*	Hanger	Capacity [lbs]	Fastener	
9½"	5000 1.7	THO20950-2	2330	(10) 16d	6-10d	9½"	5000 1.7	THF20925-2	1390	(12) 10d	6-10d	9½"	5000 1.7	TMP21	1125	(6) 10d	4-10dx1½"
	6000 1.8	THO23950-2	2825	(10) 10d	6-10d		6000 1.8	THF23925-2	1625	(14) 10d	6-10d		6000 1.8	TMP23	1375	(6) 10d	4-10dx1½"
	6500 1.8	THO25950-2	2650	(10) 16d	6-10d		6500 1.8	THF26925-2	1390	(12) 10d	6-10d		6500 1.8	TMP25	1375	(6) 10d	4-10dx1½"
	5000 1.7	THO20118-2	2330	(10) 16d	6-10d		5000 1.7	THF20112-2	1855	(16) 10d	6-10d		5000 1.7	TMP21	1150	(6) 10d	4-10dx1½"
11⅞"	6000 1.8	THO23118-2	2925	(10) 10d	6-10d	11⅞"	6000 1.8	THF23118-2	1855	(16) 10d	6-10d	11⅞"	6000 1.8	TMP23	1425	(6) 10d	4-10dx1½"
	6500 1.8	THO25118-2	2925	(10) 16d	6-10d		6500 1.8	THF26112-2	1855	(16) 10d	6-10d		6500 1.8	TMP25	1425	(6) 10d	4-10dx1½"
	60 2.0	THO23118-2	2921	(10) 16d	6-10d		60 2.0	THF23118-2	1855	(16) 10d	6-10d		60 2.0	TMP23	1425	(6) 10d	4-10dx1½"
	90 2.0	BPH71118	3455	(10) 16d	6-10d		90 2.0	HD7120	2255	(16) 16d	6-10d		90 2.0	TMP4	1800	(6) 10d	4-10dx1½"
14"	5000 1.7	THO20140-2	2330	(10) 16d	6-10d	14"	5000 1.7	THF20140-2	2320	(20) 10d	6-10d	14"	5000 1.7	TMP21	1150	(6) 10d	4-10dx1½"
	6000 1.8	THO23140-2	3350	(12) 10d	6-10d		6000 1.8	THF23140-2	2540	(20) 10d	6-10d		6000 1.8	TMP23	1525	(6) 10d	4-10dx1½"
	6500 1.8	THO25140-2	3050	(12) 16d	6-10d		6500 1.8	THF26140-2	2500	(20) 10d	6-10d		6500 1.8	TMP25	1525	(6) 10d	4-10dx1½"
	60 2.0	THO23140-2	3335	(12) 16d	6-10d		60 2.0	THF23140-2	2540	(20) 10d	6-10d		60 2.0	TMP23	1525	(6) 10d	4-10dx1½"
16"	90 2.0	BPH7114	3455	(10) 16d	6-10d	16"	90 2.0	HD7140	2820	(20) 16d	6-10d	16"	90 2.0	TMP4	1850	(6) 10d	4-10dx1½"
	6000 1.8	THO23160-2	3535	(12) 16d	6-10d		6000 1.8	THF23160-2	3050	(24) 10d	6-10d		6000 1.8	TMP23	1550	(6) 10d	4-10dx1½"
	6500 1.8	THO25160-2	3535	(12) 16d	6-10d		6500 1.8	THF26160-2	3000	(24) 10d	6-10d		6500 1.8	TMP25	1550	(6) 10d	4-10dx1½"
	60 2.0	THO23160-2	3535	(12) 16d	6-10d		60 2.0	THF23160-2	3050	(24) 10d	6-10d		60 2.0	TMP23	1550	(6) 10d	4-10dx1½"
18"	90 2.0	BPH7116	3455	(10) 16d	6-10d	18"	90 2.0	HD7160	3385	(24) 16d	6-10d	18"	90 2.0	TMP4	1900	(6) 10d	4-10dx1½"
20"	90 2.0	BPH7118	3510	(10) 16d	6-10d	20"	90 2.0	HD7180	3920	(28) 16d	6-10d	20"	90 2.0	TMP4	1970	(6) 10d	4-10dx1½"
20"	90 2.0	BPH7120	3510	(10) 16d	6-10d	20"	90 2.0	HD7180	3920	(28) 16d	6-10d	20"	90 2.0	TMP4	1970	(6) 10d	4-10dx1½"
Adjustable Height Joist Hanger						Field Slope and Skew Joist Hanger						General Notes					
 MSH						 LSSH						 USP STRUCTURAL CONNECTORS A Mitek Company					
For more information, contact USP Lumber Connectors at 1-800-328-5934 or www.uspconnectors.com																	
Joist Depth	BCI*	Hanger	Capacity [lbs]	Nailing		Joist Depth	BCI*	Hanger	Capacity [lbs]	Nailing							
9½"	5000 1.7	-	-	-	-	9½"	5000 1.7	LSSH20	1140	(10) 10d	7-10dx1½"						
	6000 1.8	MSH2318	1381	(6) 10d	4-10dx1½"		6000 1.8	LSSH23	1140	(10) 10d	7-10dx1½"						
	6500 1.8	MSH318	1381	(6) 10d	4-10dx1½"		6500 1.8	LSSH25	1412	(14) 10d	12-10dx1½"						
11⅞"	5000 1.7	-	-	-	-	11⅞"	5000 1.7	LSSH20	1140	(10) 10d	7-10dx1½"						
	6000 1.8	MSH2318	1431	(6) 10d	4-10dx1½"		6000 1.8	LSSH23	1140	(10) 10d	7-10dx1½"						
	6500 1.8	MSH318	1431	(6) 10d	4-10dx1½"		6500 1.8	LSSH25	1462	(14) 10d	12-10dx1½"						
	60 2.0	MSH2318	1425	(6) 10d	4-10dx1½"		60 2.0	LSSH23	1140	(10) 10d	7-10dx1½"						
14"	90 2.0	MSH422	1850	(6) 10d	6-10d	14"	90 2.0	LSSH35	1920	(14) 16d	12-10dx1½"						
	5000 1.7	-	-	-	-		5000 1.7	LSSH20	1140	(10) 10d	7-10dx1½"						
	6000 1.8	MSH2322	1550	(6) 10d	4-10dx1½"		6000 1.8	LSSH23	1140	(10) 10d	7-10dx1½"						
	6500 1.8	MSH318	1550	(6) 10d	4-10dx1½"		6500 1.8	LSSH25	1675	(14) 10d	12-10dx1½"						
16"	60 2.0	MSH2322	1525	(6) 10d	4-10dx1½"	16"	60 2.0	LSSH23	1140	(10) 10d	7-10dx1½"						
	90 2.0	MSH422	1950	-	6-10d		90 2.0	LSSH35	1920	(14) 16d	12-10dx1½"						
												Support Requirements					
												- Support material assumed to be VERSA-LAM® or BOISE GLULAM® or sawn lumber (Douglas fir or southern pine species).					
												- Minimum support width for single- and double-joist top mount hangers is 3" (1½" for THO hangers).					
												- Minimum support width for face mount hangers with 10d and 16d nails in 4x4 and 2x10 respectively.					

FASTER. STRONGER. EASIER.



Lifetime Guaranteed Quality and Performance

Boise Cascade warrants its BCI® Joist, Versa-Lam® LVL and ALLJOIST® products to comply with our specifications, to be free from defects in material and workmanship, and to meet or exceed our performance specifications for the normal and expected life of the structure when correctly stored, installed and used according to our Installation Guide.

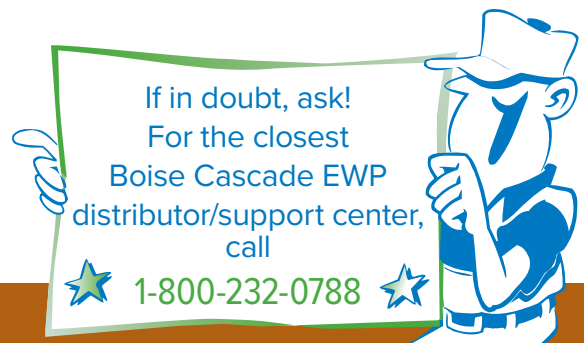

For information about
Boise Cascade's Engineered Wood Products, visit our website at
www.BC.com/ewp

Your Dealer is:



Boise Cascade®
ENGINEERED WOOD PRODUCTS

If no dealer is listed, call 1-800-232-0788